Issue No.:Issue 1Issue Date:November 2021Project No.:1825



# MONTHLY ENVIRONMENTAL MONITORING & AUDIT REPORT (OCTOBER 2021)

FOR

# PORT SHELTER PHASE 3, PO TOI O SEWERAGE TREATMENT PLANT

Prepared by

Allied Environmental Consultants Limited

**COMMERCIAL-IN-CONFIDENCE** 

Allied Environmental Consultants Limited Member of AEC Group (HKEX Stock Code: 8320.HK) 27/F, Overseas Trust Bank Building, 160 Gloucester Road, Wan Chai, Hong Kong www.asecg.com T: +852 2815 7028 F: +852 2815 5399 **沛然環境評估工程顧問有限公司** 沛然環保集團成員(港交所股份代號:8320.HK) 香港灣仔告士打道 160 號海外信託銀行大廈 27 樓 Issue No.:Issue 1Issue Date:November 2021Project No.:1825



MONTHLY ENVIRONMENTAL MONITORING & AUDIT REPORT (OCTOBER 2021)

FOR

# PORT SHELTER PHASE 3, POTOIOSEWERAGETREATMENT PLANT

Prepared by

Allied Environmental Consultants Limited

COMMERCIAL-IN-CONFIDENCE

Certified by:

Verified by:

Jan (loa

F.C. TSANG U Independent Environmental Checker

Allied Environmental Consultants Limited Member of AEC Group (HKEX Stock Code: 8320.HK) **沛然環境評估工程顧問有限公司** 沛然環保集團成員(港交所股份代號:8320.HK) 香港灣仔告士打道 160 號海外信託銀行大廈 27 樓

27/F, Overseas Trust Bank Building, 160 Gloucester Road, Wan Chai, Hong Kong www.asecg.com T: +852 2815 7028 F: +852 2815 5399

Timmy WONG

**Environmental Team Leader** 



Our Ref: PL-202111021

Drainage Services Department Special Duty Division 42/F, Revenue Tower, 5 Gloucester Road, Wan Chai, Hong Kong.

Attention: Ms. Wing W.Y. Law

11 November 2021

Dear Wing,

Port Shelter Sewerage, Stage3 - Sewerage Works at Po Toi O Monthly EM&A Report for October 2021

Referring to the captioned report (Issue No. 1) for October 2021, please be informed that we have no further comments on the report. We hereby verify the report as per Condition 3.4 of the Environmental Permit (No. EP 516/2016).

Website: www.acuityhk.com Unit E, 12/F., Ford Glory Plaza, Nos. 37-39 Wing Hong Street, Cheung Sha Wan, Kowloon, HK

Tel. : (852) 2698 6833

Fax.: (852) 2698 9383

Yours faithfully,

Toam Jan Bearg

F.C. Tsang Independent Environmental Checker

cc. ETL – Timmy WONG

# **Document Verification**



Project TitlePort Shelter Phase 3, Po Toi OProject No.Sewerage Treatment Plant1825Document TitleMonthly Environmental Monitoring & Audit Report<br/>(October 2021)

Issue No. Issue Date 1 November 2021

Description
2021 1st Submission

sion Timmy Wong

Prepared by

may

Checked by Joanne Ng

.

Approved by

Grace Kwok

Allied Environmental Consultants Limited

Member of AEC Group (HKEX Stock Code: 8320.HK) 27/F, Overseas Trust Bank Building, 160 Gloucester Road, Wan Chai, Hong Kong www.asecg.com T: +852 2815 7028 F: +852 2815 5399 **沛然環境評估工程顧問有限公司** 沛然環保集團成員(港交所股份代號: 8320.HK)

香港灣仔告士打道 160 號海外信託銀行大廈 27 樓

# **Table of Contents**

1.	Executive Summary	1
1.2.	Key Construction Works During the Reporting Period	1
1.3.	Summary of Exceedances, Investigation and Follow-up	1
1.4.	Complaint Handling, Prosecution and Public Engagement	1
1.5.	Reporting Change of EM&A Programme	2
1.6.	Future Key Issues	2
2.	Introduction	3
2.2.	Project Background	3
2.3.	Scope of Report	4
2.4.	Project Organisation	4
2.5.	Construction Programme and Activities	5
3.	Air Quality	6
3.1.	Monitoring Requirements	6
3.2.	Monitoring Equipment	6
3.3.	Monitoring Parameters, Frequency and Duration	8
3.4.	Monitoring Locations	8
3.5.	Monitoring Methodology	9
3.6.	Monitoring Results and Observations1	2
3.7.	Other Influencing Factors of the Monitoring Results1	3
4.	Noise1	.4
4.1.	Monitoring Requirements1	.4
4.2.	Monitoring Equipment1	.4
4.3.	Monitoring Locations1	5
4.4.	Monitoring Parameters and Frequency1	.6
4.5.	Monitoring Methodology1	.6
4.6.	Monitoring Results and Observations1	7

Project No. 1825

	ithly Environmental Monitoring & Audit Report (October 2021) for Port Shelter Phase 3, Po Toi O Sewer tment Plant	age
4.7.	Other Influencing Factors of the Monitoring Results	. 18
5.	Water Quality	. 19
5.1.	Monitoring Requirements	. 19
5.2.	Monitoring Parameters and Frequency	.20
5.3.	Monitoring Locations	.20
5.4.	Results and Observations	.21
6.	Environmental Site Inspection and Audit	.22
6.1.	Site Inspection	.22
6.2.	Waste Management	.26
6.3.	Status of Environmental Licenses, Notification and Permits	.27
6.4.	Implementation Status on Environmental Protection Requirements	.27
6.5. Enga	Summary of Complaints, Notification of Summons, Successful Prosecutions and Pu	
7.	Future Key Issues	.28
7.1.	Construction Programme for the Upcoming Reporting Month	. 28
7.2.	Reinstatement Works Key Issues for the Upcoming Reporting Month	. 28
7.3.	Monitoring Schedule for the Coming Month	. 28
8.	Conclusion	. 29
8.1.	General	. 29
8.2.	Environmental Impact Monitoring	. 29
8.3.	Environmental Site Inspections	. 29
8.4.	Complaint Log	. 29
8.5.	Reporting Changes	. 29
8.6.	Notifications of Summons and Successful Prosecutions	. 29

# **List of Tables**

Table 2-1	Contact Information of Key Personnel4
Table 3-1	Action and Limit Levels for 1-hour TSP6
Table 3-2	Action and Limit Levels for 24-hour TSP6
Table 3-3	Equipment Used for Air Quality Monitoring7
Table 3-4	Monitoring Parameters for Air Quality Monitoring8
Table 3-5	Location of Air Quality Monitoring Stations9
Table 3-6	1-hour Air Quality Monitoring Results in the Reporting Period13
Table 3-7	24-hour Air Quality Monitoring Results in the Reporting Period13
Table 4-1	Action and Limit Levels for Construction Noise14
Table 4-2	Noise Monitoring Equipment15
Table 4-3	Description of Proposed Noise Monitoring Locations15
Table 4-4	Parameters for Noise Impact Monitoring16
Table 4-5	Summary of Construction Noise Monitoring Results in the Reporting Period17
Table 5-1	Parameters of Water Quality Monitoring20
Table 5-2	Summary of Water Quality Impact Monitoring Stations21
Table 6-1	Observations and Recommendations in the Reporting Month22
Table 6-2	Summary of Waste Flow Table26
Table 6-3	Status of Environmental License, Notification and Permit27

# **List of Figures**

Figure 2-1	Layout Plan of the Captioned Project
Figure 3-1	Proposed Air Quality and Nosie Monitoring Stations Locations
Figure 5-1	Locations of Water Quality Impact Monitoring Stations

# **List of Appendices**

Appendix 2-1	Project Organization Chart
Appendix 2-2	Construction Works Programme
Appendix 3-1	Meteorlogical Data
Appendix 3-2	Air Quality Monitoring Equipment Calibration Certificates
Appendix 3-3	High-Volume Sampler Calibration Calculation Spreadsheet
Appendix 3-4	Methodology for Correlation Calculation between Potable Laser Dust Meter and
	High-Volume Sampler
Appendix 3-5	Correlation Calculation between Potable Laser Dust Meter and High-Volume
	Sampler
Appendix 3-6	Air Quality and Nosie Impact Monitoring Schedule
Appendix 3-7	1 hr and 24 hrs TSP Monitoring Result
Appendix 3-8	Event and Action Plan for Air Quality Impact Monitoring
Appendix 4-1	Noise Monitoring Equipment Calibration Certificates
Appendix 4-2	Noise Impact Monitoring Results
Appendix 4-3	Event and Action Plan for Noise Impact Monitoring
Appendix 6-2	Monthly Summary of Waste Flow
Appendix 6-3	Impletementation Schedule of Recommended Mitgation Measures
Appendix 6-4	Recommended Mitigation Measures and Proactive Environmental Protection
	Proforma
Appendix 6-5	Cumulative Statistics on Complaints, Notifications of Summons

# 1. Executive Summary

- 1.1.1. The proposed sewerage works in Po Toi O (hereafter as "the Project") is an environmental enhancement project that aims to improve environmental hygiene of the Po Toi O area. The Environmental Impact Assessment (EIA) Report for the Project (Register No: AEIAR-206/2017) was approved on 27 January 2017. The Environmental Permit (EP) (Permit No.: EP-516/2016) was issued on 27 January 2017 and is the current permit for the Project.
- 1.1.2. Allied Environmental Consultants (AEC) has been appointed by Drainage Services Department (DSD) as the Environmental Team (ET) to undertake the EM&A programme during construction phase of the Project in accordance to the approved EM&A Manual for the Project.
- 1.1.3. This is the 8<sup>th</sup> monthly Environmental Monitoring & Audit (EM&A) Report prepared by Allied Environmental Consultants Limited (AEC) for the Project. This report summarized the monitoring results and audits findings of the EM&A programme under the EP and the EM&A Manual of the Project during the reporting period of 1 October 2021 to 31 October 2021.

# **1.2.** Key Construction Works During the Reporting Period

- 1.2.1. The main works undertaken during the reporting period are as follows:
  - PTO-SW-03 (Open Trench, 25 nos., Length: 360m)
  - a) Construction of village sewer
  - <u>Po Toi O Sewerage Treatment Plant (PTOSTP)</u>
  - a) Installation of rock fall fencing
  - b) Installation of addition silt curtain for the construction of STP

## 1.3. Summary of Exceedances, Investigation and Follow-up

1.3.1. There was no action or limit level exceedance record of construction noise and air quality was recorded in the reporting month.

## 1.4. Complaint Handling, Prosecution and Public Engagement

1.4.1. No complaints, notification of summons and successful prosecution was received in the reporting period. No public engagement activity was conducted in the reporting month.

1.4.2. No air quality, noise and water complaints during 0700 – 1900 hours on normal weekdays was received in the reporting month.

# 1.5. Reporting Change of EM&A Programme

1.5.1. No reporting change of the EM&A programme in this reporting month.

## 1.6. Future Key Issues

- 1.6.1. The main works will be anticipated in the next reporting period are as follows:
  - PTO-SW-03 (Open Trench, 25 nos., Length: 360m)
  - a) Construction of village sewer
  - <u>Po Toi O Sewerage Treatment Plant (PTOSTP)</u>
  - a) Installation of rock fall fencing

# 2. Introduction

2.1.1. Allied Environmental Consultants (AEC) has been appointed by Drainage Services Department (DSD) as the Environmental Team (ET) to undertake the EM&A programme during construction phase of the Project in accordance to the approved EM&A Manual for the proposed sewerage works in Po Toi O (hereafter as "The Project"), an environmental enhancement project that aims to improve environmental hygiene of the Po Toi O area.

# 2.2. Project Background

- 2.2.1. Po Toi O is located in the southern part of Sai Kung District, next to Clear Water Bay. There is a small settlement called Po Toi O village around the bay. There is currently no public sewerage system for the village. Sewage and wastewater generated by local residents and local restaurants are treated by septic tanks/ soakaway system (STS).
- 2.2.2. Sewage works at Po Toi O comprise sewage collection, treatment and disposal facilities at Po Toi O under Port Shelter Sewerage, Stage 3 Sewerage Works at Po Toi O.
- 2.2.3. The Project in Po Toi O mainly comprises of the following items:
  - i. Provision of village sewerage to the unsewered areas of Po Toi O. The works involve construction of about 800m of gravity sewers and 400m of rising mains;
  - ii. Construction of a local sewage treatment plant (STP) with Average Dry Weather Flow (ADWF) of about 139m3/day; and
  - iii. Construction of a submarine outfall of about 385m in length.
- 2.2.4. The Project consists of the following works, which are classified as Designated Projects under Part I, Schedule 2 of the Environmental Impact Assessment Ordinance (EIAO):
  - Item Q.1 A sewage treatment plant and portion of sewer alignments in a conservation area;
  - ii. Item C.12 (a) (v) and (vii) A dredging operation which is less than 500m from the nearest boundary of an existing fish culture zone and coastal protection area; and
  - iii. Item F.6 A submarine sewage outfall.
- 2.2.5. The Environmental Impact Assessment (EIA) Report "Port Shelter Sewerage, Stage 3 Sewerage Works at Po Toi O" (Register No: AEIAR-206/2017) was approved on 27 January 2017. A Variation of an Environmental Permit (VEP) (Permit No.: EP-516/2016) was issued on 27 January 2017 and is the current permit for the Project.

- 2.2.6. The EM&A programme of the Project shall be implemented in accordance with the requirements and procedures set out in the EM&A Manual and the Environmental Permit (EP) of the Project (Permit No.: EP-516/2016).
- 2.2.7. The air quality and noise baseline monitoring works were conducted from 23 December 2020 to 5 January 2021 and the water quality baseline monitoring work was conducted from 17 December 2020 to 12 January 2021. A Baseline Monitoring Report had been submitted to EPD on 10 February 2021.

# 2.3. Scope of Report

2.3.1. This is the 8<sup>th</sup> EM&A Report prepared by AEC for the Port Shelter Sewerage, Stage 3 – Sewerage Works at Po Toi O. This report summarized the monitoring results and audits findings of the EM&A programme under the EP of the Project and in accordance with the EM&A Manual during the reporting period of 1 October 2021 to 31 October 2021.

# 2.4. Project Organisation

2.4.1. The project organization structure is shown in *Appendix 2-1*. The key personnel contact names and numbers are summarized in *Table 2-1*.

Position	Party	Name	Telephone	
Project Proponent	Drainage Services	Ms. Yuen Ho Yan	2594 7353	
	Department (DSD)			
Resident Engineer	Binnies Hong Kong Limited	Mr. Eugene Chan	6392 3809	
(RE)	(Binnies)	With Eugenie Chair	0392 3809	
Independent	A suite Custoire bilite		2698 8060	
Environmental	Acuity Sustainability	Dr. F.C. Tsang		
Checker (IEC)	Consulting Limited (ASC)			
Environmental	Allied Environmental	Mr. Timmy Mong	3915 7186	
Team (ET)	Consultants Limited (AEC)	Mr. Timmy Wong	3913 / 180	
Environmental	China Geo-engineering	Mr. Jospor Tong	6997 5530	
Officer (EO)	Corporation (CGC)	Mr. Jasper Tang	0337 3330	

 Table 2-1
 Contact Information of Key Personnel

# 2.5. Construction Programme and Activities

- 2.5.1. The main works will be anticipated in the reporting period are as follows:
  - PTO-SW-03 (Open Trench, 25 nos., Length: 360m)
  - b) Construction of village sewer
  - <u>Po Toi O Sewerage Treatment Plant (PTOSTP)</u>
  - c) Installation of rock fall fencing
  - d) Installation of addition silt curtain for the construction of STP
- 2.5.2. The Construction Programme is shown in *Appendix 2-2*. The general layout plan of the Project is shown in *Figure 2-1*.

# 3. Air Quality

# **3.1.** Monitoring Requirements

3.1.1. In accordance with the EM&A Manual, impact air quality monitoring shall be carried out throughout the construction period at all approved air quality monitoring locations (AMSs). 24-hours total suspended particles (TSP) monitoring shall be conducted at least once every 6 days. Meanwhile, 1-hour TSP monitoring shall be conducted at least 3 times every 6 days when the highest dust impact takes place. The Action and Limit levels for 1-hour and 24-hours TSP level are provided in *Table 3-1 and Table 3-2*.

Parameter	Air Quality Monitoring Station (AMSs)	Action Level (µg/m³)	Limit Level (µg/m³)
1-hr TSP	AMS1N	319	
(µg/m³)	AMS2N1	279	500µg/m³
	AMS3N	303	500µg/11
	AMS4N	278	

Table 3-1 Action and Limit Levels for 1-hour TSP

Table 3-2 Action and Limit Levels for 24-hour TSP

Parameter	Air Quality Monitoring Station (AMSs)	Action Level (μg/m³)	Limit Level (µg/m³)
24-hr TSP	AMS1N	153	260µg/m³
(µg/m³)	AMS2N1	179	
	AMS3N	158	
	AMS4N	144	

# 3.2. Monitoring Equipment

3.2.1. The 24-hour TSP air quality monitoring was performed using High Volume Air Samplers (HVS) at each of the designated monitoring stations. The HVS are calibrated by a HVS calibrator. Meanwhile 1-hour TSP air quality monitoring was performed using portable TSP monitors. The equipment used for air quality monitoring are given in *Table 3-3*.

Tuble 5-5 Equipment Osed for All Quality Monitoring.					
Air Quality Monitoring	Brand and Model of Equipment	Serial Number			
		4350			
		4374			
24-hour TSP*	Tisch TE-5170 High Volume Sampler	2089			
		3796			
	Tisch TE-5025A High Volume Sampler Calibrator	2154			
		620408			
1 h a	TSP Sibata LD-5R Portable TSP Monitors	882146			
1-hour TSP		882147			
		892186			

Table 3-3 Equipment Used for Air Quality Monitoring.

Note:

\* If 24-hour TSP monitoring is significantly affected by power supply inconsistency at Po Toi O village, 24-hour TSP monitoring will be conducted by direct reading dust meter instead. The proposal for the use of direct reading dust meters for 24-hour TSP monitoring was approved by IEC and ER of the Project.

- 3.2.2. Meteorological information (such as the humidity, rainfall, air pressure and temperature etc.) were collected from Hong Kong Observatory (HKO)'s Weather Stations.
- 3.2.3. According to the approved EM&A Manual, wind data monitoring equipment shall be provided and setup for logging wind speed and wind direction near the dust monitoring locations. The equipment installation location shall be proposed by the ET and agreed with the IEC. For installation and operation of wind data monitoring equipment, the following points shall be observed:
  - a) The wind sensors should be installed 10 m above ground so that they are clear of obstructions or turbulence caused by buildings.
  - b) The wind data should be captured by a data logger. The data shall be downloaded for analysis at least once a month.
  - c) The wind data monitoring equipment should be re-calibrated at least once every six months.
  - d) Wind direction should be divided into 16 sectors of 22.5 degrees each.

- 3.2.4. It is noted that after liaison with the Po Toi O resident's representative on 22 December 2020, the resident's representative has rejected the access to the space and power supply for ET to install the wind data monitoring stations. Therefore, ET had proposed the alternative method for wind data collection according to section 3.4.7 of EM&A Manual.
- 3.2.5. The alternative method for wind data collection was adopt the wind data information collected from the HKO's Waglan Island weather station as the representative wind data. Although there are other closer weather stations, Waglan Island Station was selected as it is the nearest weather station that measures wind data information mentioned above.
- 3.2.6. The meteorological data from HKO's Weather Station is given in *Appendix 3-1*.

## 3.3. Monitoring Parameters, Frequency and Duration

3.3.1. The parameters, duration and frequency for air quality impact monitoring is given in *Table 3-4*.

Identification No.		Parameters	Frequency
AMS1N*	Footpath above House		<u>1-hour TSP:</u>
AIVISTIN	No. 28 Po Toi O Chuen Road		At least 3
AMS2N1*	Open space Approx. 15 m from		times for 1-
AIVISZINT	Hung Shing Temple 1-hr TSP		hour with
AMS3N*	Vacant land near Temporary	24-hr TSP	every 6 days
AIVISSIN*	Structure (House) Rocky Shore		<u>24-hour TSP:</u>
AMS4N*			Once every 6
AIVI34IN	Resting shelter near Seacrest Villas		days

 Table 3-4
 Monitoring Parameters for Air Quality Monitoring

Notes:

\*- Due to a number of limitations identified at the air quality monitoring stations in the Approved EM&A Manual for the Project, the monitoring location AMS1 – AMS4 were replaced by alternative monitoring location AMS1N – AMS4N, which were approved by ER and IEC.

# 3.4. Monitoring Locations

3.4.1. Monitoring stations AMS1N, AMS2N1, AMS3N and AMS4N were set up in accordance to the requirements for placement of equipment, as set out in section 3.5.3 of the EM&A manual of the Project. The location of the new representative AMSs and air quality monitoring equipment used are given in *Table 3-5*. Locations of the alternative AMSs are given in *Figure 3-1*.

Identification No.	Location	Type of Monitoring	Duration	
AMS1N*	Footpath above House No. 28 Po Toi O	TSP 1 hr & 24		
AIVISTIN	Chuen Road	136	1 hr & 24 hrs	
AMS2N1*	Open space approximately 15 m from	TSP	1 hr & 24 hrs	
AIVISZINI	Hung Shing Temple		1111 & 24 1115	
AMS3N*	Vacant land near Temporary Structure	TSP 1 hr & 24 l		
AIVISSIN	(House) Rocky Shore		1111 & 24 1115	
AMS4N*	Resting shelter near Seacrest Villas	TSP	1 hr & 24 hrs	

Table 3-5 Location of Air Quality Monitoring Stations

Notes:

\*- Due to a number of limitations identified at the air quality monitoring stations in the Approved EM&A Manual for the Project, the monitoring location AMS1 – AMS4 were replaced by alternative monitoring location AMS1N – AMS4N, which were agreed by ER and IEC.

## 3.5. Monitoring Methodology

#### Monitoring Methodology for 24-hour TSP Monitoring

- 3.5.1. The HVS was installed in the vicinity of the air quality monitoring stations. The following criteria were considered in the installation of the HVS:
  - i. A horizontal platform with appropriate support to secure the sampler against gusty wind was provided.
  - ii. The distance between the HVS and any obstacles, such as buildings, was at least twice the height that the obstacle protrudes above the HVS.
  - iii. A minimum of 2 meters separation from walls, parapets and penthouse for rooftop sampler.
  - iv. A minimum of 2 meters separation from any supporting structure, measured horizontally.
  - v. No furnace or incinerator flues nearby.
  - vi. Airflow around the sampler was unrestricted.
  - vii. Permission was obtained to set up the samplers and access to the monitoring stations.
  - viii. A secured supply of electricity was obtained to operate the samplers.
  - ix. The sampler was located more than 20 meters from any dripline.
  - x. Any wire fence and gate, required to protect the sampler, did not obstruct the monitoring process.
  - xi. Flow control accuracy was kept within ±2.5% deviation over 24-hour sampling period.

- 3.5.2. The following procedures to be followed for the preparation of filter papers of the HVS:
  - i. Glass fibre filters, G810 were labelled and sufficient filters that were clean and without pinholes were selected.
  - ii. All filters were equilibrated in the conditioning environment for 24 hours before weighing. The conditioning environment temperature was around 25 °C and not variable by more than ±3 °C; the relative humidity (RH) was < 50% and not variable by more than ±5%. A convenient working RH was 40%.
  - iii. All filter papers were prepared and analysed by a HOKLAS accredited laboratory and has comprehensive quality assurance and quality control programmes.
- 3.5.3. The following procedures are followed throughout air quality monitoring works:
  - i. The power supply was checked to ensure the HVS works properly.
  - ii. The filter holder and the area surrounding the filter were cleaned.
  - iii. The filter holder was removed by loosening the four bolts and a new filter, with stamped number upward, on a supporting screen was aligned carefully.
  - iv. The filter was properly aligned on the screen so that the gasket formed an airtight seal on the outer edges of the filter.
  - v. The swing bolts were fastened to hold the filter holder down to the frame. The pressure applied was sufficient to avoid air leakage at the edges.
  - vi. Then the shelter lid was closed and was secured with the aluminium strip.
  - vii. The HVS was warmed-up for about 5 minutes to establish run-temperature conditions.
  - viii. A new flow rate record sheet was set into the flow recorder.
  - ix. On site temperature and atmospheric pressure readings were taken and the flow rate of the HVS was checked and adjusted at around 1.1 m<sup>3</sup> /min, and complied with the range specified in the updated EM&A Manual (i.e., 0.6-1.7 m<sup>3</sup> /min).
  - x. The programmable digital timer was set for a sampling period of 24 hrs, and the starting time, weather condition and the filter number were recorded.
  - xi. The initial elapsed time was recorded.
  - xii. At the end of sampling, on site temperature and atmospheric pressure readings were taken and the final flow rate of the HVS was checked and recorded.
  - xiii. The final elapsed time was recorded.
  - xiv. The sampled filter was removed carefully and folded in half-length so that only surfaces with collected particulate matter were in contact.

- xv. It was then placed in a clean plastic envelope and sealed.
- xvi. All monitoring information was recorded on a standard data sheet.
- 3.5.4. The following procedures are followed for the maintenance and calibration of HVS:
  - The HVS and its accessories were maintained in good working condition, such as replacing motor brushes routinely and checking electrical wiring to ensure a continuous power supply.
  - ii. 5-point calibration of the HVS was conducted using TE-5025A Calibration Kit prior to the commencement of monitoring. Bi-monthly 5-point calibration of the HVS will be carried out during impact monitoring. The details for HVS calibration against the TE-5025A Calibration Kit is given in *Appendix 3-3*.

## Monitoring Methodology for 24-hour TSP Monitoring by Direct Reading Dust Meters

- 3.5.5. Since power supply for HVS for 24-hour TSP monitoring at alternative monitoring locations (i.e., AMS1N to AMS4N) were rejected, the use of direct reading dust meters is adopted to measure both 1-hour and 24-hour average TSP levels for the reporting month.
- 3.5.6. In accordance to Condition 3.1 of the Project's EP and Section 3.3 of the Project's EM&A Manual, the proposal for alternative monitoring equipment (i.e., direct reading dust meter) for TSP monitoring was approved by IEC and ER.
- 3.5.7. The measuring procedures of the direct reading dust meters are given in **Section 3.5.10**.
- 3.5.8. 24 consecutive 1-hour TSP concentration measurement results is adopted for the evaluation of 24-hour TSP concentration. Results are manually logged daily, during daily maintenance of the dust meter. Calculation of the value of 24-hour TSP concentration is given by the average of 24 calculated 1-hour TSP concentration, where the calculated 1-hr TSP concentration is given by the product of the direct reading and the K-factor based on the correlation results between the direct reading meter and HVS. Details for the correlation methodology and correlation record are given in *Appendix 3-4* and *Appendix 3-5*.
- 3.5.9. HVS for 24-hr TSP monitoring will be adopted once secured supply of electricity becomes available for any agreed TSP monitoring locations.

# Monitoring Methodology for 1-Hour TSP Monitoring

3.5.10. The measuring procedures of the direct reading dust meters were in accordance with the Manufacturer's Instruction Manual as follows:
 Allied Environmental Consultants Limited
 Page 11

- i. Turn the power on.
- ii. Close the air collecting opening cover.
- iii. Push the "TIME SETTING" switch to [BG].
- iv. Push "START/STOP" switch to perform background measurement for 6 seconds.
- v. Turn the knob at SENSI ADJ position to insert the light scattering plate.
- vi. Leave the equipment for 1 minute upon "SPAN CHECK" is indicated in the display.
- vii. Push "START/STOP" switch to perform automatic sensitivity adjustment. This measurement takes 1 minute.
- viii. Pull out the knob and return it to MEASURE position.
- ix. Push the "TIME SETTING" switch the time set in the display to 3 hours.
- x. Lower down the air collection opening cover.
- xi. Push "START/STOP" switch to start measurement.
- 3.5.11. The following procedures are followed for the maintenance and calibration of direct reading dust meters:
  - i. The 1-hour TSP meter was calibrated at 1-year intervals against with high volume sampler.
  - ii. Calibration certificates of the Laser Dust Monitors are provided in *Appendix 3-2*. 1-hour validation checking of the TSP meter against HVS is carried out yearly at the air quality monitoring locations.

## 3.6. Monitoring Results and Observations

- 3.6.1. The schedule for environmental monitoring in the reporting period is provided in *Appendix 3-***6**.
- 3.6.2. The air quality monitoring results for 1-hour and 24-hour air quality monitoring are summarised in *Table 3-6* and *Table 3-7*. Air quality monitoring data and graphical presentation of the data are provided in *Appendix 3-7*.

Parameter	Monitoring Station	Average (μg/m³)	Range (µg/ m <sup>3</sup> )
	AMS1N	41.4	27.6 – 57.9
1-hr TSP in	AMS2N1	47.2	24.2 – 70.5
μg/m³	AMS3N	56.8	29.3 - 101.4
	AMS4N	43.7	24.6 - 53.1

 Table 3-6
 1-hour Air Quality Monitoring Results in the Reporting Period

 Table 3-7
 24-hour Air Quality Monitoring Results in the Reporting Period

Parameter	Monitoring Station	Average (μg/m³)	Range (µg/ m³)
	AMS1N	39.7	25.5 – 53.8
24-hr TSP in	AMS2N1	42.1	31.0 - 50.6
µg/m³	AMS3N	50.4	43.1 – 72.1
	AMS4N	41.1	35.6 - 46.2

- 3.6.3. No Action or Limit Level exceedances of air quality were recorded in the reporting month. No air quality complaints between 0700 1900 hours on normal weekdays (i.e., Mondays to Saturdays) were received in the reporting month.
- 3.6.4. The event and action plan for air quality monitoring are given in *Appendix 3-8*.

# 3.7. Other Influencing Factors of the Monitoring Results

- 3.7.1. Major emission sources during air quality monitoring in the reporting period were mainly vehicle emission from Po Toi O Chuen Road and nearby residents' activities.
- 3.7.2. The event and action plan for air quality monitoring are given in *Appendix 3-8*.

# 4. Noise

# 4.1. Monitoring Requirements

4.1.1. In accordance with the EM&A Manual, noise impact monitoring was conducted during daytime construction work on normal weekdays (0700-1900 hours between Monday to Saturday), 1 set of 30-min measurement shall be carried out at approved noise monitoring stations (NMSs) every week based on the measurement procedures under EPD's" Technical Memorandum for the Assessment of Noise from Places Other Than Domestic Premises, Public Places or Construction Sites". The Action and Limit levels for construction noise monitoring is provided in *Table 4-1*.

NMSs ID	Noise Sensitive Receivers	Description	Action Level	Limit Level
NMS1N	PTO N1	Footpath Above House No. 28	When one	
		Po Toi O Chuen Road	documented	
NMS2N1	PTO_N2	Open Space Approx. 15 m	complaint is	
	110_112	from Hung Shing Temple	received	75 dB(A)*
NMS3N	PTO_N3	Vacant Land Near Temporary	from any one of	75 UB(A)
1111331	FT0_N3	Structure (House) Rocky Shore	the noise sensitive	
NMS4N	SV/ N1	Resting Shelter Near Seacrest	receivers	
111113411	SV_N1	Villas		

 Table 4-1
 Action and Limit Levels for Construction Noise

Note: \*75 dB(A) for residential premises.

# 4.2. Monitoring Equipment

4.2.1. Noise monitoring was completed using sound level meters at each NMSs. The sound level meters deployed comply with the International Electrotechnical Commission Publications (IEC) 651:1979 (Type 1) and 804:1985 (Type 1) specifications. Acoustic calibrator was deployed to calibrate the sound level meters at a given sound pressure level. The equipment used for noise impact monitoring is given in *Table 4-2*.

···· · · · · · · · · · · · · · · · · ·				
Equipment	Brand and Model	Serial No. /Equipment		
		ID		
Integrated Sound Level Meter	Casella – CEL-63X	1488270		
Integrated Sound Level Meter	Casella – CEL-63X	2206937		
Integrated Sound Level Meter	Casella – CEL-63X	3756072		
Acoustic Calibrator	Casella – CEL-120/1	2383886		
Acoustic Calibrator	Casella – CEL-120/1	3321858		
Acoustic Calibrator	Casella – CEL-120/1	5230950		
Anemometer	SENSOR AR 816	2136513		

 Table 4-2
 Noise Monitoring Equipment

#### 4.3. Monitoring Locations

4.3.1. Due to the limitation posed by the approved monitoring stations set out by the EM&A manual, alternative monitoring stations NMS1N, NMS2N1, NMS3N and NMS4N were proposed in accordance to Section 4.5.3 of the EM&A Manual of the Project, and approved from the ER and the IEC. The locations of the NMSs are given in *Figure 3-1*, and the details of the monitoring stations are illustrated in *Table 4-3*.

 Table 4-3
 Description of Proposed Noise Monitoring Locations

NMSs ID	Location	Type of	Type of	Duration
		measurement	Monitoring	
Footpath above House No. 28				20 mins
INIVISTIN.	Po Toi O Chuen Road		Noise	30 mins
NMS2N1*	Open space approximately 15	Free-field		30 mins
INIVISZINT.	m from Hung Shing Temple			
NMS3N*	Vacant land near Temporary			30 mins
101015510	Structure (House) Rocky Shore			30 mins
	Resting shelter near Seacrest			30 mins
NMS4N*	Villas			50 mms

Notes:

\*For Free-field measurement, a correction of +3dB(A) should be made to the measured results.

\* Due to the limitation posed by the approved monitoring stations set out by the EM&A manual, four alternative representative Noise Quality Monitoring Stations (NMSs) are proposed. The alternative monitoring Locations were approved by ER and IEC.

## 4.4. Monitoring Parameters and Frequency

4.4.1. The monitoring parameters, frequency and duration of impact noise monitoring are summarised in *Table 4-4*.

Table 4-4 Parameters for Noise Impact Monitoring

Parameter and Duration	Frequency
30-mins measurement at each monitoring station between	
0700 and 1900 on normal weekdays.	At least once per week
$L_{eq}$ , $L_{10}$ and $L_{90}$ would be recorded.	

# 4.5. Monitoring Methodology

- 4.5.1. The measuring procedures of the sound level meter were in accordance with the Manufacturer's Instruction Manual as follows:
  - i. Free-field measurement was made for the noise monitoring stations.
  - ii. The sound level meter was set on a tripod at a height of 1.2 m above the ground.
  - iii. The battery condition was checked to ensure the correct functioning of the meter.
  - iv. Parameters such as frequency weighting, the time weighting and the measurement time were set as follows:
    - a. frequency weighting: A
    - b. Time weighting: Fast
    - c. Time measurement: Leq(30-minutes) during non-restricted hours i.e., 07:00 1900 on normal weekdays; Leq(5-minutes) during restricted hours i.e., 19:00 23:00 and 23:00 07:00 of normal weekdays, whole day of Sundays and Public Holidays
  - Prior to and after each noise measurement, the meter was calibrated using the acoustic calibrator at a specified sound pressure level at a specified frequency. If the difference in the calibration level before and after measurement was more than 1 dB(A), the measurement would be considered invalid and repeat of noise measurement would be required after re-calibration or repair of the equipment.
  - vi. During the monitoring period, the Leq, L10 and L90 were recorded. In addition, site conditions and noise sources were recorded on a standard record sheet.

- vii. Noise measurement was paused during periods of high intrusive noise (e.g., dog barking, helicopter noise) if possible. Observations were recorded when intrusive noise was unavoidable.
- viii. Noise monitoring was cancelled in the presence of fog, rain, wind with a steady speed exceeding 5m/s, or wind with gusts exceeding 10m/s.
- 4.5.2. The following procedures are followed for the maintenance and calibration of sound level meters:
  - i. The microphone head of the sound level meter was cleaned with soft cloth at regular intervals.
  - ii. The meter and calibrator were sent to the supplier or HOKLAS laboratory to check and calibrate at yearly intervals.
  - iii. Calibration certificates of the sound level meters and acoustic calibrators are provided in *Appendix 4-1*.

# 4.6. Monitoring Results and Observations

- 4.6.1. The schedule for environmental monitoring in the reporting period is provided in *Appendix 3-***6**.
- 4.6.2. The monitoring results for construction noise are summarised in *Table 4-5*. The noise monitoring data graphical presentation of the data is provided in *Appendix 4-2*.

NMSs ID	Construction Noise Level, dB(A)*, Leq (30 min)	Baseline Level, dB(A)	Limit Level, dB(A)
NMS1N	67.7 dB(A)	62.7 dB(A)	75
NMS2N1	64.2 dB(A)	61.8 dB(A)	75
NMS3N	65.8 dB(A)	64.6 dB(A)	75
NMS4N	57.9 dB(A)	58.1 dB(A)	75

 Table 4-5
 Summary of Construction Noise Monitoring Results in the Reporting Period

Note:

\*- A correction of +3 dB(A) was made to the free field measurements. Leq (30min) was measured at 0700-1900 hours on normal weekdays.

- 4.6.3. No Action or Limit Level exceedance of construction noise was recorded in the reporting month.
   No noise complaints from between 0700 1900 hours on normal weekdays was received in the reporting month.
- 4.6.4. The event and action plan are provided in *Appendix 4-3*.

## 4.7. Other Influencing Factors of the Monitoring Results

4.7.1. Major noise sources during noise monitoring in the reporting period were mainly road traffic noise.

# 5. Water Quality

# 5.1. Monitoring Requirements

- 5.1.1. With the recommendations of the Project's EIA report, water quality impact monitoring shall be carried out carried out 3 days per week, at mid-flood and mid-ebb tides (within ± 1.75 hour of the predicted time required) at all the approved Water Quality Monitoring Stations (WQMSs) during whole cofferdam installation/extraction work and during dredging works. The interval between two sets of monitoring shall not be less than 36 hours.
- 5.1.2. Replicate in-situ measurements of Suspended Solids (SS) and in-situ water quality data (temperature, pH, turbidity, water depth, salinity, dissolved oxygen and percentage of saturation) shall be collected.
- 5.1.3. Other relevant data should also be recorded, including monitoring location/position, time, tidal stages, weather conditions and any special observation or works that may affect the monitoring results in the vicinity.
- 5.1.4. To ensure sufficient data for robust analysis, duplicate in-situ data shall be collected. In case the difference in the duplicate in-situ measurement results is larger than 25%, the third set of in-situ measurement shall be carried out for result confirmation purpose.
- 5.1.5. Water samples shall be extracted at 1m below surface, 1m above seabed and the mid-depth level at where the water depth is at least 6m. However, if the water depth is less than 3m, water samples shall only be collected at the mid-depth level. For stations with depth less than 6m, the mid-depth sample can be omitted.
- 5.1.6. In addition, duplicated water samples for suspended solid analysis shall be collected at all the above stations and delivered to the HOKLAS accredited laboratory for analysis. Results for suspended solids shall be received back from the laboratory within 24-hour of the receipt of the samples.
- 5.1.7. Water quality impact monitoring shall also be conducted at the same frequency as monitoring throughout the whole cofferdam installation/extraction work and during dredging work. In case of exceedance of Action/Limit Level recorded, the frequency of water quality monitoring shall be increased as per the Event and Action Plan.
- 5.1.8. The water quality impact monitoring schedule shall be issued to IEC at least one month prior to the commencement of Impact Monitoring.

# 5.2. Monitoring Parameters and Frequency

5.2.1. The monitoring parameters, monitoring periods and frequencies of the water quality monitoring are summarised in *Table 5-1*.

Parameters	Duration	Frequency
Temperature (°C)	During Construction Phase:	3 days per week
pH (pH unit)	Throughout installation	(The interval between two
Turbidity (NTU)	and Extraction of	sets of monitoring shall not
Water Depth (m)	Cofferdam; and	be less than 36 hours.)
Salinity (ppt)	During Dredging	
DO (mg/l and % of		
Saturation)		
SS (mg/l)		

# 5.3. Monitoring Locations

5.3.1. According to section 5.2.6 of the EM&A manual of the project, 6 water quality monitoring stations (WMSs) are proposed at the Po Toi O FCZs, major amphioxus habitats and rocky shores where coral thrives. With reference to the tidal characteristics of Po Toi O Bay, 3 control stations are proposed where fresh marine water is not affected by the cofferdam installation/ extraction works, and 2 impact stations are proposed near the cofferdam under different tidal periods. All water quality monitoring stations show as *Figure 5-1* and *Table 5-2*.

Station	Monitoring Period	Description	Easting	Northing
*WMS1N	Mid-Ebb, Mid-Flood	Po Toi O Fish Culture Zone	848416	845209
*WMS2N	Mid-Ebb, Mid-Flood	Po Toi O Fish Culture Zone	848505	815375
WMS3	Mid-Ebb, Mid-Flood	Rocky Shore with Corals	848644	815391
WMS4	Mid-Ebb, Mid-Flood	Rocky Shore with Corals	848774	815602
WMS5	Mid-Ebb, Mid-Flood	Rocky Shore with Corals	848578	815591
WMS6	Mid-Ebb, Mid-Flood	Major Amphioxus Habitat	848639	815523
11	Mid-Flood	Impact monitoring Station	848643	815692
12	Mid-Ebb	Impact monitoring Station	848722	815910
C1	Mid-Flood	Control station	848904	816052
C2	Mid-Ebb	Control station	848529	815373
C3	Mid-Ebb	Control station	848243	815710
WMS1	Mid-Ebb, Mid-Flood	Po Toi O Fish Culture Zone	848387	815201
WMS2	Mid-Ebb, Mid-Flood	Po Toi O Fish Culture Zone	848479	815378

Table 5-2 Summary of Water Quality Impact Monitoring Stations

Notes:

\*WMS1N, WMS2N are new proposed alterative monitoring location. As previous EIA proposed monitoring location WMS1, WMS2 are situated in fish barges within the Fish Culture Zone (FCZ), and accesses to WMS1 and WMS2 were subsequently denied by the tenants of the fish barges. The relocation of WMS1 and WMS2 were approved by IEC and the ER of the Project.

## 5.4. Results and Observations

- 5.4.1. According to submission of construction works schedule and location plan under the EP of Project, the proposed period of commencement construction work with cofferdam installation / extraction work and during dredging works is August 2022.
- 5.4.2. Marine construction was not commenced within the reporting month; hence no water quality monitoring was conducted.
- 5.4.1. Refer to Sections 5.2.10 and 5.2.11 of approved EM&A Manual, construction phase site inspection for water quality mitigation measures and check the contractor's work practice on water pollution prevention during construction phase has been conducted during weekly site audit.
- 5.4.2. During the weekly site audit of this reporting month, no non- conformance water pollution was identified / observed in the commencement works area.

# 6. Environmental Site Inspection and Audit

# 6.1. Site Inspection

- 6.1.1. Site inspections were carried out by ET on a weekly basis to monitor the implementation of proper environmental pollution control and mitigation measures for the Project. Key observations were recorded in the site inspection checklist and passed to the Contractor together with the appropriate recommended mitigation measures where necessary.
- 6.1.2. In the reporting period, 4 site inspections were carried out on 7, 15, 21 and 28 October 2021.
   A joint site inspection with IEC was carried out on 21 October 2021. No non- compliance was recorded during the site inspection. Details of observations recorded during the site inspections are presented in Table 6-1.

Darameters	Date	Observations and	Action taken by
Parameters	Date	Recommendations	contractor
		<b>Observation</b>	It is observed during 15
		It is observed during 7	October 2021 site
		October 2021 site	inspection, the
		inspection, the	contractor placed
		contractor was not	sandbags for the open
		completely along with	trench site boundary
		the sandbags in the	of the Fairway Vista
		open trench site	Works area. The
	7 October 2021	boundary of the	contractor is reminded
		Fairway Vista Works	that to replaced
Water Quality		area.	sandbags to along the
			works area during
		Recommendations	open-cut excavation
		The contractor is	for laying of gravity
		reminded that to	sewers/rising mains.
		replaced sandbags to	This item will be
		along the works area	inspected in the next
		during open-cut	weekly inspection.
		excavation for laying of	
		gravity sewers/rising	(Item Closed)
		mains.	

Table 6-1 Observations and Recommendations in the Reporting Month

Project No. 1825 Monthly Environmental Monitoring & Audit Report (October 2021) for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant

Parameters	Date	Observations and	Action taken by
		Recommendations	contractor
	7 October 2021	<u>Reminder</u>	It is observed during 15
		The contractor is	October 2021 site
		reminded to maintain	inspection, the
		the treatment facility	contractor was placed
		near by the STP works	the treatment facility
		area before commence	near by the STP works
		construction works in	area.
		the STP works area.	
			(Item Closed)
			( ,
	15 September	Reminder	It is observed during 21
	2021	The contractor is	October 2021 site
		reminded to maintain	inspection, the
		the intercept the water	contractor was placed
		from u-channel at the	sand-bag to maintain
		foot of the slope where	the intercept the water
		the STP will be built.	from u-channel.
			(Item Closed)
Noise	No adverse ob	servation was identified in	the reporting period.
		Follow up Reminder	It is observed during 7
		The contractor is	October 2021 site
		reminded maintain the	inspection, the
		temporary storage area.	contractor was placed
		Designate areas for	the construction
		placement of	equipment , materials
Ecology	30 September	equipment, building	as far away from the
	2021	materials and wastes	natural environment.
		away from the natural	
		, environment.	(Item closed)
			. ,

Project No. 1825 Monthly Environmental Monitoring & Audit Report (October 2021) for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant

It is observed during 21 October 2021 site inspection, the contractor was placed equipment, building materials nearby the natural area in the Fairway Vista works area. The contractor is reminded to designate areas for placement of equipment, building materials and wastes away from the natural environment.October 2021 site inspection, the contractor was placed equipment, building materials nearby the area.28 October 2021Reminder The contractor is followed in the comin	Devenenteve	Dete	Observations and	Action taken by
It is observed during 21 October 2021 site inspection, the contractor was placed equipment, building materials nearby the natural area in the Fairway Vista works area. The contractor is reminded to designate areas for placement of equipment, building materials and wastes away from the natural environment.The item will be followed in the comin weekly inspection is November 2021.28 October 2021Reminder The contractor is reminded to designate areas for placement of equipment, building materials and wastes away from the natural environment.The item will be followed in the comin weekly inspection is November 2021.28 October 2021Reminder The contractor is reminded to erect bright colour fencing along the boundary of the undisturbed region of the shrubland and woodland, and around Diospyros vaccinioides, a plant species of conservation importance before commence construction works for the STP works area.The item vill be followed in the comin weekly inspection is November 2021.	Parameters	Date	Recommendations	contractor
The contractor is reminded to erect bright colour fencing along the boundary of the undisturbed region of the shrubland and woodland, and around Diospyros vaccinioides, a plant species of conservation importance before commence construction works for the STP works area.		21 October 2021	It is observed during 21 October 2021 site inspection, the contractor was placed equipment, building materials nearby the natural area in the Fairway Vista works area. The contractor is reminded to designate areas for placement of equipment, building materials and wastes away from the natural	inspection, the contractor was placed equipment, building materials as far away from the natural works area.
Fisheries         No adverse observation was identified in the reporting period.		28 October 2021	The contractor is reminded to erect bright colour fencing along the boundary of the undisturbed region of the shrubland and woodland, and around Diospyros vaccinioides, a plant species of conservation importance before commence construction works for	followed in the coming weekly inspection in
	Fisheries	No adverse ob	l oservation was identified in	the reporting period.
Built Heritage No adverse observation was identified in the reporting period.				

Project No. 1825 Monthly Environmental Monitoring & Audit Report (October 2021) for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant

Parameters	Date	Observations and	Action taken by	
		Recommendations	contractor	
Landscape &		Observation	It is observed during 28	
Visual			October 2021 site	
		It is observed during 23	inspection, the	
	21 October 2021	October 2021, site	contractor was fence	
		inspection, the	along the works area	
		contractor was tied the	and natural	
		plastics railing with	environment with	
		existing tree in the	plastic railing. The	
		Fairway vista works	contractor is reminded	
		area.	placed equipment,	
		Recommendations	construction materials	
			as far as away from the	
		The contractor is	natural environmental.	
		reminded carefully		
		protected all existing	(Item closed)	
		trees during		
		construction period.		
Miscellaneous	No adverse ob	servation was identified in	the reporting period.	

# 6.2. Waste Management

- 6.2.1. As advised by the Contractor, 53 m<sup>3</sup> of inert C&D material was generated in the reporting month. For C&D wastes, 0 m<sup>3</sup> of general refuse was disposed of at NENT landfill, 0 kg waste were collected by recycling contractors, and 0 kg of chemical wastes was collected by licensed Contractors in the reporting period.
- 6.2.2. The actual amounts of different types of waste generated by the activities of the Project in the reporting period are shown in *Table 6-2*, the detailed monthly summary of waste flow is detailed in *Appendix 6-2*.

Waste Type	Quantity	Disposal/ Reuse Locations	
Inert C&D Waste Disposed as	53m <sup>3</sup>	Tseung Kwan O Area 137 Fill	
Public Fill	5311-	Bank (TKO137FB).	
C&D Wastes Disposed as General	0 m <sup>3</sup>	North East New Territories	
Refuse	0 m <sup>2</sup>	(NENT)	
Recycle Materials	0 kg	<b>Recycling Facilities</b>	
General Refuse	0 kg	North East New Territories	
	0 kg	(NENT)	
Chemical Waste	0 kg	Licensed Contractors	

Table 6-2Summary of Waste Flow Table

6.2.3. During regular site auditing, the mitigation measures proposed in the Implementation Schedule of the Environmental Mitigation Measures (EMIS) in the approved EIA report of the Project has been effectively implemented in the commenced works area. No adverse waste impact was observed from the construction works in reporting month.

# 6.3. Status of Environmental Licenses, Notification and Permits

6.3.1. The environmental licenses and permits for the Project and valid in the reporting period are summarized in *Table 6-3*.

Table 6-3	Status of Environmental License, Notification and Pel	rmit

License/ Notification/	Reference No.	Valid Period	
Permit	Reference No.	From	То
Environmental Permit	EP-516/2016	27 January 2017	End of Project
Construction Dust	458613	3 August 2020	N/A
Notification Under APCO			
Wastewater Discharge License	WT00038707-2021	3 November 2021	31 August 2026
Chemical Waste Producer	5213-820-C3510-	22 Contombor 2020	N/A
Registration	18	23 September 2020	
Billing Account for Disposal	WFG22785	17 August 2020	N/A
of Construction Waste			

#### 6.4. Implementation Status on Environmental Protection Requirements

6.4.1. The Implementation Schedule of the Environmental Mitigation Measures (EMIS) of the reporting period is summarized in *Appendix 6-3*. The implementation of the key mitigation measures during the reporting period is presented in *Appendix 6-4*.

# 6.5. Summary of Complaints, Notification of Summons, Successful Prosecutions and Public Engagement Activities

- 6.5.1. No complaints, notification of summons and successful prosecution was received in the reporting period. No public engagement activities were conducted in the reporting period.
- 6.5.2. Statistics on complaints, notifications of summons, successful prosecutions and public engagement activities are summarized in *Appendix 6-5*.

# 7. Future Key Issues

# 7.1. Construction Programme for the Upcoming Reporting Month

- PTO-SW-03 (Open Trench, 25 nos., Length: 360m)
- a) Construction of village sewer
- <u>Po Toi O Sewerage Treatment Plant (PTOSTP)</u>
- a) Installation of rock fall fencing

# 7.2. Reinstatement Works Key Issues for the Upcoming Reporting Month

- 7.2.1. Potential environmental impacts due to the construction activities, including air quality, noise, water quality, waste, landscape and visual, will be monitored or reviewed. The ET will continue to implement the environmental monitoring & audit programme in accordance with the EM&A Manual and Environmental Permit requirement. The recommended environmental mitigation measures shall be implemented on site and regular inspections as required will be carried out to ensure that the environmental conditions are acceptable.
- 7.2.2. The anticipated impact of major work activities within the site and the recommended mitigation measures are shown in *Appendix 6-4*.

# 7.3. Monitoring Schedule for the Coming Month

7.3.1. The tentative schedule for environmental monitoring in November 2021 is provided in *Appendix 3-6.* 

# 8. Conclusion

### 8.1. General

8.1.1. This report summarized the monitoring results and audits findings of the EM&A programme under the EP of the Project and in accordance with the EM&A Manual during the reporting period of 1 October 2021 to 31 October 2021.

### 8.2. Environmental Impact Monitoring

8.2.1. No Action or Limit Level exceedance of construction air quality, noise was recorded in the reporting month. No air quality complaints and noise complaints during 0700 – 1900 hours on normal weekdays was received in the reporting month.

### 8.3. Environmental Site Inspections

8.3.1. For the environmental site inspections carried out in the reporting month. Recommendations on remedial actions were given to the contractors for the deficiencies identified during the site audits. The contractor had been follow-up the recommendations on the remedial action accordingly.

#### 8.4. Complaint Log

8.4.1. There was no complaint received in relation to the environmental impact during the reporting period.

#### 8.5. Reporting Changes


8.5.1. No report changes in this reporting period.


### 8.6. Notifications of Summons and Successful Prosecutions


8.6.1. There was no notification of summons and successful prosecution was received in the reporting period

Figure 2-1


Layout Plan of the Captioned Project

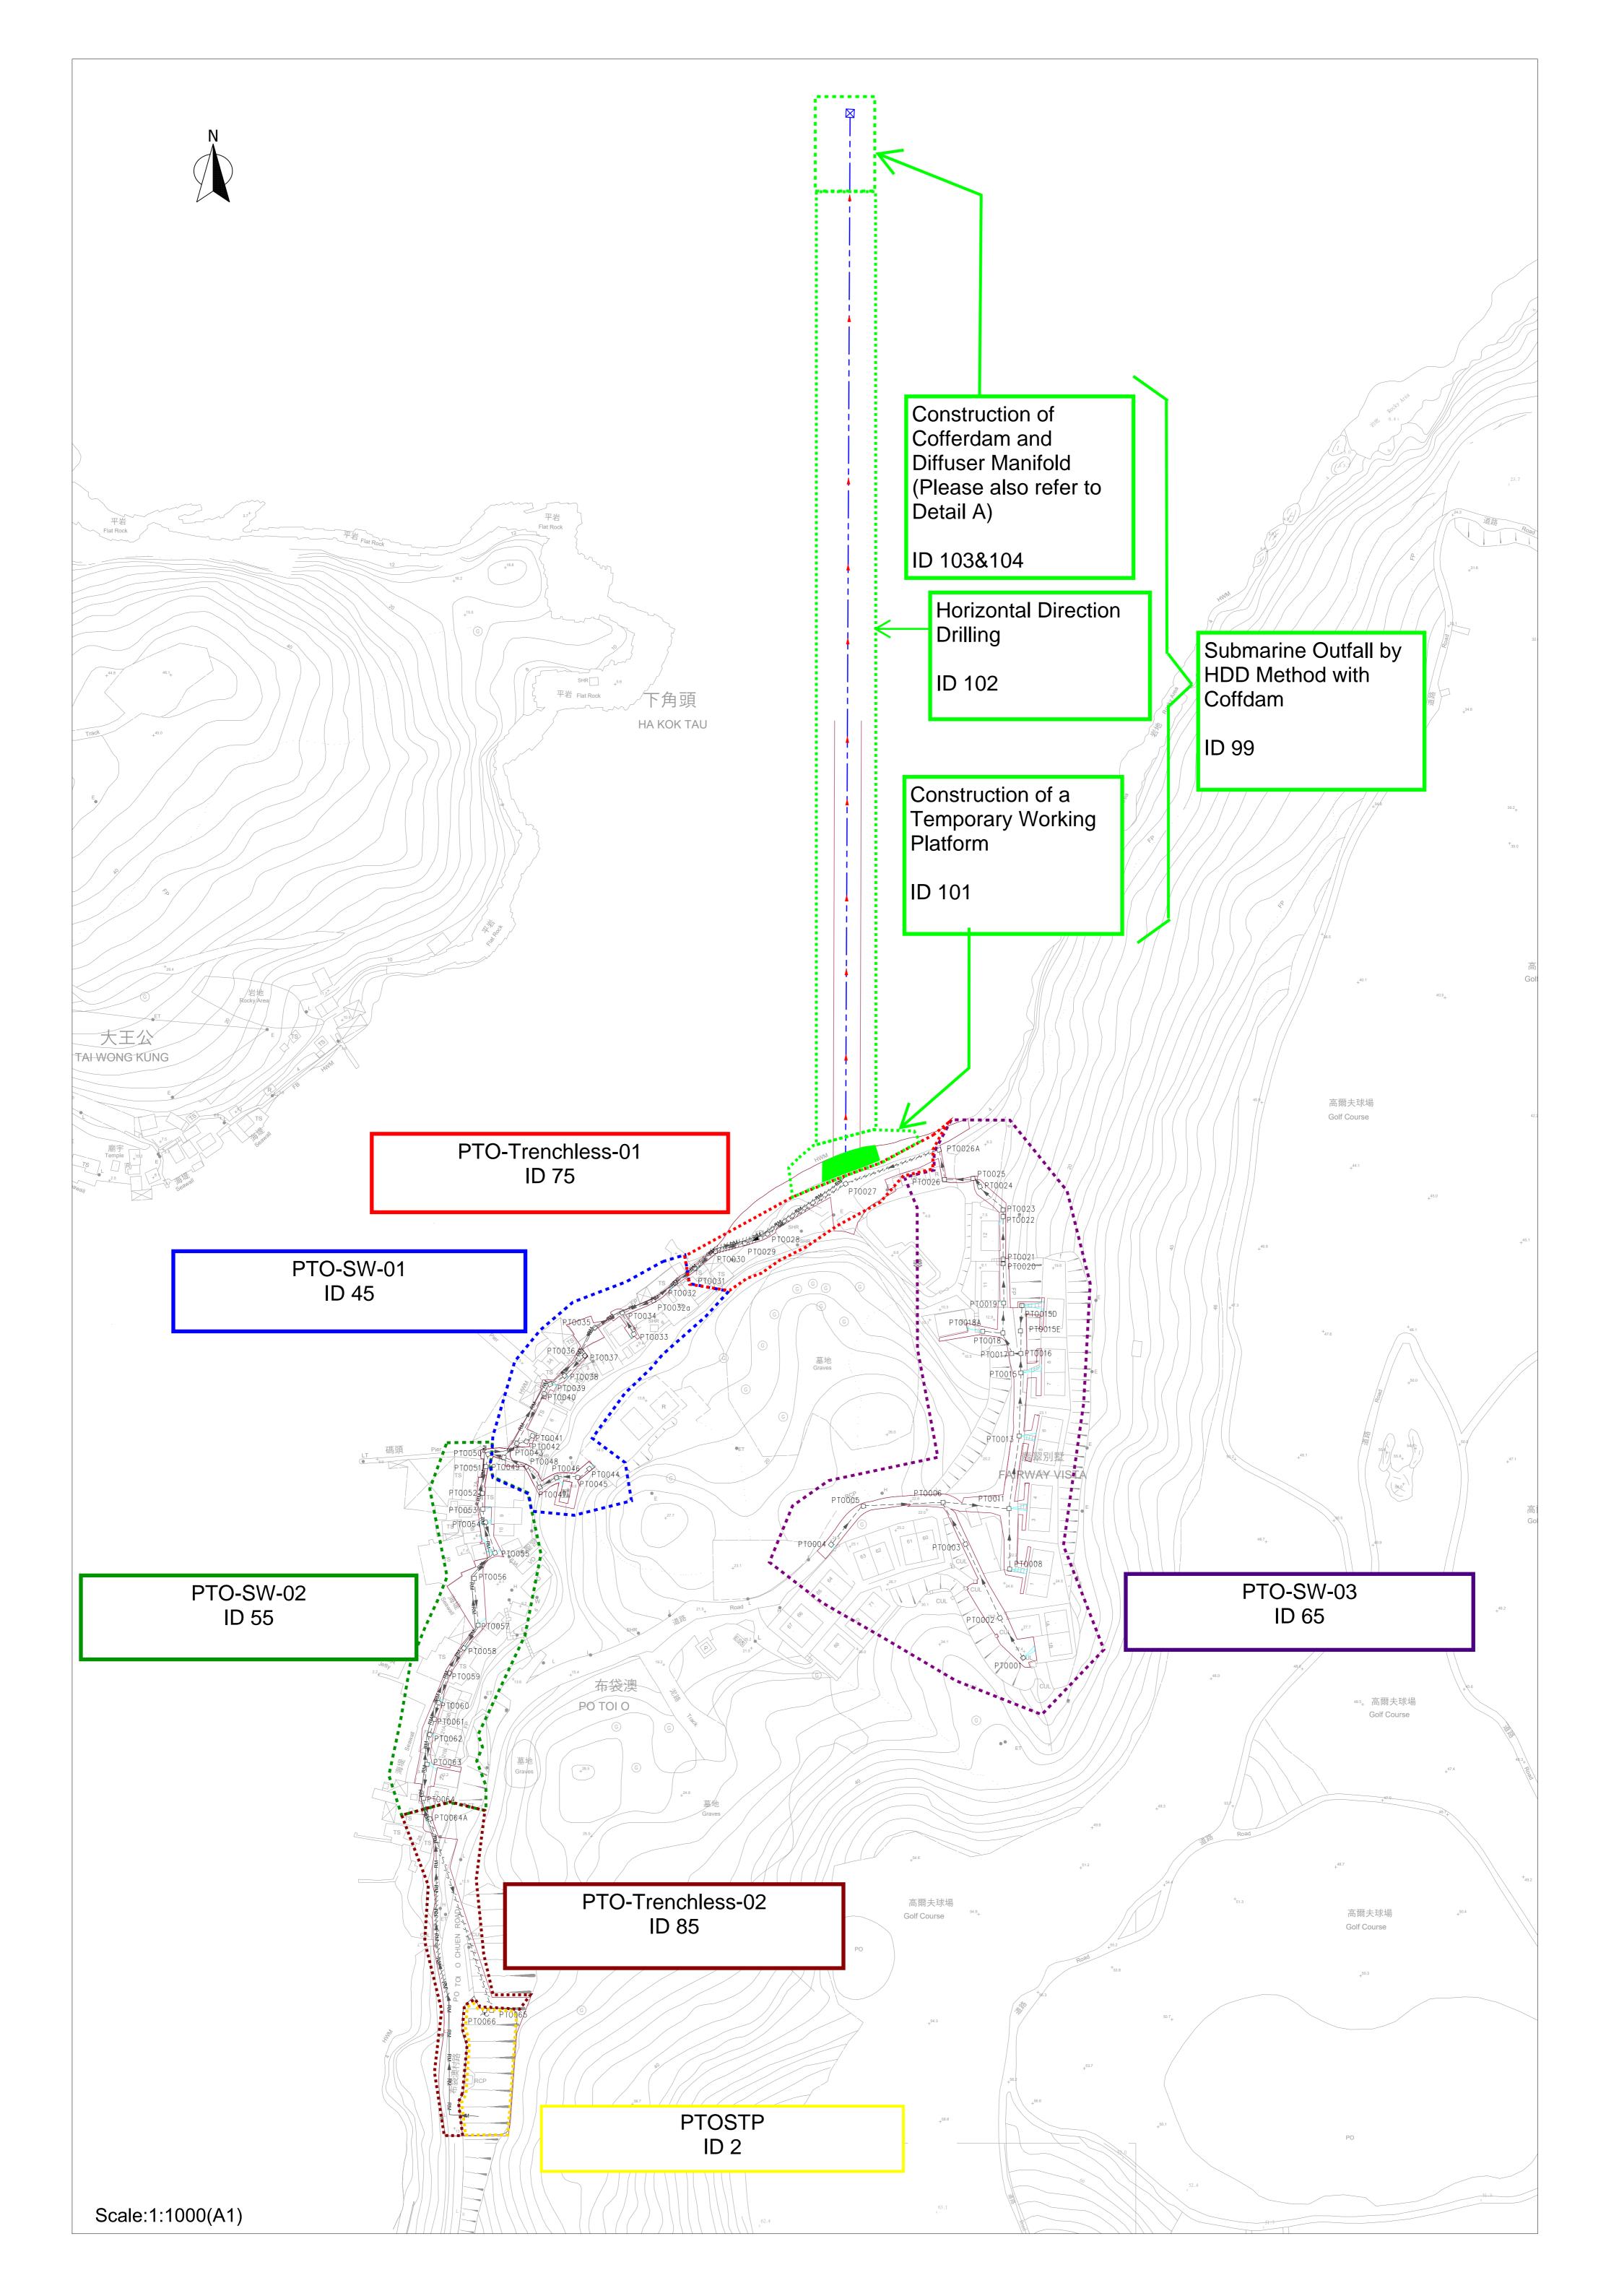

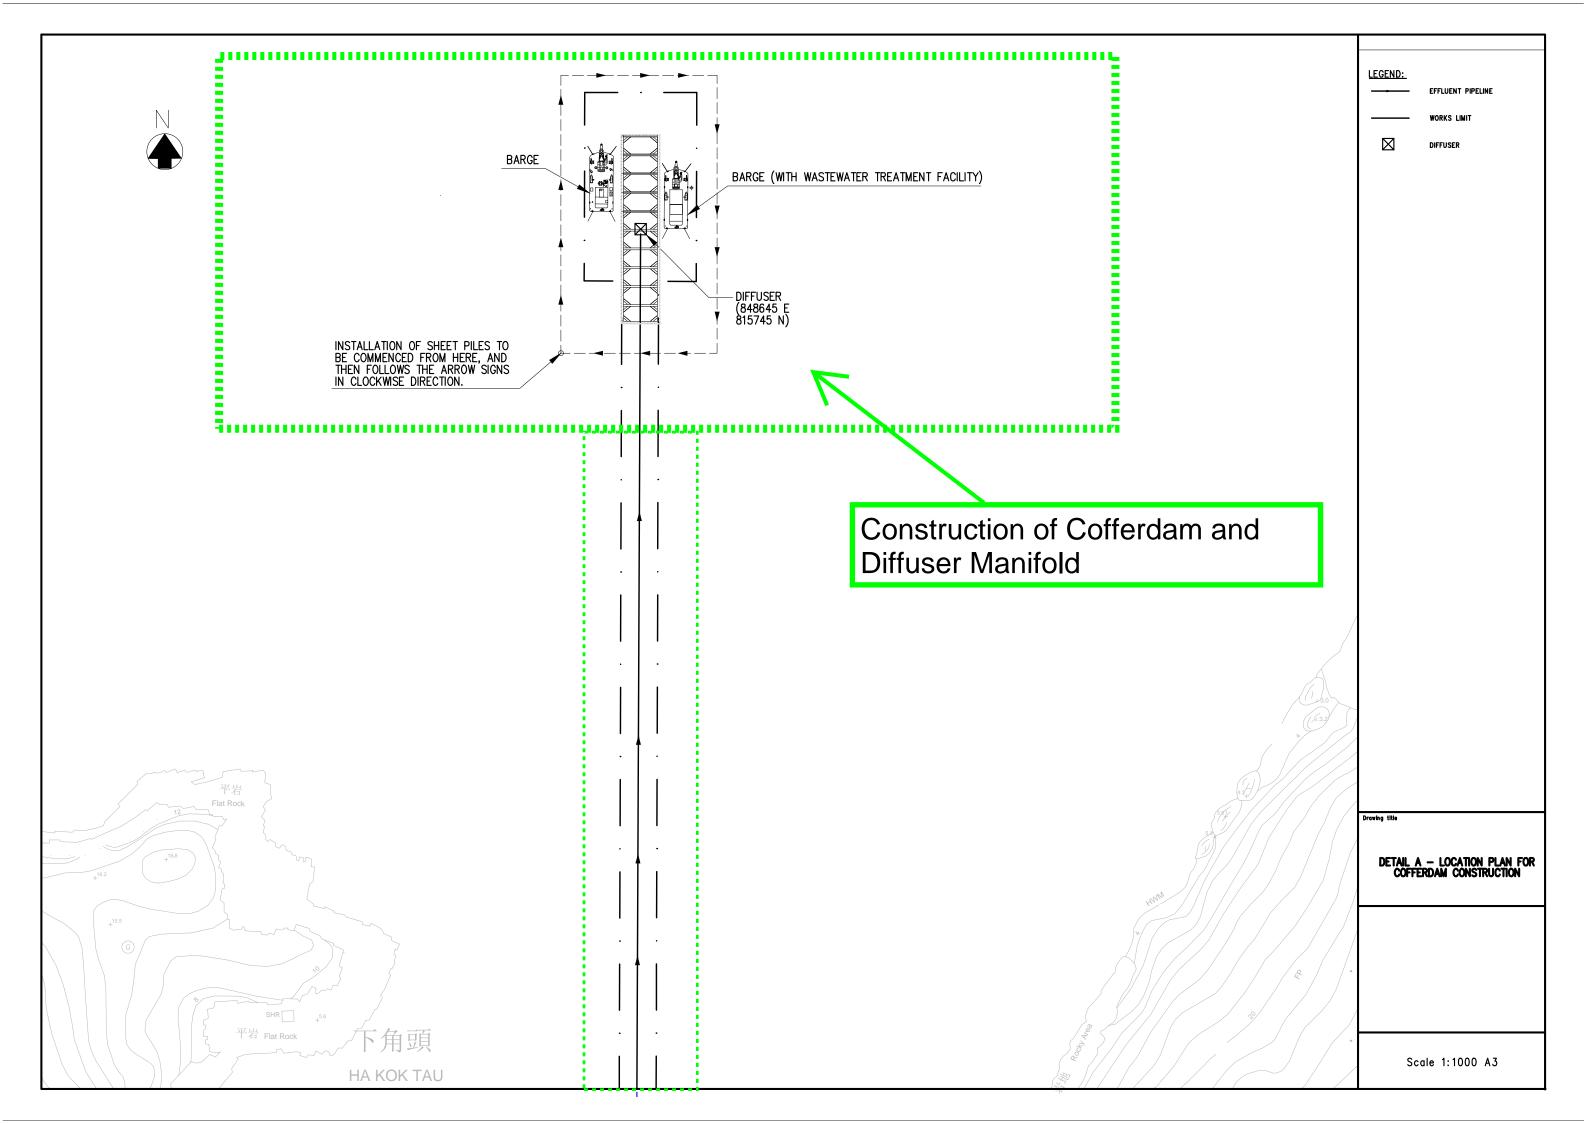

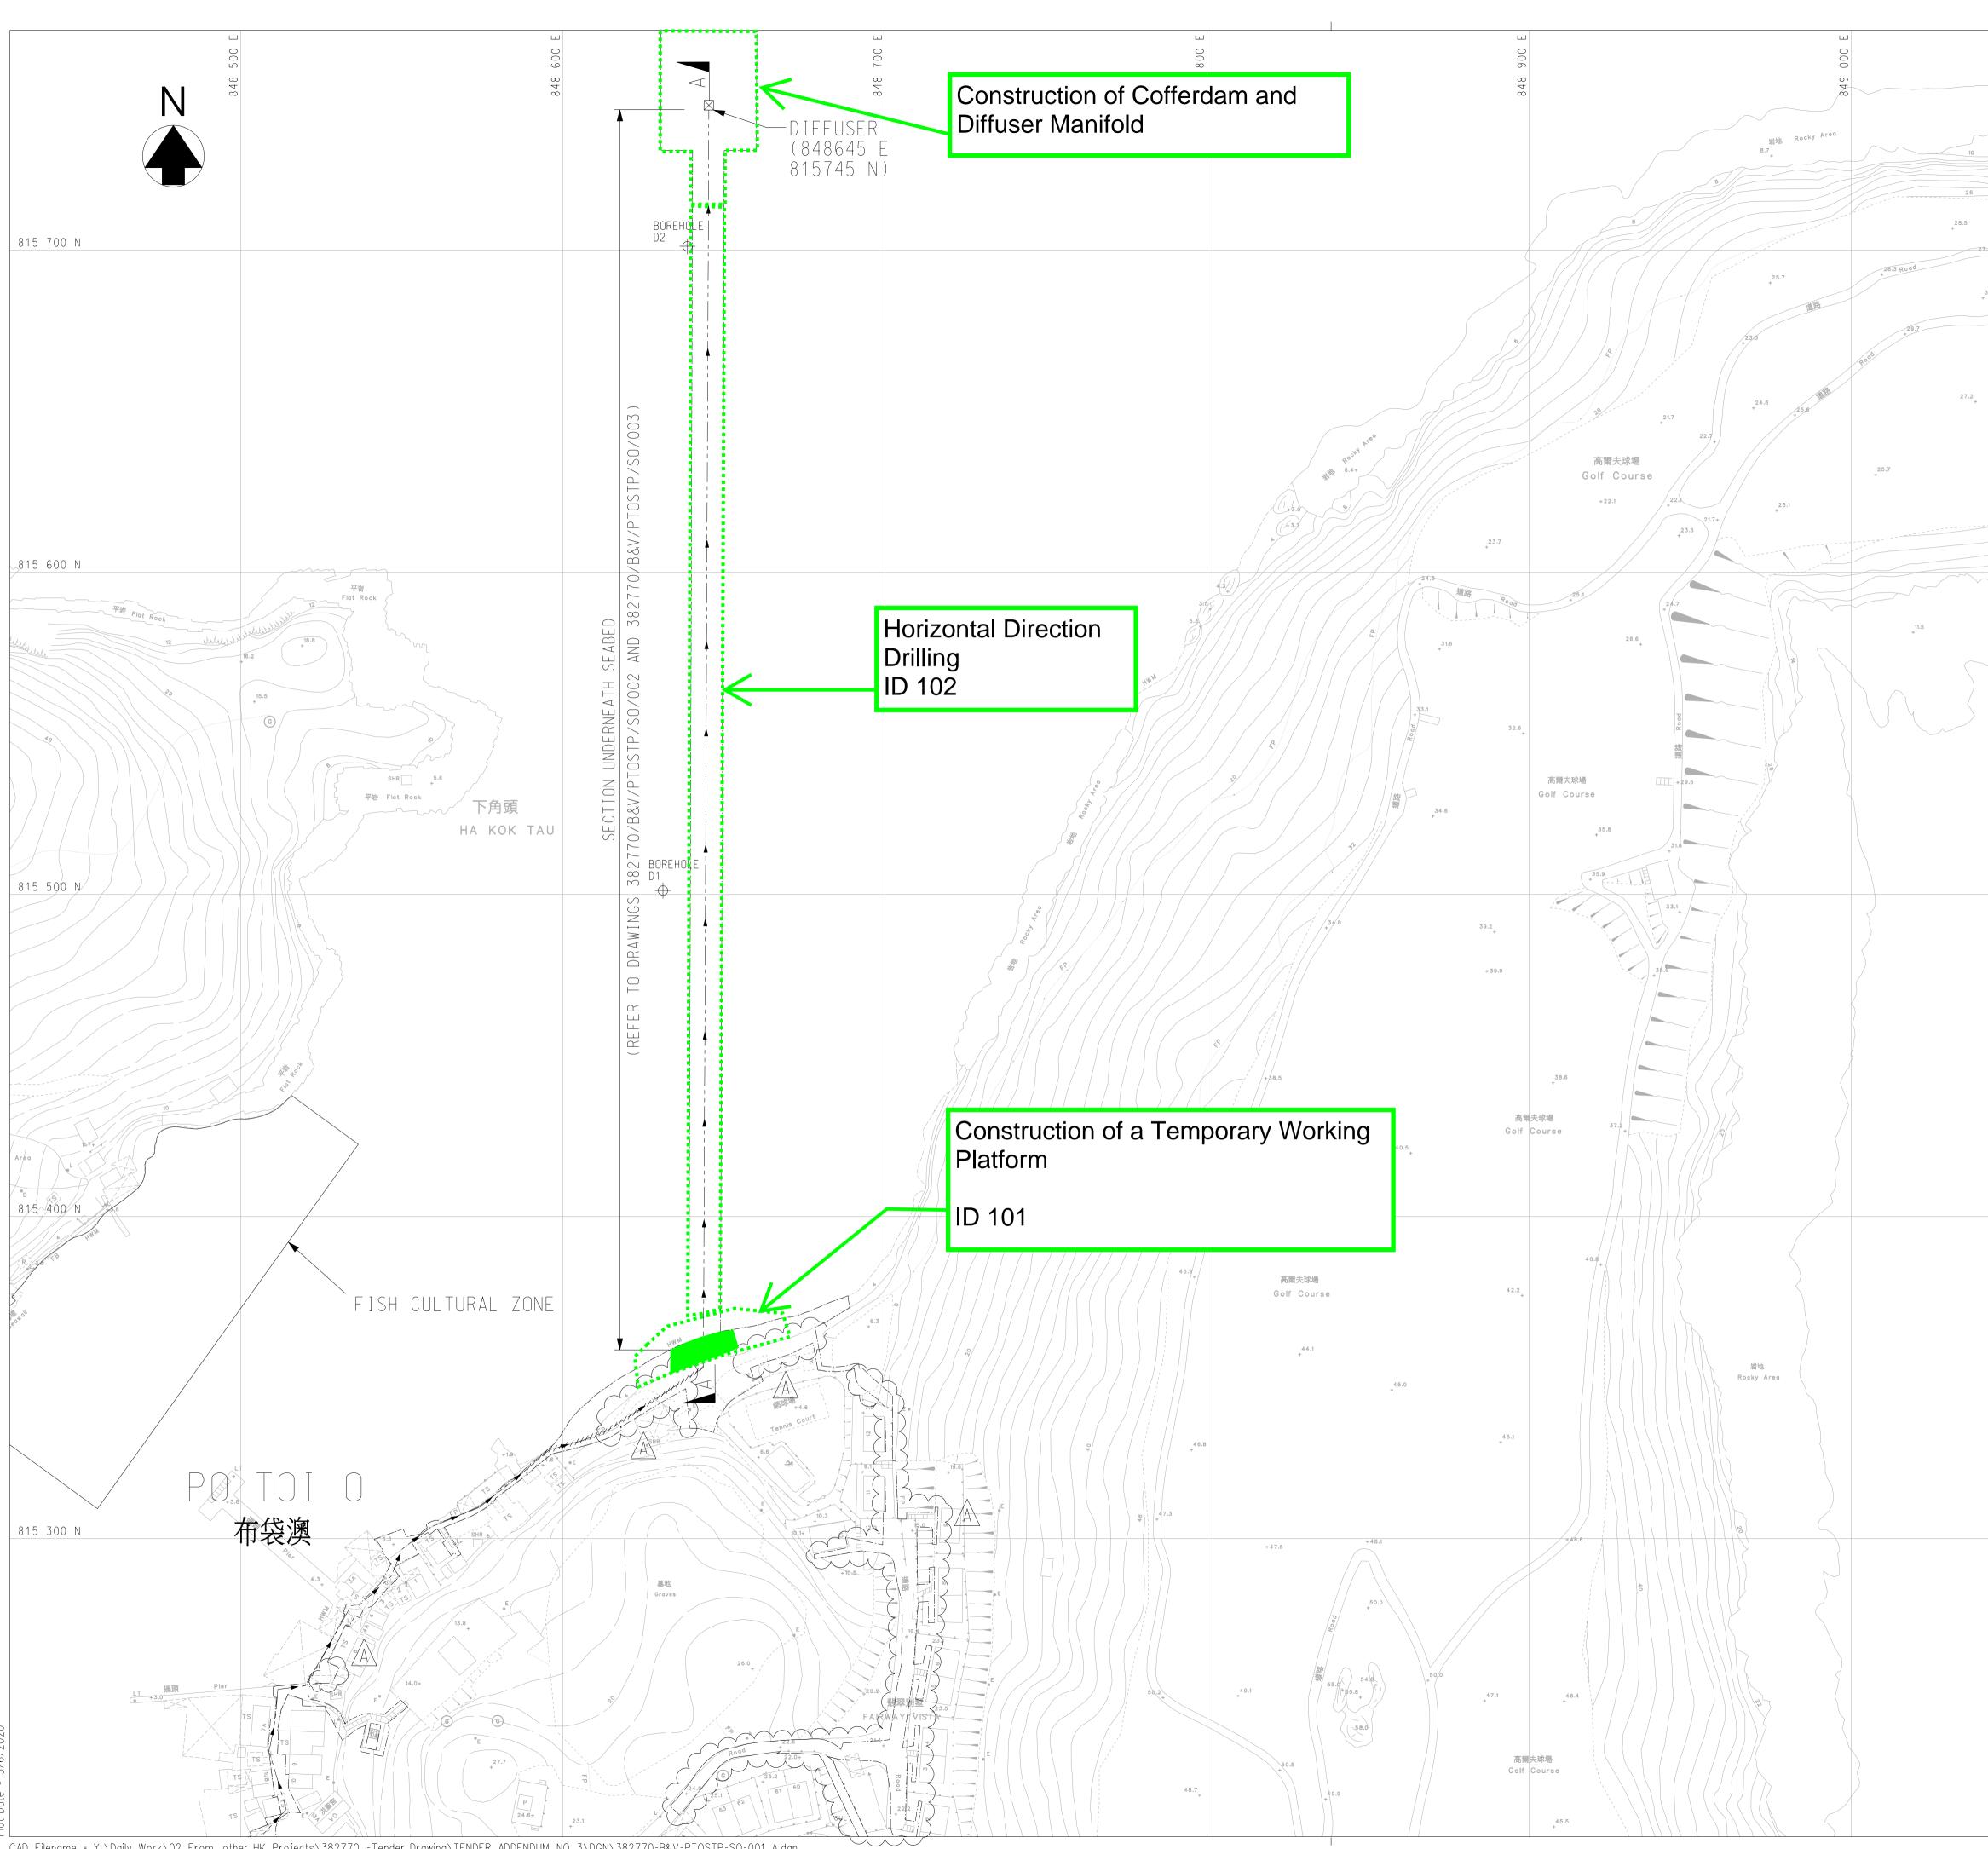


Ш 00	C	Copyright by	Black & Veatcl	h Hong Kong	Limited
84 9	NOT				
	3	OR GENERA 82770/B&V	L NOTES, R /GN/000.	EFER TO	
	7				
		<u>SEND:</u> -►	F F F I II F N T	PIPELINE	
20		+++++	FINAL EFI	FLUENT PIF	PELINE
*			BY TRENC	HLESS METH	IOD
29.6 +	26.2		WORKS EI		
	26.2				
26.6					
高爾夫球場 Golf Course					
	25.6 +				
25.3 +					
20					
10	~~~~				
岩地 Rocky Area					
	А		ENDER ADDE		ΗN
	Revisio	n Date Designed	Descrip Checked	tion Drawn	Initial Checked
	Initia		WL	SZ	0.0
	Date Appro	03/20 ved	03/20	03/20	03/20
	Contr	act no.	DC/2019/	09	
	Contr	act title			
		PROVISION	OF VILLAG		AGE
	Drawi	ng title			
	P	ROPOSED	PO TOI ) SUBMAR	0 – INF OUT	FALL
			LAYOUT	PLAN	
	Drawi	ng no.		R	evision
	3827	'70/B&V/	PTOSTP/S	SO/001	А
	Scale		A1 1 : 1(		
			A3 1 : 20	000	
		「 香	港特别行』 THE GOVER		
			HON ECIAL ADMIN	G KONG Istrative	REGION
			R,	R	
	BL		LATCH HON( C 程 顧 問		
			E. 1 1		

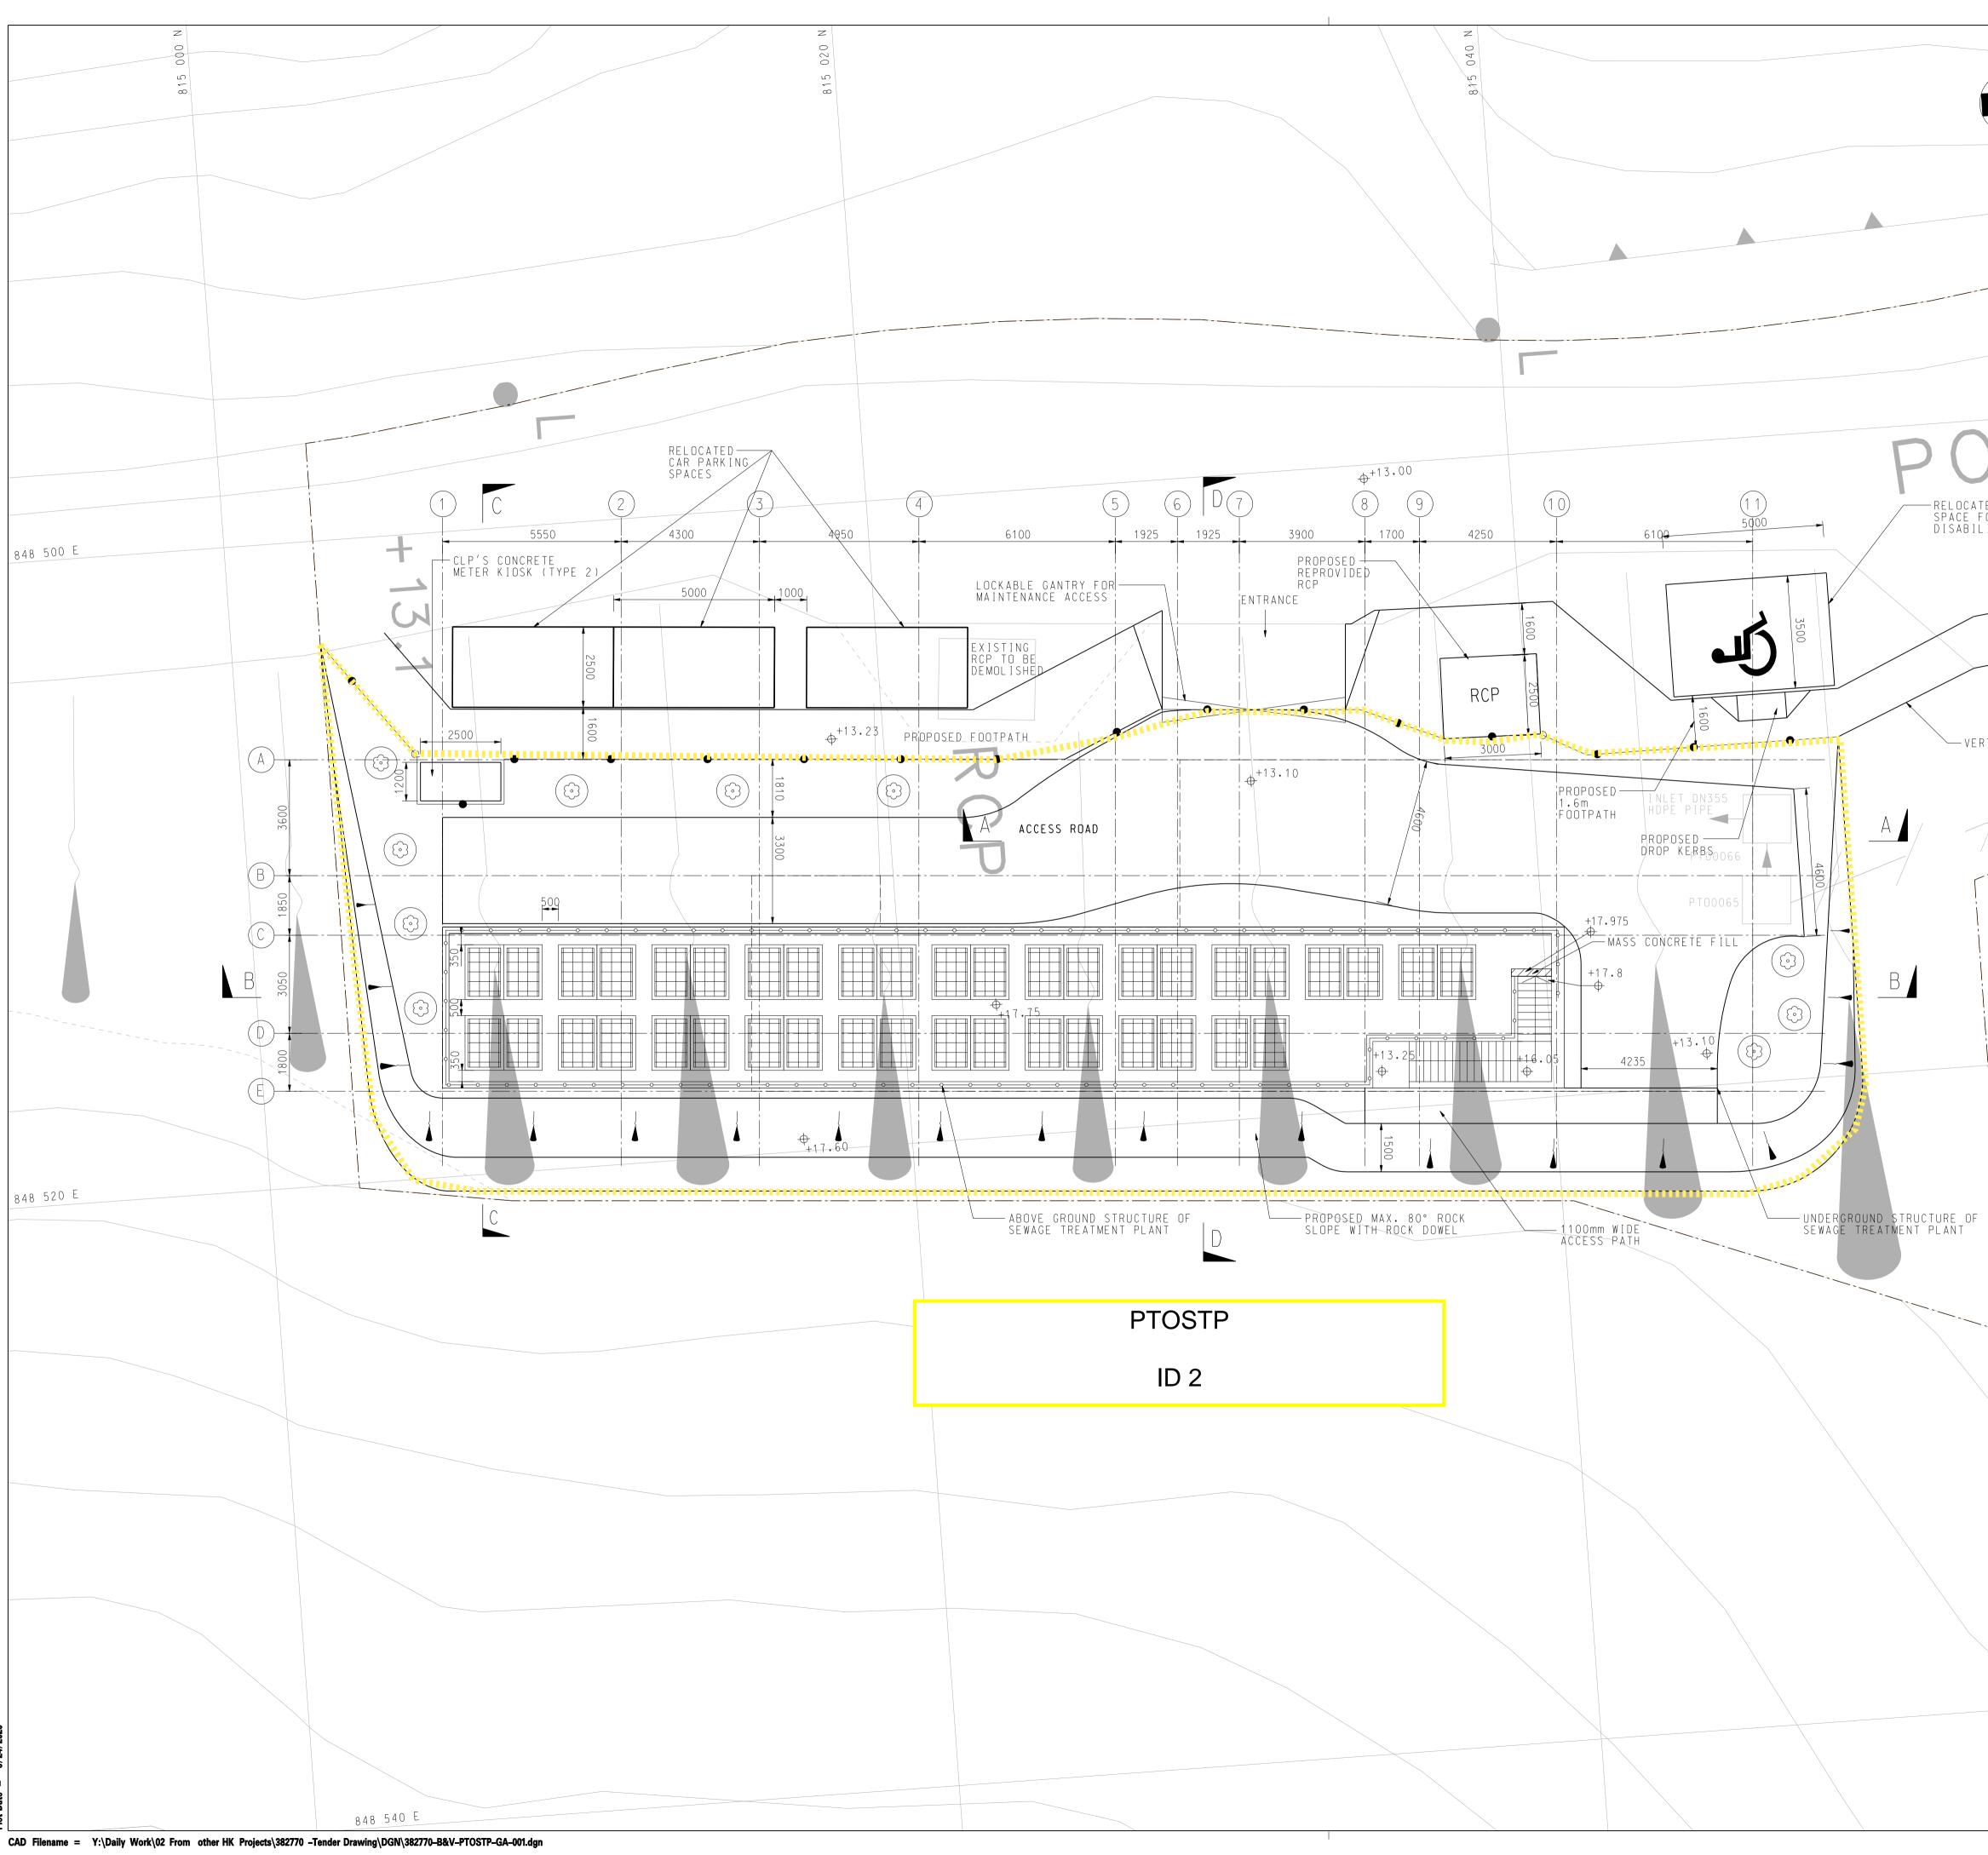

Z 0	© Copyright by Black & Veatch Hong Kong Limited
	NOTES: 1. FOR OTHER NOTES AND LEGEND, REFER TO DRAWING NO. 382770/B&V/GN/000. 2. ALL LEVELS ARE IN METERS ABOVE PRINCIPAL DATUM (mPD). 3. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
	LEGEND: 
	PROPOSED CUT SLOPE BOUNDARY FENCE (REFER TO ARCHITECTURAL DRAWINGS FOR THE TYPES AND DETAILS) 
ED CAR PARKING OR PERSON WITH .ITY	-→──── STAINLESS STEEL RAILINGS
PROPOSED KERB LINE	
RTICAL FACING	
	RevisionDateDescriptionInitialDesignedCheckedDrawnCheckedInitialWCWLSZCCDate03/2003/2003/2003/20
	Approved Contract no.
	DC/2019/09 Contract title
	PROVISION OF VILLAGE SEWERAGE IN SAI KUNG
	Drawing title
	GENERAL ARRAGEMENT OF PO TOI O SEWAGE TREATMENT PLANT - GENERAL LAYOUT
	Drawing no. Revision 382770/B&V/PTOSTP/GA/001 -
	Scale A1 1 : 100 A3 1 : 200
	香港特别行政區政府渠務署 THE GOVERNMENT OF THE HONG KONG SPECIAL ADMINISTRATIVE REGION DRAINAGE SERVICES DEPARTMENT
	EEE。 BLACK & VEATCH HONG KONG LIMITED 博威工程顧問有限公司

Figure 3-1


Proposed Air Quality and Nosie Monitoring Stations Locations

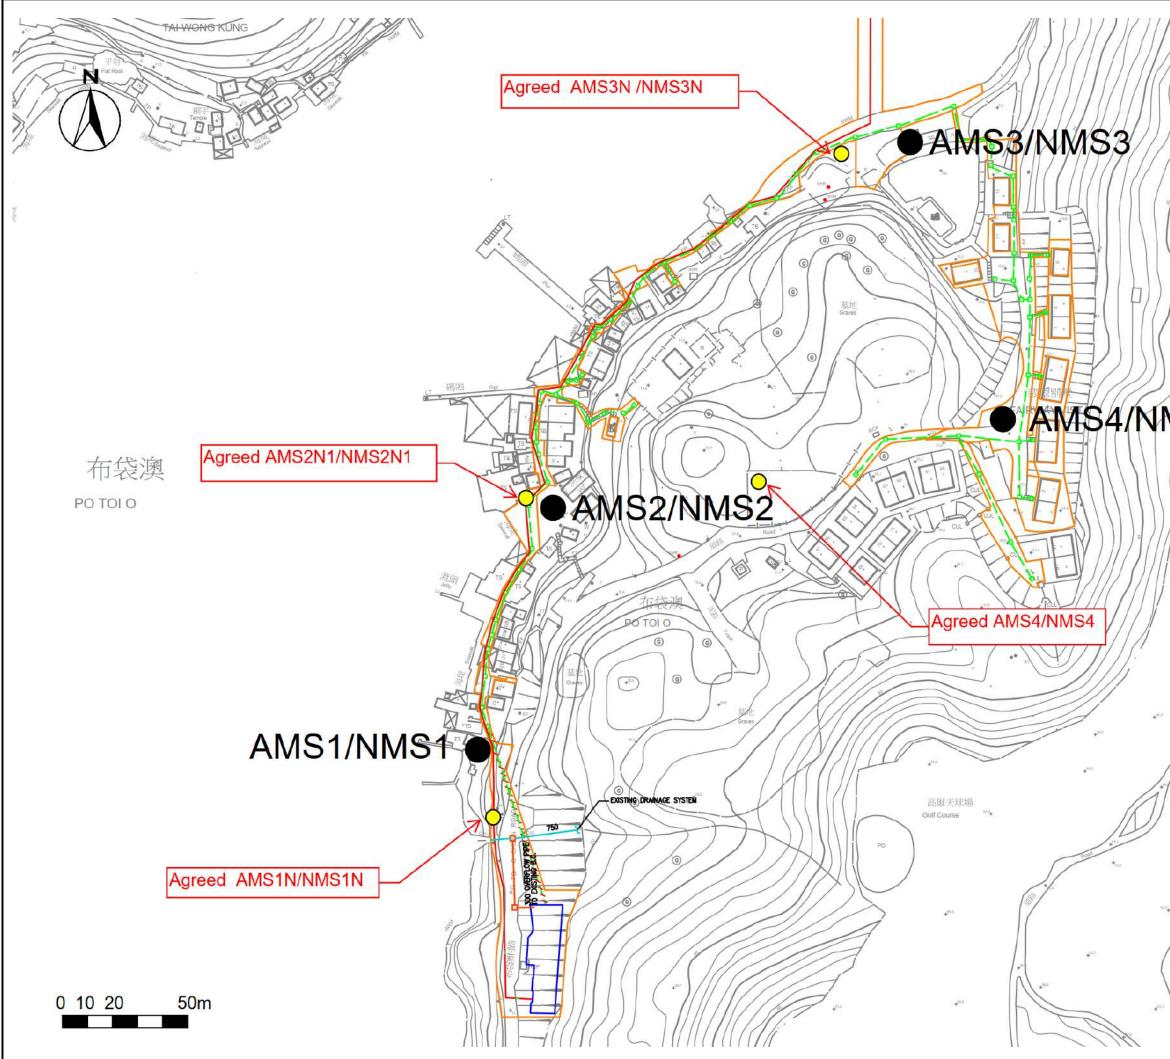

<b>VIS</b> 4	Pr Pr Pr Pr Pr Pr Pr Aii Pr	roposed Work Boundary roposed Sewer and Manhole roposed Rising Main roposed Sewer by Trenchless ethod roposed Sewage Treatment ant r/Noise Monitoring Stations oposed in EM&A Manual greed Air/Noise Monitoring Stations
*	Consultant	AEC
		Mental Consultants Limited
	Project No. : File Name : Project : Air Quality Baseline	& ENVIROMENTAL ENGINEERS 1825 /, Noise and Water Quality Monitoring Report for Port hase 3- Po Toi O Sewerage
	ACOUSTICIANS Project No. : File Name : Project : Air Quality Baseline Shelter Ph Treatment Drawing Title :	& ENVIROMENTAL ENGINEERS 1825 y, Noise and Water Quality Monitoring Report for Port hase 3- Po Toi O Sewerage Plant of Air Quality and Noise
	Project No. : File Name : Project : Air Quality Baseline Shelter Ph Treatment Drawing Title : Location	ENVIROMENTAL ENGINEERS  1825  /, Noise and Water Quality Monitoring Report for Port hase 3- Po Toi O Sewerage Plant  of Air Quality and Noise g Station  Revision :

Figure 5-1


Locations of Water Quality Impact Monitoring Stations

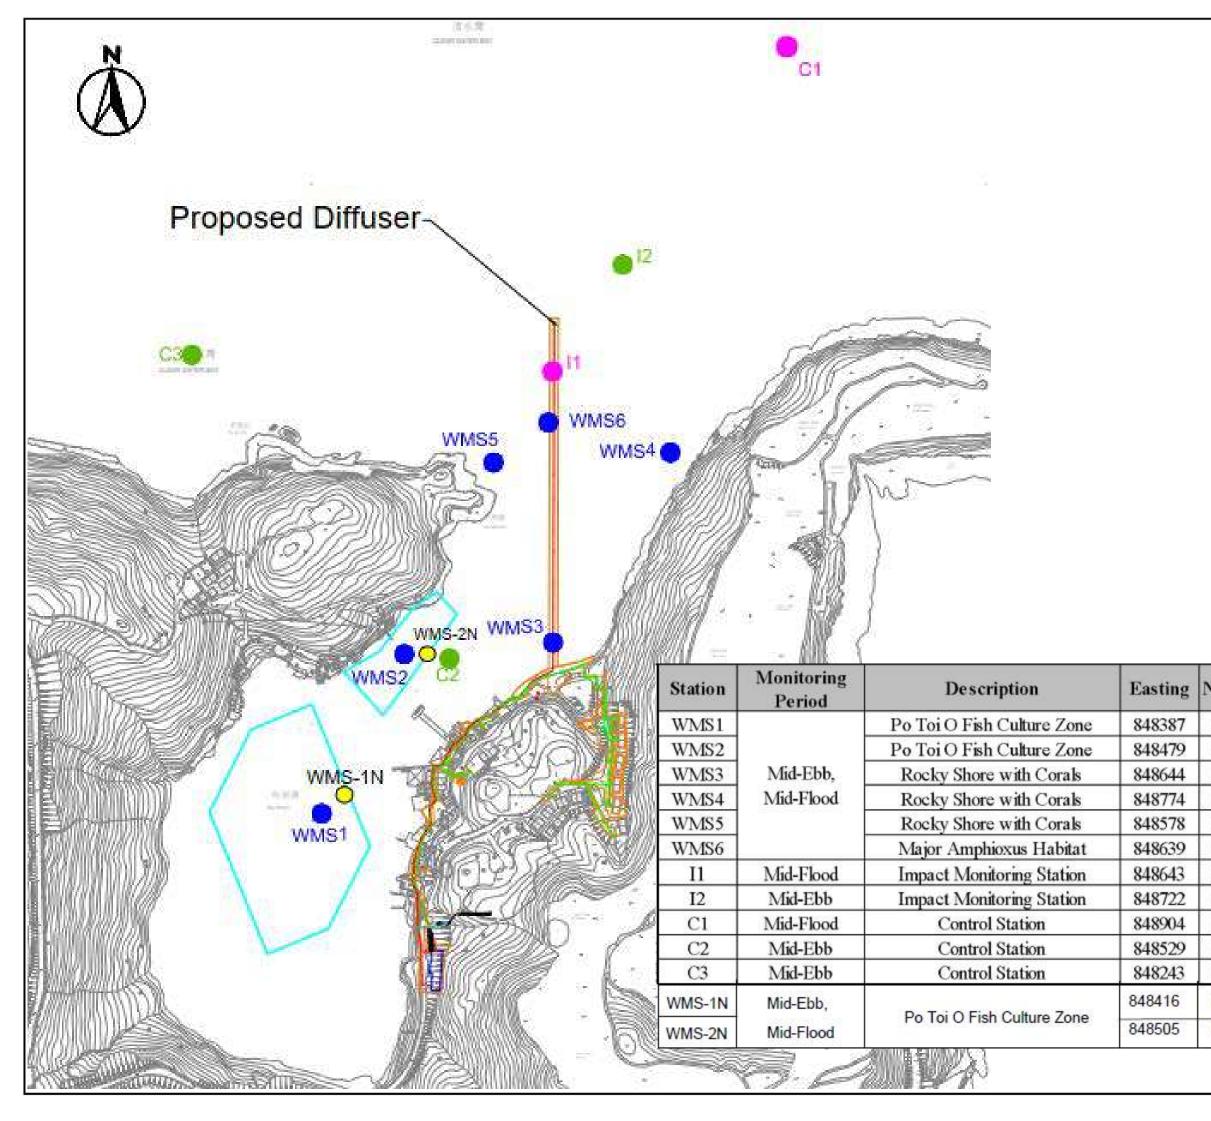

	NOTES :			
		Proposed	Work Bound	ary
		Proposed	Sewer and M	anhole
		Proposed	l Rising Main	
	++++++++	Proposed Method	Sewer by Tre	nchless
		Proposed Plant	l Sewage Trea	tment
		Po Toi O	Fish Culture Z	one
	•	Water Mo	nitoring Point	
	Consultant		[0]	
	Alliand Facility	A		- Line iter d
orthing	Allied Enviro		CONSUITANT	
	Project No. :		1825	
815201	File Name :		-	
815378	Project :			
815391	Air Qua		and Water Qu	
815602	Shelter	Phase 3- F	ig Report for Po Toi O Sewe	
815591	Treatmo	ent Plant		
815523				
815692	Drawing Title :			
815810	Locatio	n of Water (		
816052	Monitor	ing Station	5	
815373				
815710				
815209	Drawing No :		Revision :	0
815375	Figure Scale :		Date :	-
	NTS		April 2	
	DO NOT SCALE OFF CONSTRUCTION PURP ALL RIGHTS RESERVE APPROVED BY ALLIED	DRAWING. THIS OSES UNLESS D AND REPRO ENVIRONMEN	DRAWING IS NOT EXPRESSLY STATE DUCTION IN ANY I TAL CONSULTANTS	FOR ED. FORM MUST BE LIMITED.

Appendix 2-1

Project Organization Chart

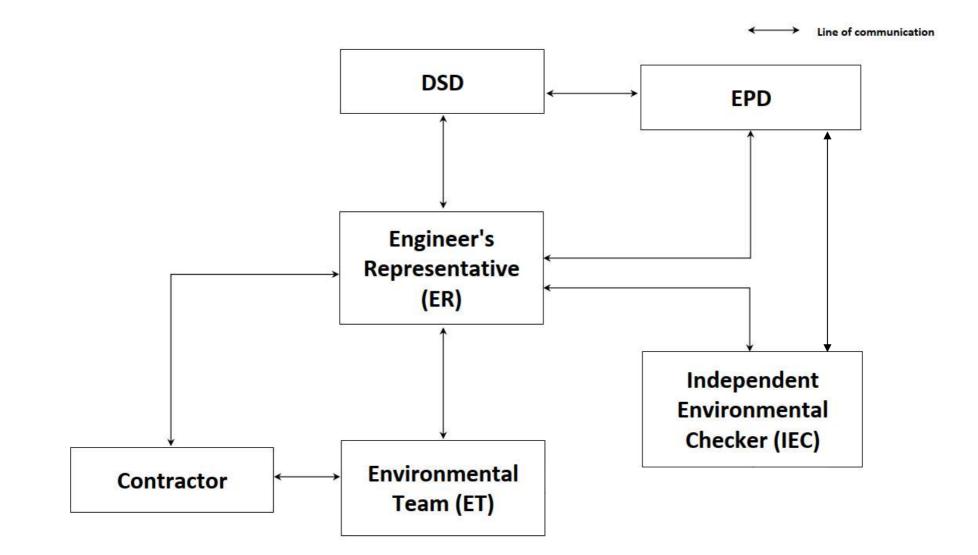


Appendix 2-2

Construction Works Programme

,	Provision of Village Sewerage in Sai Kung								partment of HKS/ werage in Sai Ku DC/2019/09 nme for PTO						
战別碼	Task Name	Duration	Starting Date	ercentag Complet of Date			2021年				2022年				2023年
1	Section 2 - Village Sewerage Works at Po Toi O and PTOSTP	1190 days	2020/7/24	0% 2024/7/24	第三季	第四季	第一季	第二季	第三季	第四季	第一季	第二季	第三季	第四季	第一季
2	Po Toi O Sewage Treatment Plant (PTOSTP)	1190 days	2020/7/24	0% 2024/7/24											
3															
4	Liaise with the village representative works to ensure the possession of construction site	75 days	2020/7/24	0% 2020/10/2											
2	Preperation works (i.e. TMLG meetings; Application for traffic advice for suspension of existing parking slot; Re-provision of existing RCP, etc.)	231 days	2020/7/24	0% 2021/4/29				J							
6	Environmental submissions	231 days	2020/7/24	0% 2021/4/29											
7	Possession of site (Access Date: 22nd October 2020)	1 day	2020/10/22	0% 2020/10/2	_	ь.									
8	Installation of site hoardings at PTOSTP	50 days 10 days	2020/10/23 2020/12/22	0% 2020/12/2 0% 2021/1/5			₽								
10	Mobilization of plant and equipment Site clearance	95 days	2020/12/22 2021/1/6	0% 2021/4/29	-										
11	Initial survey, UU detection and permit-to-dig	95 days	2021/1/6	0% 2021/4/29											
12					-										
13	Preparation for geotechnical submissions	7 days	2021/4/30	0% 2021/5/8	•										
14 15	Liaison with PTO VR	35 days	2021/5/10	0% 2021/6/21	-			<b>_</b>	_						
15	Preparation and installation of rock fall fencing	105 days	2021/5/10	0% 2021/0/21					}						
17															
18	Slope cutting (Total 2850 m3 solid materials to be removed, i.e. about 4275 m3 loosen materials. 23.8m3 loosen materials to be removed per day, i.e. 4 trips of dumping per day)(installation of silt curtain at the outlet	120 days	2021/10/27	0% 2022/3/22						Ľ					
10	of the box culvert)	24 days	2022/2/22	00/ 2022/5/5	•										
19 20	Installation of rock dowl (include drilling, rebar installation and grouting, etc.) Construction of anchorages for flexible barrier	34 days 34 days	2022/3/23 2022/5/6	0% 2022/5/5 0% 2022/6/16	-							<u>}_</u>	<b></b>		
20	Installation of flexible barriers	30 days	2022/6/17	0% 2022/0/10								<u> </u>	<b></b>		
22															
23	Installation of sheetpile	25 days	2022/7/23	0% 2022/8/20									- Č		
24	Excavation from +13.25 Mpd to -1.20 Mpd (Total 2150 m3 solid materials to be removed, i.e. about 3225m3 loosen materials. 23.8m3 loosen materials to be removed per day, i.e. 4 trips of dumping per day)	105 days	2022/8/22	0% 2022/12/2	•								c		<u> </u>
25	Plate load test	12 days	2022/12/28	0% 2023/1/11	-										<u> </u>
26	Construction of raft footing	40 days	2023/1/12	0% 2023/3/2											
27	Construction of basement (below +13.25 mPD)	45 days	2023/3/3	0% 2023/4/28											
28 29	Construction of R.C. walls at 1st Floor	55 days	2023/4/29	0% 2023/7/6	-										
29 30	Construction of K.C. wails at 1st Floor Construction of rooftop (below + 17.75 mPD)	55 days 55 days	2023/4/29	0% 2023/7/6	-										
31	External Finishes	110 days	2023/9/9	0% 2024/1/22											
32	Internal Finishes (incl. installation of Door & Window etc)	110 days	2023/9/9	0% 2024/1/22					1						
33	Landscape works & other associated works	797 days	2021/6/22	0% 2024/2/26	•										
34	E&M works	292 days	2023/4/29	0% 2024/4/23											
35 36	T&C (Stage 1) + T&C (Stage 2)	292 days 223 days	2023/4/29 2023/7/24	0% 2024/4/23	-										
37	T&C (Stage 3)	75 days	2023/1/24	0% 2024/7/24											
38															
39															
40	Construction of PTO Village Sewerage	1179 days	2020/7/24	0% 2024/7/11											
41 42	Liaise with the village representatives Initial survey and photo-taking	90 days 90 days	2020/7/24 2020/8/26	0% 2020/11/9 0% 2020/12/1			1								
43	UU Detection and application for permit-to-dig	90 days	2020/9/21	0% 2020/12/1	-  Č	×	<u> </u>								
44															
45	Trial pit excavation (Access Date of PTO-B1-01: 22nd Oct 2020)	90 days	2020/10/22	0% 2021/2/8											
46 47	Producing Lawart plane showing the leastion of terminal manhales, timber here and all imment of	83 dawn	2020/11/17	0% 2021/2/27											
+/	Producing Layout plans showing the loction of terminal manholes, timber box and alignment of sewers and other associated preparation works	83 days	2020/11/17	0% 2021/2/27				Ŋ							
48								Ļ							
49 50	Liaison with PTO VR	83 days	2021/3/1	0% 2021/6/7				(							
50 51	PTO-SW-01 (Open Trench, 18 nos. manholes (170m), and rising main(CH2+53.81 - CH4+36.66)	316 days	2021/6/8	0% 2022/6/30	-				<b></b>						
58	Landscape works for PTO-SW-01	316 days	2021/6/8	0% 2022/6/30					-						
60															
61	PTO-SW-02 (Open Trench, 16nos. Manhole(145m), and a Section of Rising Main)	263 days	2022/7/2	0% 2023/5/20											
68 70	Landscape works for PTO-SW-02	263 days	2022/7/2	0% 2023/5/20											
70 71	PTO-SW-03 (Open Trench, 25 nos., Length: 360m)	390 days	2022/7/2	0% 2023/10/2	-										
78	Landscape works for PTO-SW-03	390 days	2022/7/2	0% 2023/10/2											
80													-		
81	PTO-Trenchless-01 (Trenchless, (Length: 75m) and related Rising Main)	237 days	2022/7/2	0% 2023/4/19											
88	Landscape works for PTO-Trenchless-01	237 days	2022/7/2	0% 2023/4/19											
90 91	PTO-Trenchless-02 (Trenchless, (Length: 100m) and related Rising Main)	289 days	2023/4/20	0% 2024/4/10	-										
98	Landscape works for PTO-Trenchless-02	289 days 289 days	2023/4/20	0% 2024/4/10											
00															
101	Testing of PTO Village Sewerage	75 days	2024/4/11	0% 2024/7/11											
03															
104 105	Submarine Outfall by HDD Method with Cofferdam	471 days	2022/11/11	0% 2024/6/17											
105		uays		0.70 2024/0/17											
07	Installation of silt curtain near the rocky shore and construction of cofferdam for entry pit	81 days	2022/11/11	0% 2023/2/20										•	
108	Horizontal Directional Drilling	225 days	2023/2/21	0% 2023/11/2											
109	Construction of Cofferdam (include installation of silt curtain around the cofferdam)	90 days	2023/8/7	0% 2023/11/2	!										
110 111	Construction of diffuser manifold Removal of cofferdam at both the manifold and the entry pit (including removal of silt curtain after removal of	65 days 25 days	2023/11/23 2024/2/14	0% 2024/2/9 0% 2024/3/13	i										
	cofferdam)														
112	Landscape works	396 days	2022/11/11	0% 2024/3/13										<u>ا</u>	:
113	Tecting of Submaine Outfall	75 dave	2024/3/14	00/ 2024/6/15	_										
114 116	Testing of Submaine Outfall	75 days	2024/3/14	0% 2024/6/17											
117	Completion of Section 2	0 days	2024/7/11	0% 2024/7/11											
	1 -		1												

Project:DC/2019/09	Task Split	Milestone	Project Summary	Split	Milestone	\$
Date: Oct 2021	Project Guide: Critical Task Progress	Summary	Project Guide: Critical Task 🗇	Progress	Summary	Ŷ



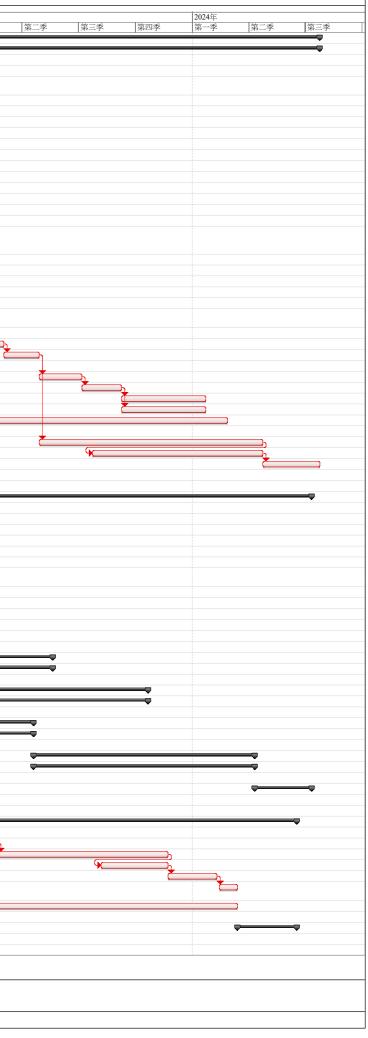

Appendix 3-1

Meteorological Data

# Project No. 1825 Monthly Environmental Monitoring & Audit Report for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant

#### Hong Kong Observatory King's Park Waglan Island<sup>^</sup> **Air Temperature** Mean Mean **Total Bright Prevailing Wind** Mean Mean Mean Amount Total Day Wind Absolute Mean Absolute **Dew Point** Relative of Rainfall **Sunshine** Direction Pressur **Daily Max Daily Min** Speed (deg. e (hPa) (deg. C) Humidity (%) Cloud (degrees) (mm) (hours) (km/h)(deg. C) **C**) (deg. C) (%) 1 1009.1 33.1 30.3 28.8 26.1 79 65 Trace 6.9 230 v 2 1011.0 32.9 30.0 28.3 24.8 74 68 8.2 110 9.4 -2.9 090 25.0 3 1012.4 29.9 28.8 27.0 82 1.9 24.9 79 1012.5 8.5 080 36.1 4 32.7 29.8 28.1 23.7 71 51 -5 1011.4 32.8 30.1 28.7 23.7 69 45 Trace 10.5 080 43.0 1008.5 6.9 070 48.5 6 31.7 29.5 27.6 23.2 69 63 Trace 7 25.0 23.8 88 43.9 0.4 1005.7 30.8 28.8 75 070 56.0 090 8 1004.6 26.8 25.5 24.7 24.4 96 329.7 53.3 94 -9 1004.9 26.5 25.3 130.3 0.2 58.8 27.9 25.0 91 97 100 080 46.8 10 1008.0 27.9 26.8 25.3 24.2 86 89 45.1 -11 1005.4 32.7 28.5 26.0 21.8 68 66 10.7 360 35.1 -1001.3 26.4 25.1 23.6 84 0.2 0.6 360 62.4 12 18.2 65 1002.5 13 25.8 22.9 23.9 89 90 57.7 0.2 080 61.4 27.4 1009.2 26.1 5.2 080 32.5 14 30.0 27.8 25.3 86 88 13.3 15 1010.4 27.6 26.2 25.2 23.4 85 92 4.6 060 26.9 -8.6 16 1013.8 30.3 26.8 24.3 21.4 73 57 Trace 010 35.5

### Appendix 3-1 Daily Extract of Meteorological Observations, October 2021

Allied Environmental Consultants Limited

Member of AEC Group (HKEX Stock Code: 8320.HK)

# Project No. 1825 Monthly Environmental Monitoring & Audit Report for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant

				Hong Kong	Observator	у			King's Park	Waglan Isla	nd^
Day	Mean Pressur e (hPa)	Air T Absolute Daily Max (deg. C)	Гетрега Mean (deg. С)	ture Absolute Daily Min (deg. C)	Mean Dew Point (deg. C)	Mean Relative Humidity (%)	Mean Amount of Cloud (%)	Total Rainfall (mm)	Total Bright Sunshine (hours)	Prevailing Wind Direction (degrees)	Mean Wind Speed (km/h)
17	1018.0	28.0	24.2	22.2	17.9	68	82	-	8.2	010	40.8
18	1018.3	27.7	23.9	20.9	18.1	70	59	-	4.6	010	25.0
19	1017.8	28.9	25.7	23.5	20.9	75	39	-	9.7	080	20.5
20	1015.9	29.8	26.8	25.0	22.5	78	49	0.1	10.3	090	21.9
21	1014.9	28.2	24.2	19.3	20.5	80	76	0.7	1.8	360	20.3
22	1019.2	20.5	19.3	18.2	15.1	77	88	Trace	-	360	33.6
23	1020.1	22.7	20.5	18.3	15.8	75	95	-	0.8	010	24.0
24	1018.9	26.6	22.1	19.8	16.1	69	61	-	7.8	360	28.1
25	1016.6	27.5	23.1	19.7	16.4	66	49	-	7.4	360	25.5
26	1015.8	28.3	25.1	22.7	19.1	69	68	-	8.6	050	26.5
27	1016.7	27.0	25.6	24.9	21.1	76	86	Trace	1.3	070	32.0
28	1017.9	28.0	25.7	24.2	21.3	77	87	0.1	4.8	080	34.0
29	1018.2	27.7	25.5	23.9	20.9	76	84	1.1	8.4	080	32.1
30	1018.8	26.2	24.4	23.0	20.8	81	88	2.4	1.5	060	26.4
31	1018.7	26.1	24.3	23.4	19.5	75	75	-	4.1	070	34.2
Mean/Total	1012.8	28.5	26.0	24.1	21.4	76	74	631.1	149.1	080	34.4

Member of AEC Group (HKEX Stock Code: 8320.HK)

# Project No. 1825 Monthly Environmental Monitoring & Audit Report for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant

*^The prevailing wind direction is the wind direction most frequently observed during the period.* 

All data were recorded at the Hong Kong Observatory except sunshine duration which was recorded at King's Park and winds at Waglan Island.

\*\*\* unavailable

Source: <a href="https://www.weather.gov.hk/wxinfo/pastwx/metob202110.htm">https://www.weather.gov.hk/wxinfo/pastwx/metob202110.htm</a>

Appendix 3-2

Air Quality Monitoring Equipment Calibration Cert



Report no.: 940891CA202793

Page 1 of 1

Hong Kong

# CALIBRATION CERTIFICATE OF DUST METER

Client : Fugro Technical Services Limited

Project : Calibration Services

### **Client Supplied Information**

Details of Unit Under Test, UUT

: Laser dust monitor
: SIBATA
: LD-5R
: 620408
: NA
: 26-Nov-2021

#### Laboratory Information

Description	: 1. Balance	2. TSP high volume air sampler					
Equipment ID. / Seria	al no. : 1. C-065-9	2. 4350					
Date of Calibration	: 27-Nov-2020	Ambient Temperature : 25 ± 10 °C					
Calibration Location	: General Chemical	Laboratory of FTS and Ma Wan A1 Site Bound	ary				
Method Used	: By direct comparis	By direct comparison the weight of dust particle trapped in a filter paper using high					
	volume sampler (T	SP method) for a certain period, with the readir	ng of the UUT. They				
	should be placed a	t the same location and powered on and off at	the same time.				

#### Calibration Results :

Reference concentration (mg/m <sup>3</sup> )	Total count for 1 hour	CPM (Count per minute)
0.3486	5200	86.67
0.1257	4582	76.37
0.0943	4417	73.62

#### **Remarks:**

1. The equipment being used in this calibration is traceable to recognized National Standards.

2. The interpolation equation : Concentration  $(mg/m^3) = K \times [UUT reading (CPM)]$ , where K = 0.002403

3. Correlation coefficient (r): 0.9962

Checked by : Churry Date : 30 - 12 - 2020 Certified by : KJ. Jeung Date : J - 1 - Yor CA-R-297 (22/07/2009) Leung Kwok Tai (Assistant Manager)

\*\* End of Report \*\*

The copyright of this report is owned by Fugro Technical Services Limited. This report shall not be reproduced except in full.

T +852 2450 8233 | F +852 2450 6138 | E matlab@fugro.com | W fugro.com



Report no.: 940891CA202730(7)

Page 1 of 1

# CALIBRATION CERTIFICATE OF DUST METER

Client : Fugro Technical Services Limited

Project : Calibration Services

### **Client Supplied Information**

Details of Unit Under Test, UUT

Description	: Laser dust monitor
Manufacturer	: SIBATA
Model No.	: LD-5R
Serial No.	: 882146
Specification Limit	: NA
Next Calibration Date	: 22-Nov-2021

#### Laboratory Information

Description		: 1. Balance		2. TSP high volume air sampler
Equipment ID. / Seria	al ı	no. : 1. C-065-9		2. 4350
Date of Calibration	:	23-Nov-2020	А	mbient Temperature : 25 ± 10 °C
Calibration Location	•	General Chemical L	_abo	pratory of FTS and Ma Wan A1 Site Boundary
Method Used	:	By direct compariso	on th	ne weight of dust particle trapped in a filter paper using high
		volume sampler (TS	SP r	method) for a certain period, with the reading of the UUT. They
		should be placed at	the	same location and powered on and off at the same time.

### Calibration Results :

Reference concentration (mg/m <sup>3</sup> )	Total count for 1 hour	CPM (Count per minute)
0.0915	2788	46.47
0.0469	2287	38.12
0.1172	3129	52.15

#### **Remarks:**

1. The equipment being used in this calibration is traceable to recognized National Standards.

2. The interpolation equation : Concentration (mg/m<sup>3</sup>) = K x [UUT reading (CPM)], where K = 0.001869

3. Correlation coefficient (r): 0.9990

Checked by :	_ Date :_	15-12-2020	_ Certified by :_	K.T. Leung	Date :15-12-2020
CA-R-297 (22/07/2009)			Leung	Kwok Tai (Assist	ant Manager)

\*\* End of Report \*\*

The copyright of this report is owned by Fugro Technical Services Limited. This report shall not be reproduced except in full.



Report no.: 940891CA202730(2)

Page 1 of 1

# CALIBRATION CERTIFICATE OF DUST METER

Client : Fugro Technical Services Limited

Project : Calibration Services

#### **Client Supplied Information**

Details of Unit Under Test, UUT

Description	: Laser dust monitor
Manufacturer	: SIBATA
Model No.	: LD-5R
Serial No.	: 882147
Specification Limit	: NA
Next Calibration Date	: 22-Nov-2021

#### Laboratory Information

Description	: 1. Balance	2. TSP high volume air sampler
Equipment ID. / Seri	al no. :1. C-065-9	2. 4350
Date of Calibration	: 23-Nov-2020	Ambient Temperature : 25 ± 10 °C
Calibration Location	: General Chemical	Laboratory of FTS and Ma Wan A1 Site Boundary
Method Used	: By direct comparise	on the weight of dust particle trapped in a filter paper using high
	volume sampler (T	SP method) for a certain period, with the reading of the UUT. They
	should be placed a	t the same location and powered on and off at the same time.

#### Calibration Results :

Reference concentration (mg/m <sup>3</sup> )	Total count for 1 hour	CPM (Count per minute)
0.0915	3424	57.07
0.0469	2818	46.97
0.1172	3629	60.48

#### **Remarks:**

1. The equipment being used in this calibration is traceable to recognized National Standards.

2. The interpolation equation : Concentration (mg/m<sup>3</sup>) = K x [UUT reading (CPM)], where K = 0.001554

3. Correlation coefficient (r): 0.9923

Checked by :	_ Date :	15-12-2020	_Certified by :	K.T. Loung	Date :_	15-12-2020
CA-R-297 (22/07/2009)			Leung	Kwok Tai (Assista	nt Manage	er)

\*\* End of Report \*\*

The copyright of this report is owned by Fugro Technical Services Limited. This report shall not be reproduced except in full.

T +852 2450 8233 | F +852 2450 6138 | E matlab@fugro.com | W fugro.com



Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

Report no.: 940891CA211483

Page 1 of 1

# CALIBRATION CERTIFICATE OF DUST METER

Client : Fugro Technical Services Limited

Project : Calibration Services

### **Client Supplied Information**

Details of Unit Under Test, UUT

Description	: Laser dust monitor
Manufacturer	: SIBATA
Model No.	: LD-5R
Serial No.	: 892186
Specification Limit	: NA
Next Calibration Date	: 02-Jun-2022

### Laboratory Information

Description	: 1. Balance	2. TSP high volume air sampler
Equipment ID. / Seri	al no. : 1. C-065-9	2. 4350
Date of Calibration	: 03-Jun-2021	Ambient Temperature : 25 ± 10 °C
Calibration Location	: General Chemical L	aboratory of FTS and Ma Wan A1 Site Boundary
Method Used	: By direct compariso	on the weight of dust particle trapped in a filter paper using high
	volume sampler (TS	SP method) for a certain period, with the reading of the UUT. They
	should be placed at	the same location and powered on and off at the same time.

#### Calibration Results :

Reference concentration (mg/m <sup>3</sup> )	Total count for 1 hour	CPM (Count per minute)
0.0569	2147	35.78
0.0675	2299	38.32
0.1122	2675	44.58

#### Remarks:

1. The equipment being used in this calibration is traceable to recognized National Standards.

- 2. The interpolation equation : Concentration (mg/m<sup>3</sup>) = K x [UUT reading (CPM)], where K = 0.001994
- 3. Correlation coefficient (r): 0.9948

Checked by :	Date : 23-6-2021	_ Certified by : DI Jun	Date : <u>30 - 6 - 2021</u>
CA-R-297 (22/07/2009)		Leung Kwok Tai (Assis	stant Manager)

\*\* End of Report \*\*

Appendix 3-3

High-Volume Sampler Calibration Calculation Spreadsheet



Model	Iodel:     Tisch TE-5170     Date of Calibration: 23-Sep-21									
Serial N	<i>ا</i> م.: ،	4350					Cali	bration Date: Technician:		
				co	)NDI	TIONS				
	Sea Level Pressure (hPa): 1013.00 Temperature (°C): 28							rected Pressu Tem <sub>l</sub>	re (mm Hg): perature (K):	760 301
			(	CALIBR	ATIC	ON ORIF	ICE			
Model:Tisch TE-5025AQstd Slope:2.11508Serial No.:2154Qstd Intercept:-0.02962Calibration Date:11-Sep-20Expiry Date:11-Sep-21										
				CAL	.IBR/	ATIONS				
Plate         H2O (L)         H2O (R)         H2O         Qstd           No.         (in)         (in)         (in)         (m³/m					l (char	t)	IC (corrected)		LINEAR RESSION	
18 13 10	5.40 4.00 2.90	-6.10 -5.00 -4.20	11.500 9.000 7.100	1.	.609 .425 .267	53	.00 .00	57.70 52.73 48.75	Slope = Intercept = Corr. coeff.=	27.8513 13.1746 0.9980
7 5	1.80 0.80	-2.90 -2.00	4.700 2.800	1.	.034 .801	43	.00	42.78 34.82		
Calcula	ations:									
	= 1/m[Sqrt(H Sqrt(Pa/Pstd)		)(Tstd/Ta))-b]		FLOW RATE CHART					
IC = cc I = actor	standard flo prrected char ual chart resp alibrator Oct	rt response ponse				70.00 -				
<ul> <li>m = calibrator Qstd slope</li> <li>b = calibrator Qstd intercept</li> <li>Ta = actual temperature during calibration (deg K)</li> <li>Pa = actual pressure during calibration (mm Hg)</li> </ul>					ponse (IC)	50.00 - 40.00 -				
Tstd = 298 deg K Pstd = 760 mm Hg					Actual chart response	30.00 -				
For subsequent calculation of sampler flow: 1/m((I)[Sqrt(298/Tav)(Pav/760)]-b)				Actual c	20.00 -					
m = sampler slope b = sampler intercept I = chart response Tav = daily average temperature Pav = daily average pressure						10.00 - 0.00 - 0.0	00	0.500 Standard	1.000 1.50 Flow Rate (m <sup>3</sup>	



Model: Tisch TE-5170 Date of Calibration: 23-Sep-21										
Serial N	Serial No.: 4374 Next Calibration Date: 22-Nov-21 Technician: Sam Fong									
				CO	)NDI	TIONS				
		1013	3.00 28	(	Cor	rected Pressu Tem	re (mm Hg): perature (K):	760 301		
			(	CALIBR	ATIC	ON ORIFI	ICE			
	Model: Tisch TE-5025AQstd Slope:2.11508Serial No.:2154Qstd Intercept:-0.02962Calibration Date:11-Sep-20Expiry Date:11-Sep-21								-0.02962	
				CAL	.IBR/	ATIONS				
PlateH2O (L)H2O (R)H2OQstdNo.(in)(in)(in)(m³/m					l (chart	t)	IC (corrected)		LINEAR	
18 13 10 7	5.40 4.10 3.10 2.00	-6.30 -5.50 -4.20 -2.80	11.700 9.600 7.300 4.800	1. 1. 1. 1.	.623 .471 .285 .045	59. 53. 47. 39.	.00 .00 .00 .00	58.70 52.73 46.76 38.80	Slope = Intercept = Corr. coeff.=	37.0683 -1.3472 0.9954
5 Calcula	1.30 ations:	-2.50	3.800	0.	.931	32.	.00	31.84		
	1/m[Sqrt(H Sqrt(Pa/Pstd		)(Tstd/Ta))-b]					FLOW	RATE CHART	
Qstd = standard flow rate IC = corrected chart response I = actual chart response m = calibrator Qstd slope b = calibrator Qstd intercept Ta = actual temperature during calibration (deg K) Pa = actual pressure during calibration (mm Hg) Tstd = 298 deg K Pstd = 760 mm Hg					Actual chart response (IC)	70.00 - 60.00 - 50.00 - 40.00 - 30.00 -				
For subsequent calculation of sampler flow: 1/m((I)[Sqrt(298/Tav)(Pav/760)]-b)				Actual c	20.00 -					
m = sampler slope b = sampler intercept I = chart response Tav = daily average temperature Pav = daily average pressure						10.00 0.00 0.00	00	0.500 Standard	1.000 1.50 Flow Rate (m <sup>3</sup>	



Model: Serial N		Tisch TE-517 2089	70					f Calibration: bration Date:	22-Nov-21	
Technician: Sam Fo CONDITIONS							Sam Fong			
Sea Level Pressure (hPa): 101:							re (mm Hg):	760		
Temperature (°C):				28			Temperature (K):		301	
			(	CALIBR	ATIC	ON ORIF	ICE			
Model: Tisch TE-5025A Serial No.: 2154 Calibration Date: 11-Sep-20						Qstd Slope: 2.11508 Qstd Intercept: -0.02962 Expiry Date: 11-Sep-21				
				CAL	.IBR/	ATIONS				
Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m <sup>3</sup> /m		l (char	t)	IC (corrected)		LINEAR
18 13	5.70 4.20	-7.10 -5.40	12.800 9.600	1. 1.	.697 .471	59. 54.	.00 .00	58.70 53.72	Slope = Intercept =	23.9755 18.4796
10 7 5	2.50 1.30 0.80	-3.70 -3.00 -1.20	6.200 4.300 2.000	0.	.185 .989 .679	989 41.00		48.75 40.79 34.82	Corr. coeff.=	0.9924
	ations:	- 1.20	2.000	0.	015		.00	34.02	<u> </u>	
Qstd = 1/m[Sqrt(H2O(Pa/Pstd)(Tstd/Ta))-b]					FLOW RATE CHART					
IC = I[Sqrt(Pa/Pstd)(Tstd/Ta)]						70.00				
	Qstd = standard flow rate IC = corrected chart response						L			
l = actu	ual chart res	ponse				60.00 -				
	m  = calibrator Qstd slope b  = calibrator Qstd intercept					50.00				
Ta = actual temperature during calibration (deg K) Pa = actual pressure during calibration (mm Hg) Tstd = 298 deg K					Actual chart response (IC)	40.00 -				
Pstd = 760 mm Hg					art res	30.00 -				
For subsequent calculation of sampler flow: 1/m((l)[Sqrt(298/Tav)(Pav/760)]-b)						20.00 -				
m = sampler slope b = sampler intercept I = chart response						10.00		0.500	1.000 1.50	00 2.000
Tav = daily average temperature Pav = daily average pressure					0.000 0.500 1.000 1.500 2.000 Standard Flow Rate (m <sup>3</sup> /min)					



Model: Tisch TE-5170 Serial No.: 3796			Date of Calibration: 23-Sep-21 Next Calibration Date: 22-Nov-21								
					Technician: Sam Fong						
	CONDITIONS										
Sea Level Pressure (hPa): 101. Temperature (°C):			3.00Corrected Pressure (mm28Temperature			-	760 301				
CALIBR						ATION ORIFICE					
Model: Tisch TE-5025A Serial No.: 2154 Calibration Date: 11-Sep-20					Qstd Slope: 2.11508 Qstd Intercept: -0.02962 Expiry Date: 11-Sep-21						
				CAL	.IBR/	ATIONS					
Plate	H2O (L)	H2O (R)	H2O	Qstd		I	IC	L	INEAR		
No.	(in)	(in)	(in)	(m <sup>3</sup> /m		(chart)	(corrected)		RESSION		
18	5.00	-6.60	11.600		.616	58.00		Slope =	25.5442		
13	3.80	-5.20	9.000		.425	53.00		Intercept =	15.7976		
10	2.40	-4.70	7.100		.267	47.00		Corr. coeff.=	0.9952		
7 5	1.50 0.50	-3.20 -1.50	4.700 2.000		.034 .679	42.00 34.00					
<b>Calcul</b> a Qstd =		20(Pa/Pstd)	)(Tstd/Ta))-b]		<b></b>			RATE CHART			
	Sqrt(Pa/Pstd)		· · · · ·			70.00					
Octd -	standard flo	ow rate				70.00					
	orrected char					60.00					
l = actu	ual chart res	ponse							▶		
m = calibrator Qstd slope						50.00					
<ul> <li>b = calibrator Qstd intercept</li> <li>Ta = actual temperature during calibration (deg K)</li> <li>Pa = actual pressure during calibration (mm Hg)</li> </ul>					oonse (IC)	40.00					
Tstd = 298 deg K Pstd = 760 mm Hg					Actual chart response	30.00	<b>*</b>				
For subsequent calculation of sampler flow: 1/m((I)[Sqrt(298/Tav)(Pav/760)]-b)					Actual c	20.00					
m = sampler slope b = sampler intercept I = chart response Tav = daily average temperature						<b>0.00</b>	0.500 Stopdard	1.000 1.50			
Pav = daily average pressure					Standard Flow Rate (m <sup>3</sup> /min)						

Appendix 3-4

Methodology for Correlation Calculation between Potable Laser Dust Meter and High-Volume Sampler

# 1. Correlation between Portable laser dusty meter and High-

# volume Sampler Methodology

### 1.1. Correlation results between the direct reading meter and High-Volume Sampler

High – Volume Sampler Calibration

- 1.1.1. The specification, a sample of calibration certificate and certificate of comparison check with High volume sampler of the proposed air quality monitoring equipment listed in Table 2.1 are attached in appendix.
- 1.1.2. The High-Volume air sampler calibration procedure based on the requirement of manufacturer are shown below.
- (a) Disconnect the sampler motor from the mass flow controller and connect the motor to a stable AC power source.
- (b) Mount the calibrator orifice and top loading adapter plate to the sampler. A sampling filter is generally not used during this procedure. Tighten the top loading adapter hold down nuts securely to ensure that no air leaks are present.
- (c) Allow the sampler motor to warm up to its normal operating temperature
- (d) (approximately 10-15 minutes).
- (e) Conduct a leak test by covering the hole(s) on top of the orifice and pressure tap on the orifice with your hands. Listen for a high-pitched squealing sound made by escaping air. If this sound is heard, a leak is present and the top loading adapter hold-down nuts need to be re-tightened. If the sound is lower, the leak is near one of the other gaskets in the system. Avoid running the sampler for longer than 30 seconds at a time with the orifice blocked to avoid overheating the motor. Do not perform this leak test procedure with a manometer connected to the side tap on the calibration orifice or the blower motor. Liquid from the manometer could be drawn into the system and cause motor damage.
- (f) Connect one side of a water manometer to the pressure tap on the side of the orifice with a rubber vacuum tube. Leave the opposite side of the manometer open to the atmosphere. Note: Both valves on the manometer have to be open for the liquid to flow

freely. One side of the 'U' tube goes up the other goes down; add together for the "H2O reading.

- (g) A manometer must be held vertically to ensure accurate readings. Tapping the backside of the continuous flow recorder will help to center the pen and provide accurate readings. When using a variable orifice, five flow rates are achieved in this step by adjusting the knob on the variable orifice to five different positions and taking five different readings.
- (h) Record the ambient air temperature, the ambient barometric pressure, the sampler serial number, the orifice s/n, the orifice slope and intercept with date last certified, todays date, site location and the operators initials on the attached blank calibration sheet.
- (i) An example of a Lead (or TSP) Sampler Calibration Data Sheet has been attached with data filled in from a typical calibration. This includes the transfer standard orifice calibration relationship which was taken from the Orifice Calibration Worksheet that accompanies the calibrator orifice.

Disconnect the sampler motor from its power source and remove the orifice and top loading adapter plate. Re-connect the sampler motor to the electronic mass flow controller.

- 1.1.3. Since this calibration is for a TSP sampler, the slope and intercept for this orifice uses standard flows rather than actual flows and is taken from the Q standard section of the Orifice Calibration Worksheet. The Q actual flows are only used when calibrating a PM-10 sampler.
- 2.3.4 The five orifice manometer readings taken during the calibration have been recorded in the column on the data worksheet titled Orifice "H2O. The five continuous flow recorder readings taken during the calibration have been recorded under the column titled I chart.

2.3.5 The orifice manometer readings need to be converted to the standard air flows they represent using the following equation:

 $Qstd = 1/m[Sqrt((H_20)(Pa/760)(298/Ta))-b]$ 

where:

Qstd = actual flow rate as indicated by the calibrator orifice, m<sup>3</sup>/min H<sub>2</sub>O = orifice manometer reading during calibration, "H<sub>2</sub>O Ta = ambient temperature during calibration, K (K = 273 + °C) 298 = standard temperature, a constant that never changes, K Pa = ambient barometric pressure during calibration, mm Hg 760 = standard barometric pressure, a constant that never changes, mm Hg m = *Qstandard slope of orifice* calibration relationship b = *Qstandard intercept of orifice* calibration relationship.

- 2.3.6 Once these standard flow rates have been determined for each of the five run points, they are recorded in the column titled Qstd, and are represented in cubic meters per minute.
- 2.3.7 Once these standard flow rates have been determined for each of the five run points, they are recorded in the column titled Qstd, and are represented in cubic meters per minute

2.3.8 The continuous flow recorder readings taken during the calibration need to be corrected to the current meteorological conditions using the following equation:

IC = I[Sqrt((Pa/760)(298/Ta))]

where:

IC = continuous flow recorder readings corrected to current Ta and Pa
I = continuous flow recorder readings during calibration
Pa = ambient barometric pressure during calibration, mm Hg.
760 = standard barometric pressure, a constant that never changes, mm Hg
Ta = ambient temperature during calibration, K (K = 273 + °C)
298 = standard temperature, a constant that never changes, K

- 2.3.9 After each of the continuous flow recorder readings have been corrected, they are recorded in the column titled IC (corrected).
- 2.3.10 Using Qstd and IC (or FLOW (corrected)) as the x and y axis respectively, a slope, intercept, and correlation coefficient can be calculated using the least squares regression method. The correlation coefficient should never be less than 0.990 after a five-point calibration. A coefficient below .990 indicates a calibration that is not linear and the calibration should be performed again. If this occurs, it is most likely the result of an air leak during the calibration or high wind speed during the calibration procedure.
- 2.3.11 The equations for determining the slope (m) and intercept (b) are as follows:

$$\frac{(\sum x)(\sum y)}{\sum xy - n}$$

$$\frac{(\sum x)^2}{\sum x^2 - n} ; \quad b = \overline{y} - m\overline{x}$$

The equation for the coefficient of correlation (r) is as follows:

m=

$$\mathbf{r} = \sum xy - \frac{(\sum x)(\sum y)}{n}$$

$$\sqrt{\left[\sum x^2 - \frac{(\sum x)^2}{n}\right] \left[\sum y^2 - \frac{(\sum y)^2}{n}\right]}$$

where: n = number of observations $\sum = sum of$ 

- 2.3.12 The acceptable operating flow range of a TSP sampler is 1.1 to 1.7 m3/min (39 to 60 CFM). Looking at the worksheet column Qstd(see page 38), the flow rates that are within this range can be identified along with the chart reading (I) that represents them. For instance, if you wanted to set this sampler at 1.265 m3/min (44.67 CFM) (Make sure the mass flow controller is plugged in and a filter is in place) you would turn the Flow Adjustment screw until the continuous flow recorder read 37 on the chart. By making sure that the sampler is operating at a chart reading (or manometer reading) that is within the acceptable range, it can be assumed that valid TSP data is being collected.
- 2.3.13 A calibration that has a correlation coefficient of less than .990 is not considered linear and should be re-calibrated. Therefore, if r < 0.990, return all the points or only the point with the greatest deviation and the recalculate.</p>
- 2.3.14 The 24-hour TSP levels to be measured by direct reading methods, utilising portable Laser Particle Photometer Monitors (Sibata Model LD-3B/5R), in place of High-Volume Sampler (HVS) if HVS experience difficulties in operation during monitoring. It is demonstrated by the previous project experiences, that 24-hour TSP monitoring results collected by direct reading method are comparable to those produced by the high-volume sampling method, to indicate short event impacts. The projects utilising the collection of 24-hour TSP levels data by direct reading methods are shown below.

Project Contract Number	Location	Status
NDO 03/2018	Road Widening and Retrofitting Noise Barriers on	On-going
	Tai Po Road (Sha Tin Section)	
NDO 14/2018	Advance and First Stage Works of Kwu Tung North	On-going
	and Fanling North New Development Areas	

Project Reference for utilising the collection of 24-hour TSP levels data by direct reading methods

- 2.3.15 Calculation of the value of 24-hour TSP concentration is given by the average of 24 calculated 1-hour TSP concentration, where the calculated 1-hr TSP concentration is given by the product of the direct reading and the K-factor based on the correlation results between the direct reading meter and High-Volume Sampler.
- 2.3.16 The correlation results between the direct reading meter and High-Volume Sampler shall be review with bimonthly internal calibration. To maintain the correlation with two sets of data (monitoring data from HVS and monitoring data from Portable Laser Particle Photometer Monitors) bimonthly internal calculated are strongly linked together two sets of data.
- 2.3.17 To protect the dust meter from being damaged and to operate without disturbances or nuisance, temporary barriers shall be erected around the monitoring equipment during the monitoring period. Temporary barriers will be placed approx. 0.5m away from the dust meter.

# Maintenance/ Calibration for the High-Volume Sampler (HVS) being correlation

- 2.3.18 The HVS shall be calibrated bimonthly in accordance to the specification in the manufacturer's manual. The calibration certificates shall be available to the IEC for checking upon request. The validity and accuracy of the HVS shall also be tested against the result by the TE-5025A Calibration Kit periodically, Details of Calibration Cert and Specification for HVS- 5170 and HVS- Calibration Kit TE-5025A are given in Appendix 2-1 and Appendix 2-3.
- 2.3.19 Tisch TE-5170 is chosen as the HVS for 24-hour TSP monitoring and Tisch TE 5025A is chosen as the HVS Calibration-Kit for HVS calibration.
- 2.3.20 The high-volume motors and their accessories should be properly maintained. Appropriate maintenance such as routine motor brushes replacement and electrical wiring checking should be made to ensure that the equipment and necessary power supply were in good working condition.

Appendix 3-5

Correlation Calculation between Potable Laser Dust Meter and High-Volume Sampler



Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

# **Correlation between HVS & Dust Meter**

Date of Correlation:	23 September 2021
Date of Next Correlation:	22 November 2021

## Laser dust monitor Information

Model:	Sibata LD-5R
Serial No:	882147
Date of Calibration:	23 September 2021
Date of Next Calibration:	22 November 2021


# High Volume Sampler (HVS) Information

Model:	Tisch TE-5170
Serial No:	4350
Baseline Monitoring Location ID	AMS-1N
Baseline Monitoring Location	Footpath above House No. 28 Po Toi O Tsuen Road
Ambient Temperature:	28.0 °C
Method Used:	
	Dy direct comparison the weight of duct particle trans

By direct comparison the weight of dust particle trapped in a filter paper using HVS (TSP method) for a certain period, with the reading of the Unit uner test. They should be paced at the same location and powered on and off at the same time.

## **Calibraion Results:**

HVS - TSP μg/m³	49.5	74.4	110.5	171.2	300.9
Dust Meter - CPM	25	48	82	117	193

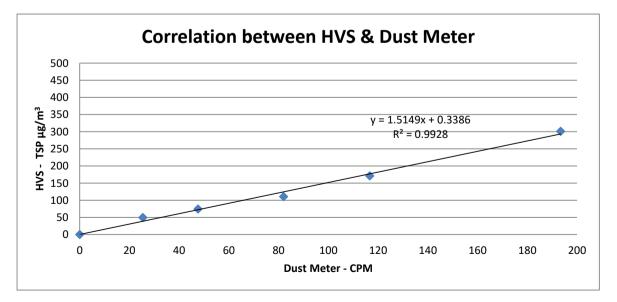

## **Remarks:**

1. K-Factor (x) = 1.5149x + 0.3386

2. Correlation coefficient (r) = 0.9928



Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

# **Correlation between HVS & Dust Meter**

Date of Correlation:	23 September 2021
Date of Next Correlation:	22 November 2021

## Laser dust monitor Information

Model:	Sibata LD-5R
Serial No:	892186
Date of Calibration:	23 September 2021
Date of Next Calibration:	22 November 2021


## High Volume Sampler (HVS) Information

Model:	Tisch TE-5170
Serial No:	4374
Baseline Monitoring Location ID	AMS-2N1
Baseline Monitoring Location	Open Space Approx. 15m from Hung Shing Temple
Ambient Temperature:	28.0 °C
Method Used:	
	By direct comparison the weight of duct particle trans

By direct comparison the weight of dust particle trapped in a filter paper using HVS (TSP method) for a certain period, with the reading of the Unit uner test. They should be paced at the same location and powered on and off at the same time.

## **Calibraion Results**

Calibraion Results:	43.7	64.9	98.7	148.4	277.0
Dust Meter - CPM	21	42	68	90	159

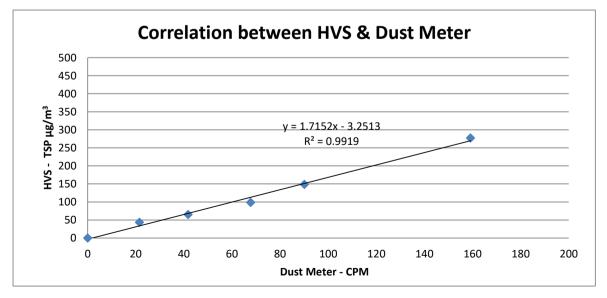

## **Remarks:**

1. K-Factor (x) = 1.7152x - 3.2513

2. Correlation coefficient (r)= 0.9919



Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

# **Correlation between HVS & Dust Meter**

Date of Correlation:	23 September 2021
Date of Next Correlation:	22 November 2021

## Laser dust monitor Information

Model:	Sibata LD-5R
Serial No:	620408
Date of Calibration:	23 September 2021
Date of Next Calibration:	22 November 2021


# High Volume Sampler (HVS) InformationModel:Tisch TE-5170Serial No:2089

Serial No:	2089
Baseline Monitoring Location ID	AMS-3N
Baseline Monitoring Location	Vacant land near Temporary Structure (House) near
Ambient Temperature:	28.0 °C
Method Used:	

By direct comparison the weight of dust particle trapped in a filter paper using HVS (TSP method) for a certain period, with the reading of the Unit uner test. They should be paced at the same location and powered on and off at the same time.

## **Calibraion Results**

Calibraion Results:	52.3	79.3	115.9	183.2	309.4
Dust Meter - CPM	22	42	69	108	170

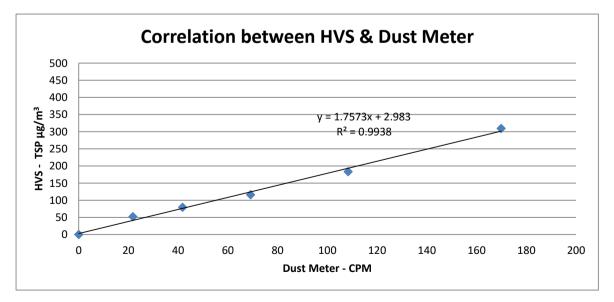

## **Remarks:**

1. K-Factor (x) = 1.7573x + 2.983

2. Correlation coefficient (r) = 0.9938



Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

# **Correlation between HVS & Dust Meter**

Date of Correlation:	23 September 2021
Date of Next Correlation:	22 November 2021

## Laser dust monitor Information

Model:	Sibata LD-5R
Serial No:	882146
Date of Calibration:	23 September 2021
Date of Next Calibration:	22 November 2021


## High Volume Sampler (HVS) Information

Model:	Tisch TE-5170
Serial No:	3796
Baseline Monitoring Location ID	AMS-4N
Baseline Monitoring Location	Resting shelter near Seacrest Villas
Ambient Temperature:	28.0 °C
Method Used:	
	Du divert compositors the unitable of

By direct comparison the weight of dust particle trapped in a filter paper using HVS (TSP method) for a certain period, with the reading of the Unit uner test. They should be paced at the same location and powered on and off at the same time.

## **Calibraion Results**

Calibraion Results:	50.0	75.4	111.2	173.8	300.1
Dust Meter - CPM	21	39	64	98	152

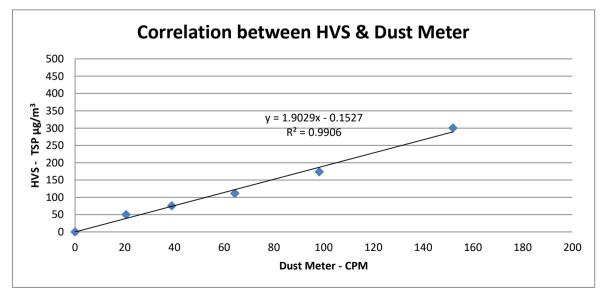

## **Remarks:**

1. K-Factor (x)= 1.9029x - 0.1527

2. Correlation coefficient (r) = 0.9906

Appendix 3-6

Air Quality and Noise Impact Monitoring Schedule

#### Contract No. EP516/2016 Port Shelter Sewerage, stage 3 – Sewage Works at Po Toi O

Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday
26-Sep	27-Sep	28-Sep	29-Sep	30-Sep	1-Oct	2-Oct
			*Noise			
			** 1 - hr TSP			
			**24- hr TSP			
3-0ct	4-Oct	5-Oct	6-Oct	7-Oct	8-Oct	9-Oct
		*Noise				
		** 1 - hr TSP				
		**24- hr TSP				
10-Oct	11-Oct	12-Oct	13-Oct	14-Oct	15-Oct	16-Oct
	*Noise					
	** 1 - hr TSP				** 1 - hr TSP	
	**24- hr TSP				**24- hr TSP	
17-Oct	18-Oct	19-Oct	20-Oct	21-Oct	22-Oct	23-Oct
				*Noise		
				** 1 - hr TSP		
				**24- hr TSP		
24-Oct	25-Oct	26-Oct	27-Oct	28-Oct	29-Oct	30-Oct
			*Noise			
			** 1 - hr TSP			
			**24- hr TSP			
31-Oct	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov

#### 2021/10 Air and Noise Quality Impact Monitoring Schedule

\* Noise Monitoring Locations: NSM1N,NMS2N,NMS3Namd NMS4N

\*\* 1hr TSP and 24- hr TSP Monitoring Locations: ASM1N , ASM2N1, ASN3N and ASM4N

#### Contract No. EP516/2016 Port Shelter Sewerage, stage 3 – Sewage Works at Po Toi O

Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday
31-Oct	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov
		*Noise				
		** 1 - hr TSP				
		**24- hr TSP				
7-Nov	8-Nov	9-Nov	10-Nov	11-Nov	12-Nov	13-Nov
	*Noise					
	** 1 - hr TSP					** 1 - hr TSP
	**24- hr TSP					**24- hr TSP
14-Nov	15-Nov	16-Nov	17-Nov	18-Nov	19-Nov	20-Nov
					*Noise	
					** 1 - hr TSP	
					**24- hr TSP	
21-Nov	22-Nov	23-Nov	24-Nov	25-Nov	26-Nov	27-Nov
				*Noise		
				** 1 - hr TSP		
				**24- hr TSP		
28-Nov	29-Nov	30-Nov	1-Dec	2-Dec	3-Dec	4-Dec

#### 2021/11 Air and Noise Quality Impact Monitoring Schedule

\* Noise Monitoring Locations: NSM1N,NMS2N,NMS3Namd NMS4N

\*\* 1hr TSP and 24- hr TSP Monitoring Locations: ASM1N ,ASM2N1, ASN3N and ASM4N

Appendix 3-7

1 hr and 24 hrs TSP Monitoring Result

#### Project No. 1825 Monthly Environmental Monitoring & Audit Report for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant 2021/10 1-hour and 24-hours TSP Monitoring Data

Aonitoring Location		AN	/IS-1N					
			1-hour TSP Monitoring				24-hour TSP Monitoring	
Date	Weather		Start Time	Concentration $(\mu g/m^3)$	Average Concentration (μg/m <sup>3</sup> )	Start Time	Concentration $(\mu g/m^3)$	
		1st hr	15:15	42.8				
2021-10-05	Fine	2nd hr	16:15	48.8	46.3	09:15	41.5	
		3rd hr	17:15	47.3				
		1st hr	09:27	51.9				
2021-10-11	Sunny	2nd hr	10:27	47.3	52.4	09:27	53.8	
		3rd hr	11:27	57.9				
		1st hr	15:16	27.6	28.6			
2021-10-15	Sunny	2nd hr	16:16	29.1		09:16	35.2	
		3rd hr	17:16	29.1				
		1st hr	10:30	50.3				
2021-10-21	Fine	2nd hr	11:30	47.3	48.3	08:30	42.4	
		3rd hr	12:30	47.3				
		1st hr	13:57	30.6				
2021-10-27	Fine	2nd hr	14:57	32.2	31.7	09:57	25.5	
		3rd hr	15:57	32.2				
				Average :	41.4	Average :	39.7	
				Action Level :	319	Action Level :	153	
				Limit Level :	500	Limit Level :	260	



#### Project No. 1825

Monthly Environmental Monitoring & Audit Report for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant 2021/09 1-hour and 24-hours TSP Monitoring Data

			1-hou	Ir TSP Monitoring		24-hour TSF	9 Monitoring
Date	Weather		Start Time	Concentration $(\mu g/m^3)$	Average Concentration (µg/m <sup>3</sup> )	Start Time	Concentratio (μg/m <sup>3</sup> )
		1st hr	15:23	53.4			
2021-10-05	Fine	2nd hr	16:23	70.5	64.8	09:23	50.6
		3rd hr	17:23	70.5			
		1st hr	10:33	51.6		09:33	44.8
2021-10-11	Sunny	2nd hr	11:33	56.8	56.2		
		3rd hr	12:33	60.2			
	Sunny	1st hr	10:21	24.2	25.7	09:21	35.6
2021-10-15		2nd hr	11:21	26.4			
		3rd hr	12:21	26.4			
		1st hr	10:42	55.1		09:42	48.6
2021-10-21	Fine	2nd hr	11:42	49.9	52.8		
		3rd hr	12:42	53.4			
		1st hr	11:43	37.9			
2021-10-27	Fine	2nd hr	12:43	36.2	36.8	09:43	31.0
		3rd hr	13:43	36.2			
				Average :	47.2	Average :	42.1
				Action Level :	279	Action Level :	179
				Limit Level :	500	Limit Level :	260



#### Project No. 1825 Monthly Environmental Monitoring & Audit Report for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant 2021/09 1-hour and 24-hours TSP Monitoring Data

Monitoring Location	:	AN	/IS-3N					
			1-hou	r TSP Monitoring		24-hour TSF	24-hour TSP Monitoring	
Date	Weather		Start Time	Concentration $(\mu g/m^3)$	Average Concentration (µg/m <sup>3</sup> )	Start Time	Concentration (µg/m <sup>3</sup> )	
		1st hr	15:28	89.1				
2021-10-05	Fine	2nd hr	16:28	87.3	92.6	09:28	72.1	
		3rd hr	17:28	101.4				
		1st hr	09:48	49.2				
2021-10-11	Sunny	2nd hr	10:48	53.9	49.4	09:48	43.1	
		3rd hr	11:48	45.2				
		1st hr	15:32	31.1	31.7	09:32	48.3	
2021-10-15	Sunny	2nd hr	16:32	29.3				
		3rd hr	17:32	34.6				
		1st hr	10:18	52.2				
2021-10-21	Fine	2nd hr	11:18	48.7	51.0	10:18	45.4	
		3rd hr	12:18	52.2				
		1st hr	10:28	53.9				
2021-10-27	Fine	2nd hr	11:28	61.0	59.2	09:28	43.1	
		3rd hr	12:28	62.7				
				Average :	56.8	Average :	50.4	
				Action Level :	303	Action Level :	158	
				Limit Level :	500	Limit Level :	260	



#### Project No. 1825 Monthly Environmental Monitoring & Audit Report for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant 2021/09 1-hour and 24-hours TSP Monitoring Data Monitoring Location : AMS-4N


		1-hou	Ir TSP Monitoring	24-hour TSP Monitoring			
Date	Weather		Start Time	Concentration $(\mu g/m^3)$	Average Concentration (µg/m <sup>3</sup> )	Start Time	Concentration $(\mu g/m^3)$
		1st hr	15:18	45.5			
2021-10-05	Fine	2nd hr	16:18	47.4	47.4	09:18	46.2
		3rd hr	17:18	49.3			
		1st hr	13:57	53.1			
2021-10-11	Sunny	2nd hr	14:57	49.3	49.3	09:57	45.2
		3rd hr	15:57	45.5			
		1st hr	13:09	24.6	27.8	09:09	
2021-10-15	Sunny	2nd hr	14:09	30.3			35.6
		3rd hr	15:09	28.4			
		1st hr	10:07	45.5		09:07	
2021-10-21	Fine	2nd hr	11:07	39.8	42.3		40.3
		3rd hr	12:07	41.7			
		1st hr	11:11	53.1			
2021-10-27	Fine	2nd hr	12:11	51.2	51.8	09:11	38.3
		3rd hr	13:11	51.2			
				Average :	43.7	Average :	41.1
				Action Level :	278	Action Level :	144
				Limit Level :	500	Limit Level :	260



## Appendix 3-7 - 1hour and 24 hours TSP Monitoring Result

## Reporting Month: 2021/10


#### AMS1N – 1 – hour TSP monitoring Chart

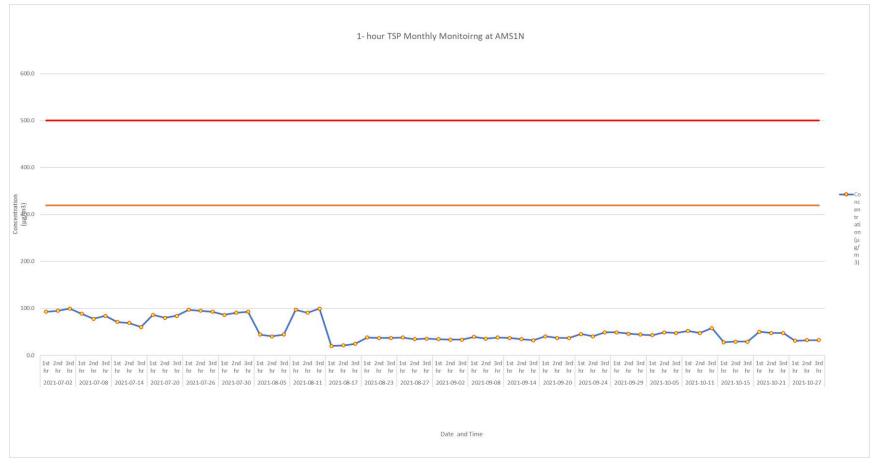

#### Allied Environmental Consultants Limited


Member of AEC Group (HKEX Stock Code: 8320.HK)

## AMS1N – 24-hour TSP Monitoring

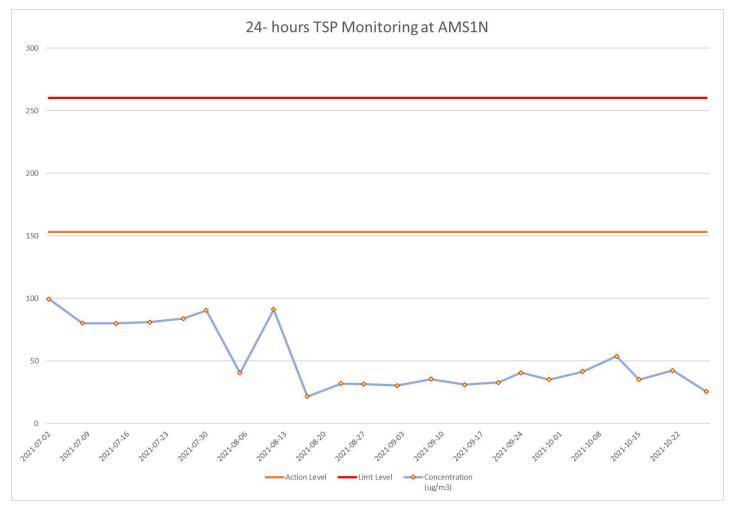

Allied Environmental Consultants Limited Member of AEC Group (HKEX Stock Code: 8320.HK)


## AMS2N1 – 1 – hour TSP monitoring Chart

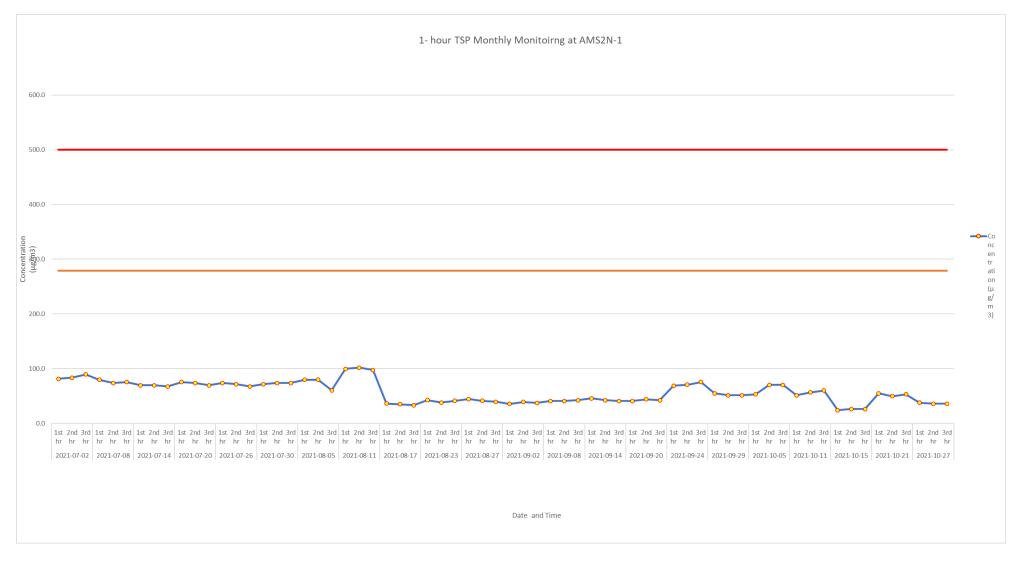

Allied Environmental Consultants Limited

Member of AEC Group (HKEX Stock Code: 8320.HK)


## AMS2N1 – 24-hour TSP Monitoring

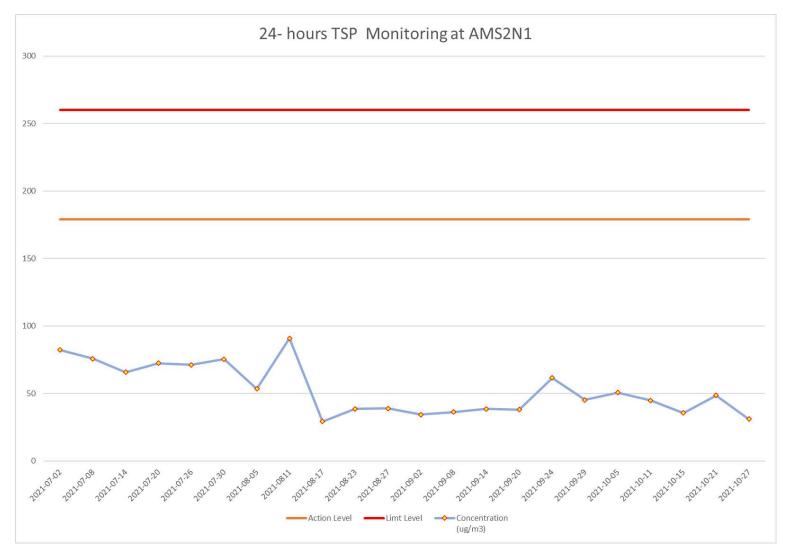

Allied Environmental Consultants Limited


Member of AEC Group (HKEX Stock Code: 8320.HK)

## AMS3N – 1 – hour TSP monitoring Chart

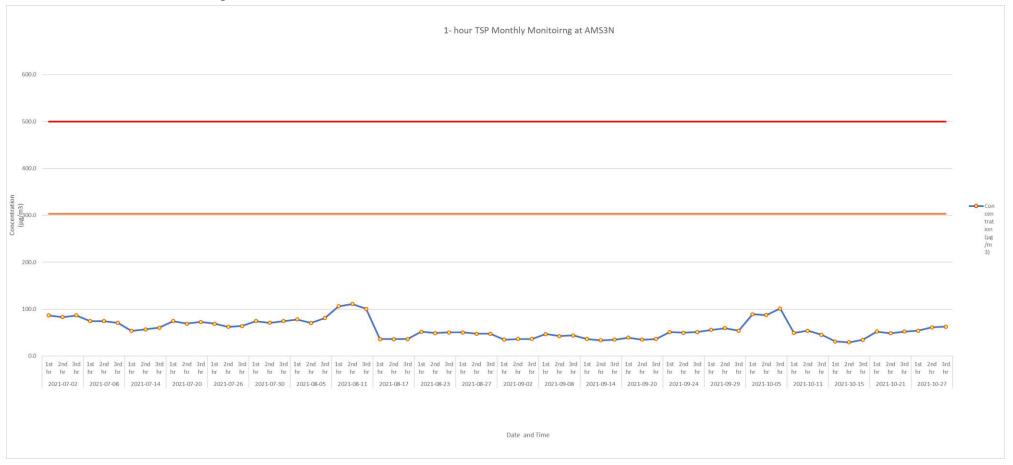

Allied Environmental Consultants Limited Member of AEC Group (HKEX Stock Code: 8320.HK)


## AMS3N – 24-hour TSP Monitoring

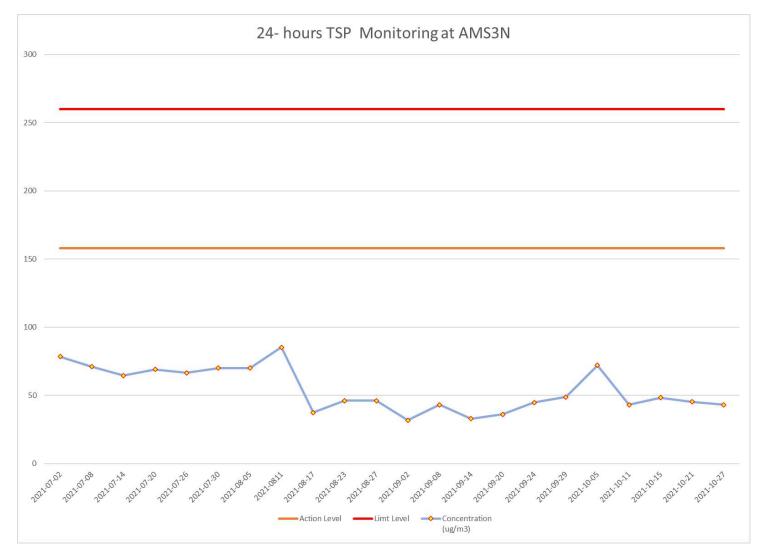


Allied Environmental Consultants Limited

Member of AEC Group (HKEX Stock Code: 8320.HK)

## AMS4N – 1 – hour TSP Monitoring

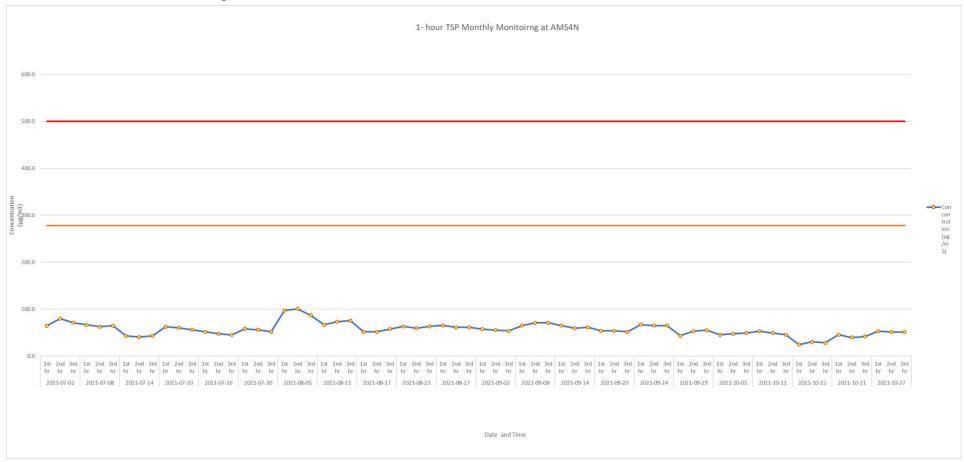

## AMS4N – 24-hour TSP Monitoring

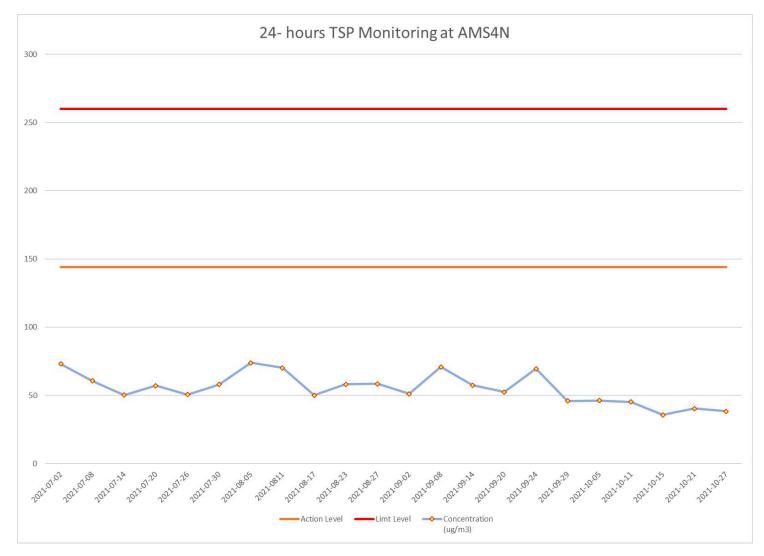

Allied Environmental Consultants Limited

Member of AEC Group (HKEX Stock Code: 8320.HK)

Appendix 3-8

Event and Action Plan for Air Quality Monitoring

## Project No. 1825

Monthly Environmental Monitoring & Audit Report for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant

## Appendix 3-8 Event and Action Plan for Air Quality Impact Monitoring

EVENT	ACTION									
	ET	IEC	ER	CONTRACTOR						
Action Level										
1.Exceedance for one sample	<ol> <li>Inform IEC, ER and Contractor;</li> <li>Identify source, investigate the causes of exceedance and propose remedial measures;</li> <li>Repeat measurement to confirm finding;</li> <li>A. Increase monitoring frequency to daily.</li> </ol>	<ol> <li>Check monitoring data submitted by ET;</li> <li>Check Contractor's working method.</li> </ol>	1. Notify Contractor	<ol> <li>Rectify any unacceptable practice;</li> <li>2. Amend working methods if appropriate.</li> </ol>						
2.Exceedance for two or more consecutive samples	<ol> <li>Inform IEC, ER and Contractor;</li> <li>Identify source;</li> <li>Advise the ER on the effectiveness of the proposed remedial measures;</li> <li>Repeat measurements to confirm findings;</li> <li>Increase monitoring frequency to daily;</li> <li>Discuss with IEC, ER and Contractor on remedial actions required;</li> <li>If exceedance continues, arrange meeting with IEC and ER;</li> <li>If exceedance stops, cease additional monitoring.</li> </ol>	<ol> <li>Check monitoring data submitted by ET;</li> <li>Check Contractor's working method;</li> <li>Discuss with ET and Contractor on possible remedial measures</li> <li>Advise the ET/ER on the effectiveness of the proposed remedial measures;</li> <li>Supervise Implementation of remedial measures.</li> </ol>	<ol> <li>Confirm receipt of notification of failure in writing;</li> <li>Notify Contractor;</li> <li>Ensure remedial measures properly implemented.</li> </ol>	<ol> <li>Submit proposals for remedial to</li> <li>ER and IEC within 3 working days of notification;</li> <li>Implement the agreed proposals;</li> <li>Amend proposal if appropriate.</li> </ol>						

## Project No. 1825

## Monthly Environmental Monitoring & Audit Report for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant

EVENT	ACTION											
	ET	IEC	ER	CONTRACTOR								
Limit Level												
1.Exceedance for one sample	<ol> <li>Inform IEC, ER, Contractor and EPD;</li> <li>Identify source, investigate the causes of exceedance and propose remedial measures;</li> <li>Repeat measurement to confirm finding;</li> <li>Increase monitoring frequency to daily;</li> <li>Assess effectiveness of Contractor remedial actions and keep IEC, EPD and ER informed of the results.</li> </ol>	<ol> <li>Check monitoring data submitted by ET;</li> <li>Check Contractor's working method;</li> <li>Discuss with ET and Contractor on possible remedial measures;</li> <li>Advise the ER on the effectiveness of the proposed remedial measures;</li> <li>Supervise implementation of remedial measures.</li> </ol>	<ol> <li>Confirm receipt of notification of failure in writing;</li> <li>Notify Contractor;</li> <li>Ensure remedial measures properly implemented.</li> </ol>	<ol> <li>Take immediate action to avoid further exceedance;</li> <li>Discuss with ET and IEC on remedial actions</li> <li>Submit proposals for remedial actions to IEC within 3 working days of notification;</li> <li>Implement the agreed proposals;</li> <li>Amend proposal if appropriate.</li> </ol>								
2.Exceedance for two or more consecutiv e samples	<ol> <li>Notify IEC, ER, Contractor and EPD;</li> <li>Identify source;</li> <li>Repeat measurement to confirm findings;</li> <li>Increase monitoring frequency to daily;</li> <li>Carry out analysis of Contractor's working procedures to determine possible mitigation to be implemented;</li> <li>Arrange meeting with IEC and ER and Contractor to discuss the remedial actions to be taken;</li> <li>Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results;</li> <li>If exceedance stops, cease additional</li> </ol>	<ol> <li>Check monitoring data submitted by ET;</li> <li>Check Contractor's working method;</li> <li>Discuss amongst ER, ET, and Contractor on the potential remedial actions;</li> <li>Review Contractor's remedial actions whenever necessary to assure their effectiveness and advise the ER accordingly;</li> <li>Supervise the implementation of remedial measures.</li> </ol>	<ol> <li>Confirm receipt of notification of failure in writing;</li> <li>Notify Contractor;</li> <li>In consultation with the IEC, agree with the Contractor on the remedial measures to be implemented;</li> <li>Ensure remedial measures properly implemented;</li> <li>If exceedance continues, consider what portion of the work is responsible and instruct</li> <li>the Contractor to terminate that portion of work until the exceedance ceases.</li> </ol>	<ol> <li>Take immediate action to avoid</li> <li>further exceedance;</li> <li>Discuss with ET and IEC on remedial actions</li> <li>Submit proposals for remedial actions to ER and IEC within 3 working days of notification;</li> <li>Implement the agreed proposals;</li> <li>Resubmit proposals if problem still not under control;</li> <li>Stop the relevant portion of works as determined by the ER until the exceedance</li> </ol>								

Appendix 4-1

Noise Monitoring Equipment Calibration Certificates



Page 1 of 1

## Report no.: 212769CA212069(1)

## CALIBRATION CERTIFICATE OF SOUND LEVEL METER

**Client Supplied Information** 

Client : Fugro Technical Services Ltd.

Address : Room 723 & 725, 7/F., Block B Profit Industrial Building, 1-15 Kwai Fung Crescent, Kwai Chung, N.T. Project : Calibration Services

Details of Unit Under Test, UUT

Description

: Sound Level Meter

Preamplifier
CEL-495
004030

#### Laboratory Information

Details of Reference Equipment -

Description	:	B & K Acoustic Multifunction Calibrator 4226 (Traditional free field setting)	
Equipment ID.	:	R-108-1	

Date of Calibration	:	26-Aug-2021	
<b>Calibration Location</b>	:	Calibration Laboratory of FTS	
Method Used	:	By direct comparison	

Ambient Temperature	2	20±2 °C
Relative Humidity	:	<80% R.H.

#### **Calibration Results :**

Parameters		Mean Value (dB)	Specific	ation	Limit(dB)
	4000Hz	1.2	2.6	to	-0.6
	2000Hz	1.3	2.8	to	-0.4
A	1000Hz	0.0	1.1	to	-1.1
A-weigthing	500Hz	-3.3	-1.8	to	-4.6
frequency	250Hz	-8.7	-7.2	to	-10.0
response	125Hz	-16.1	-14.6	to	-17.6
	63Hz	-26.1	-24.7	to	-27.7
	31.5Hz	-38.8	-37.4	to	-41.4
Differential level	94dB-104dB	0.3		± 0.6	6
linearity	104dB-114dB	-0.3		± 0.6	6

#### **Remarks**:

- 1. The equipment used in this calibration is traceable to recognized National Standards.
- 2. The mean value is the average of four measurements.
- 3. The expanded uncertainty is 0.3 dB with a coverage factor of 2 at a confidence level of 95%.
- 4. For calibration: Reference SPL are 94, 104 & 114dB, range setting is 20-140dB & time weighting is fast
- 5. The UUT does comply with EN 61672-1: 2003 Class 1 sound level meter for the above measurement.
- 6. The values given in this Calibration Certificate only relate to unit under test and the values measured at the time of the test. Any uncertainties will not include allowance for the equipment long term drift, variations with environment changes, vibration and shock during transportation, overloading, mis-handling or the capability of any other laboratory to repeat the measurement.

Checked by :	Cound	_ Date : _	27-8-2021	Certified by : _	K.T. Jeung	Date: 27-8-2021
CA-R-297 (22/07/20	09)			Leung k	Kwok Tai (Assistar	nt Manager)
			** E	nd of Report **		

The copyright of this report is owned by Fugro Technical Services Limited. This report shall not be reproduced except in full.



# Certificate of Conformity and Calibration

Instrument Model:-	CEL-633A	N Contraction of the second seco		
Serial Number Firmware revision	2206937 V006-05			
Microphone Type:- Serial Number	CEL-251 4926	21/2/20	amplifier Type:- ial Number	CEL-495 004597
Instrument Class/Type:-	°1			
Applicable standards:-				
IEC 61672: 2002 / EN 60651 (El IEC 60651 1979 (Sound Level M			2. The second s second second sec	Meters)
Note:- The test sequences perform Standard - IEC61672. The combinati electro-acoustic performance to all aj Standards - IEC60651 and IEC6080	on of tests perfor oplicable standar	rmed are considered to d	confirm the products	el meter
Test Conditions:-	29 °C 57 %RH 999 mBar	Test Engineer:- Date of Issue:-	Stephen Potten January 8, 2021	

#### Declaration of conformity:-

This test certificate confirms that the instrument specified above has been successfully tested to comply with the manufacturer's published specifications. Tests are performed using equipment traceable to national standards in accordance with Casella's ISO 9001:2008 quality procedures. This product is certified as being compliant to the requirements of the CE Directive.


#### Test Summary:-

Self Generated Noise Test	All Tests Pass
Electrical Signal Test Of Frequency Weightings	All Tests Pass
Frequency & Time Weightings At 1 kHz	All Tests Pass
Level Linearity On The Reference Level Range	All Tests Pass
Toneburst Response Test	All Tests Pass
C-peak Sound Levels	All Tests Pass
Overload Indication	All Tests Pass
Acoustic Tests	All Tests Pass

#### Combined Electro-Acoustic Frequency Response - A Weighted

Combined Electro-Acoustic Frequency Response - A Weighted (IEC 61672-3:2006)

The following A-Weighted frequency response graph shows this instruments overall frequency response based upon the application of multi-frequency pressure field calibrations. The microphones Pressure to Free field correction coefficients are applied to pressure response. Reference level taken at 1kHz.

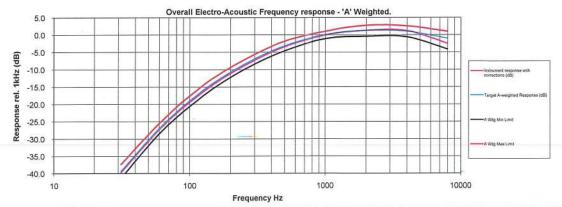

Casel	la	UK	

Regent House, Wolseley Road, Kempston, Bedford MK427.37 United Kingdom Teit +44 (0) 1234 844100 Fax: +44(0) 1234 841490 E-mat: info@caselasolutions.com 415 Lawrence Bell Drive, Unit 4 Buffalo, NY 14221, USA Toll Free (800) 366-2966 Tel: +1 (716) 276 3040 E-mail: info@casellausa.com

Casella USA

Ideal Industries India Pvt.Ltd. 229-230, Spazedge, Tower -B Sonna Road, Sector-47, Gurgaon-122001, Haryana , India.

Casella India

Tel: +91 124 4495100 E-mail: casella.sales@ideal-industries.in Casella China Ideal Industries China Room 305, Bullding 1, No. 1279, Chuanqiao Rd, Pudong New District, Shanghai, China

Tel: +86-21-31263188 Fax: +86-21-61605906 Email: info@casellasolutions.cn Casella Australia

Ideal Industries (Aust) PTY. LTD Unit 17, 35 Dunlop Rd, Mulgrave. Vic. 3170, Australia.

Email: australia@casellasolutions.com

Tested to CEL-63X test sheet TP444 revision 01-00



Report no.: 212769CA212124

#### Page 1 of 1

# CALIBRATION CERTIFICATE OF SOUND LEVEL METER

**Client Supplied Information** 

Client : Fugro Technical Services Ltd. Project : Calibration Services

#### Details of Unit Under Test, UUT

Description	:	Sound Level Meter		
Manufacturer	:	Casella		
		Meter	Microphone	Preamplifier
Model No.	:	CEL-63X	CE-251	CEL-495
Serial No.	:	3756072	02633	004052
Equipment ID	:	N-32		
Next Calibration Date	:	30-Aug-2022		
Specification Limit	:	EN 61672-1: 2003 Cla	ss 1	

#### Laboratory Information

Details of Reference Equipment -

Description	:	B & K Acoustic Multifunction Calibrator 4226 (Traditional free field settin	ıg)
Equipment ID.	:	R-108-1	
Date of Calibration	:	31-Aug-2021	

<b>Calibration Location</b>	:	Calibration Laboratory of FT	S .
Method Used	:	By direct comparison	

Ambient Temperature	1	20±2 °C
Relative Humidity		<80% R.H.

#### Calibration Results :

Parameters		Mean Value (dB)	Specific	Specification Limit(dB)			
	4000Hz	-0.4	2.6	to	-0.6		
	2000Hz	1.1	2.8	to	-0.4		
	1000Hz	0.5	1.1	to	-1.1		
frequency	500Hz	-2.6	-1.8	to	-4.6		
	250Hz	-8.0	-7.2	to	-10.0		
Tooponoo	125Hz	-15.4	-14.6	to	-17.6		
	63Hz	-25.5	-24.7	to	-27.7		
	31.5Hz	-38.4	-37.4	to	-41.4		
Differential level linearity	94dB-104dB	0.0		± 0.6	3		
	104dB-114dB	0.0		± 0.6	3		

#### Remarks :

- 1. The equipment used in this calibration is traceable to recognized National Standards.
- 2. The mean value is the average of four measurements.
- 3. For calibration: Reference SPL are 94, 104 & 114dB, range setting is 20-140dB & time weighting is fast
- 4. The UUT does comply with EN 61672-1: 2003 Class 1 sound level meter for the above measurement.
- 5 The values given in this Calibration Certificate only relate to unit under test and the values measured at the time of the test. Any uncertainties will not include allowance for the equipment long term drift, variations with environment changes, vibration and shock during tranportation, overloading, mis-handling or the capability of any other laboratory to repeat the measurement.

Checked by :	Cound	_ Date : _	3-9-2021	_ Certified by : _	KitJoung	_ Date : _	4-9-2021
CA-R-297 (22/07/20	09)			Leung k	(wok Tai (Assista	nt Manager)	
			** 🗖	nd of Report **			

\*\* End of Report \*\*

The copyright of this report is owned by Fugro Technical Services Limited. This report shall not be reproduced except in full.



Page 1 of 1

Fugro Development Centre 5 Lok Yi Street, Tai Lam Tuen Mun, NT Hong Kong

Report no.: 212769CA211663

## CALIBRATION CERTIFICATE OF SOUND CALIBRATOR

Client : Fugro Technical Services Ltd.

**Project : Calibration Services** 

#### **Client Supplied Information**

#### Details of Unit Under Test, UUT

Description		:	Sound Calibrator
Manufacturer		:	Casella (Model CEL-120/1)
Serial No.		:	2383886
Equipment ID		:	N/A
Next Calibration Date	;	15	-Jul-2022
Specification Limit	1	EN	60942: 2003 Class 1

#### Laboratory Information

#### **Details of Calibration Equipment**

Description :	Reference Sound level meter				
Equipment ID. :	R-119-2				
Date of Calibration :	16-Jul-2021				
Calibration Location :	Calibration Laboratory of FTS	Ambient Temperature : 20±2 °C			
Method Used :	By direct comparison	Relative Humidity : <80% R.H.			

#### **Calibration Results :**

Parameters (Setting of UUT)	Mean Value (error of measurement)	Specification Limit(dB)
94dB	0.3 dB	10.440
114dB	0.4 dB	±0.4dB

#### Remarks :

- 1. The equipment used in this calibration is traceable to recognized National Standards.
- 2. The mean value is the average of four measurements.
- 3. The expanded uncertainty is 0.3 dB with a coverage factor of 2 at a confidence level of 95%.
- 4. The unit under test complies with the specification limit.
- 5. The values given in this Calibration Certificate only relate to the unit-under-test and the values measured at the time of the test. Any uncertainties quoted will not include allowances for the environmental changes, variation and shock during transportation, or the capability of any other laboratory to repeat the measurement.

Checked by :	Cenny	Date :_	20-7-202	Certified by :_	F J. Joung	2 Date : 20-7-202	1
CA-R-297 (22/07/2	009)			Leung	g Kwok Tai (Assis	tant Manager)	

\*\* End of Report \*\*



Page 1 of 1

Report no.: 203258CA211142(1)

# **CALIBRATION CERTIFICATE OF SOUND CALIBRATOR**

Client : Fugro Technical Services Ltd.

Project : Calibration Services

## **Client Supplied Information**

#### Details of Unit Under Test, UUT

Description		:	Sound Calibrator
Manufacturer		:	Casella (Model CEL-120/1)
Serial No.		:	3321858
Equipment ID		: .	N/A
Next Calibration Date	:	27-	-May-2022
Specification Limit	:	EN	60942: 2003 Class 1

## Laboratory Information

## **Details of Calibration Equipment**

Description :	Reference Sound level meter
Equipment ID. :	R-119-2
Date of Calibration :	28-May-2021
Calibration Location :	Calibration Laboratory of FTS
Method Used :	By direct comparison

Ambient Temperature : 20±2 °C Relative Humidity : <80% R.H.

#### **Calibration Results :**

Parameters (Setting of UUT)	Mean Value (error of measurement)	Specification Limit(dB)
94dB	-0.2 dB	10.4dB
114dB	-0.2 dB	±0.4dB

#### **Remarks**:

- 1. The equipment used in this calibration is traceable to recognized National Standards.
- 2. The mean value is the average of four measurements.
- 3. The unit under test complies with the specification limit.
- 4. The values given in this Calibration Certificate only relate to the unit-under-test and the values measured at the time of the test. Any uncertainties quoted will not include allowances for the environmental changes, variation and shock during transportation, or the capability of any other laboratory to repeat the measurement.

Checked by :	_ Date : 1-6-2021	_ Certified by :_	C.J. Jama	_ Date : <u>(~ 6 - 70 M</u> _	
CA-R-297 (22/07/2009)		Leung	Kwok Tai (Assis	tant Manager)	
	**	End of Report *	*		

The copyright of this report is owned by Fugro Technical Services Limited. This report shall not be reproduced except in full. **T** +852 2450 8233 | **F** +852 2450 6138 | **E** matlab@fugro.com | **W** fugro.com



Page 1 of 1

Report no.: 212769CA211553(1)

# CALIBRATION CERTIFICATE OF SOUND CALIBRATOR

Client : Fugro Technical Services Ltd. Project : Calibration Services

## **Client Supplied Information**

Details of Unit Under Test, UUT

Description		:	Sound Calibrator
Manufacturer		:	Casella (Model CEL-120/1)
Serial No.		:	5230950
Equipment ID		:	N/A
Next Calibration Date	1	05-	Jul-2022
Specification Limit	:	EN	60942: 2003 Class 1
Equipment ID Next Calibration Date	:	: 05-,	N/A Jul-2022

#### Laboratory Information

Details of Calibration Equipment

Description	:	Reference Sound level meter
Equipment ID.	:	R-119-2
Date of Calibration	:	06-Jul-2021
Calibration Location	ו :	Calibration Laboratory of FTS
Method Used	:	By direct comparison

Ambient Temperature : 20±2 °C Relative Humidity : <80% R.H.

#### Calibration Results :

Parameters (Setting of UUT)	Mean Value (error of measurement)	Specification Limit(dB)
94dB	-0.4 dB	±0.4dB
114dB	-0.3 dB	±0.40B

#### Remarks :

- 1. The equipment used in this calibration is traceable to recognized National Standards.
- 2. The mean value is the average of four measurements.
- 3. The unit under test complies with the specification limit.
- 4. The values given in this Calibration Certificate only relate to the unit-under-test and the values measured at the time of the test. Any uncertainties quoted will not include allowances for the environmental changes, variation and shock during transportation, or the capability of any other laboratory to repeat the measurement.

Checked by :	Lilliam Date: 7-7-2021	_ Certified by :_	KJ. Jeung Date: 7-7-2071	_
CA-R-297 (22/07/2009)		Leung	g Kwok Tai (Assistant Manager)	
	**	End of Report *	**	



Report No. : 212769CA211145

Page 1 of 1

# CALIBRATION CERTIFICATE OF ANEMOMETER

#### **Client Supplied Information**

Client : Fugro Technical Services Limited

Project : Calibration Services

Details of Unit Under Test, UUT

Description	•	Anemometer
-------------	---	------------

Manufacturer	•	SENSOR

Model No. : AR816

Serial No. : 2136513

Equipment ID.: NA

Next Calibration Date : 30-May-2022

#### Laboratory Information

Details of Reference Equipment -

Description :	Reference Anemometer			
Equipment ID.:	R-101-4			
Date of Calibration :	31-May-2021	Ambient Temperature	:	22 °C
Calibration Location :	Calibration Laboratory o	f FTS		
Method Used : In-hou	use Method R-C-279			

#### Calibration Results :

Reference Reading	UUT Reading	Error
(m/s)	(m/s)	(m/s)
1.99	2.0	0.0
4.00	4.3	0.3
6.01	6.3	0.3
7.99	8.2	0.2
10.03	9.9	-0.1

#### Remark :

1. The equipment being used in this calibration is traceable to recognized National Standards.

- 2. The reported readings in this calibration are an average from 10 trials.
- 3. The expanded uncertainty is 0.5 m/s with a coverage factor of 2 at a confidence level of 95%.

Checked by :	Lilliam	Date : 2-	6-2021		1		2-6-2024
CA-R-297 (22/07/200	9)			Leu	ng Kwok Tai (Assi	stant Man	ager)

\*\* End of Report \*\*

Appendix 4-2

Noise Impact Monitoring Results

#### Project No. 1825

Monthly Environmental Monitoring & Audit Report for Port Shelter Phase 3, Po Toi O Sewerage Treatment Plant

#### Appendix 4-2 : Noise Monitoring Data Month <u>2021/10</u>

10000000 <u>2021/</u>

Monitoring Location :		NMS1N		
Date	Leq30min dB(A)*	L10 dB(A)	L90 dB(A)	Limit Level dB(A)
2021-10-05	58.1	60.0	53.5	75
2021-10-11	71.4	75.5	67.5	75
2021-10-21	61.1	63.0	58.0	75
2021-10-27	68.9	73.5	65.0	75
Average :		67.7		
Action Level :	When or	ne valid documented complaint is re	eceived	
Limit Level :		75.0 dB(A)		
* Remark: For Free-field	measurement, a correction of +3dB(A	A) should be made to the measured	results.	

#### Monitoring Location : Start Date & Time 2021-10-05 NMS2N1 Leq30min dB(A)\* 55.4 L90 dB(A) 51.5 L10 dB(A) Limit Level dB(A) 57.5 75 2021-10-11 67.9 71.0 64.5 75 2021-10-21 2021-10-27 64.5 68.5 64.2 62.1 59.0 75 63.8 61.0 75 Average : Action Level : When one valid documented complaint is received Limit Level : 75.0 dB(A) \* Remark: For Free-field measurement, a correction of +3dB(A) should be made to the measured results.


2021-10-05         61.6         64.0         56.5         75           2021-10-11         65.8         68.5         61.5         75           2021-10-21         65.9         69.5         60.5         75           2021-10-27         67.8         71.0         63.5         75           Average :         65.8         65.8         65.8         65.5         75	onitoring Location :		NMS3N		<u>.</u>
2021-10-11         65.8         68.5         61.5         75           2021-10-21         65.9         69.5         60.5         75           2021-10-27         67.8         71.0         63.5         75           Average :	Start Date & Time	Leq30min dB(A)*	L10 dB(A)	L90 dB(A)	Limit Level dB(A
2021-10-21         65.9         69.5         60.5         75           2021-10-27         67.8         71.0         63.5         75           Average :         55.8         55.8         55           Action Level :         When one valid documented complaint is received         55.8	2021-10-05	61.6	64.0	56.5	75
2021-10-27         67.8         71.0         63.5         75           Average :         65.8         63.5         75           Action Level :         When one valid documented complaint is received         65.8	2021-10-11	65.8	68.5	61.5	75
Average :         65.8           Action Level :         When one valid documented complaint is received	2021-10-21	65.9	69.5	60.5	75
Action Level : When one valid documented complaint is received	2021-10-27	67.8	71.0	63.5	75
	Average :		65.8		
	Action Level :	When o	ne valid documented complaint is re	eceived	
Limit Level : 75.0 dB(A)	Limit Level :		75.0 dB(A)		

Start Date & Time	Leg30min dB(A)*	L10 dB(A)	L90 dB(A)	Limit Level dB(A)
2021-10-05	56.4	59.5	49.5	75
2021-10-11	60.8	63.5	57.5	75
2021-10-21	54.7	58.5	49.0	75
2021-10-27	57.2	62.0	52.5	75
Average :		57.9	•	
Action Level :	When o	ne valid documented complaint is re	eceived	
Limit Level :		75.0 dB(A)		

## Appendix 4-2 - Nosie Monitoring Data Chart

## Monitoring Station: NMS1N

## Leq30 minutes Impact Monitoring

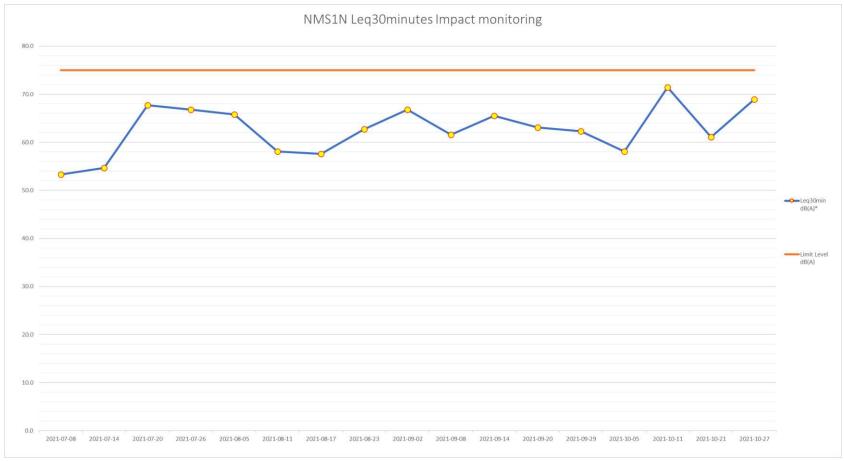


#### Allied Environmental Consultants Limited

Member of AEC Group (HKEX Stock Code: 8320.HK)

## Monitoring Station: NMS2N1

## Leq30 minutes Impact Monitoring

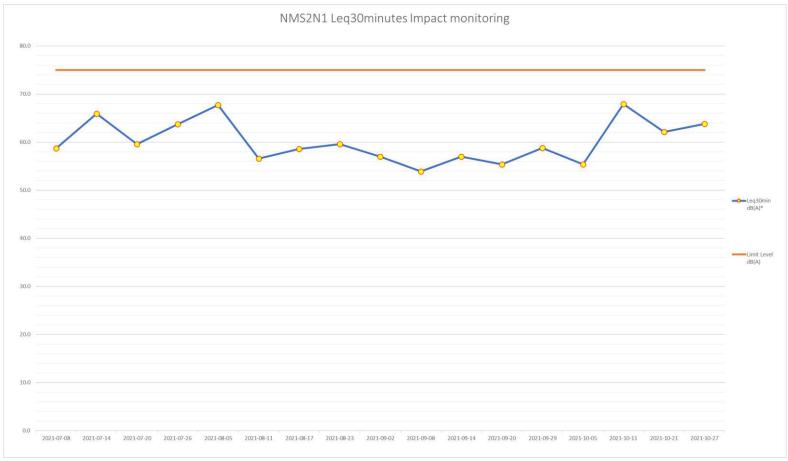


Allied Environmental Consultants Limited

Member of AEC Group (HKEX Stock Code: 8320.HK)


## Monitoring Station: NMS3N

## Leq30 minutes Impact Monitoring

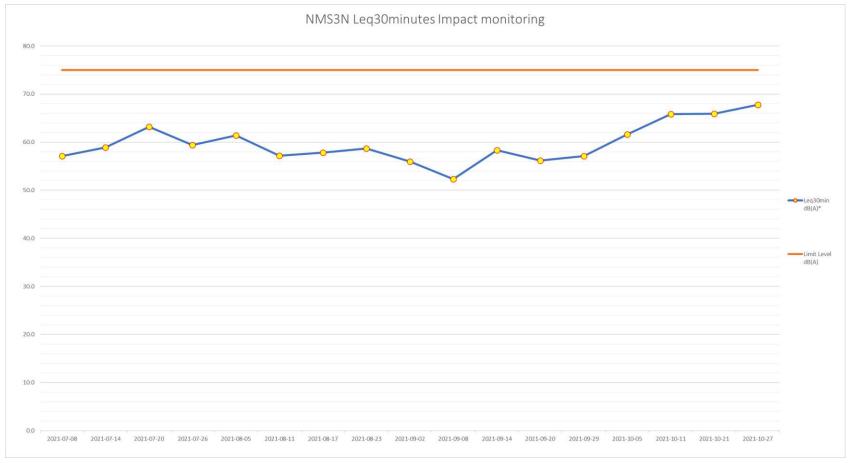

### Monitoring Station: NMS4N

### Leq30 minutes Impact Monitoring

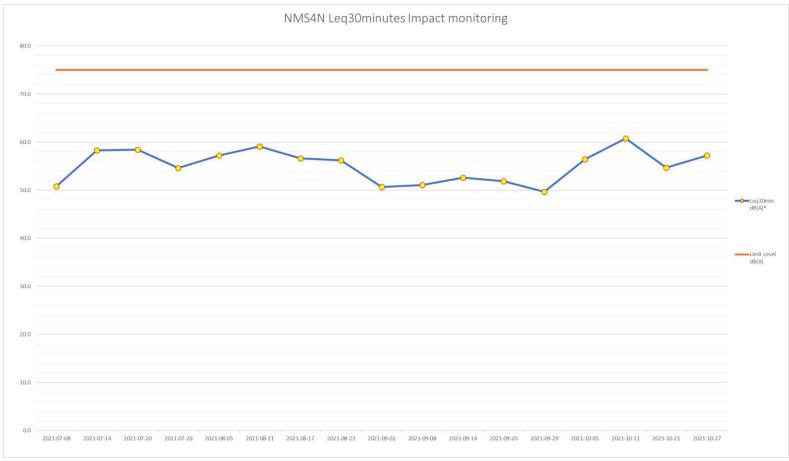

Allied Environmental Consultants Limited

Member of AEC Group (HKEX Stock Code: 8320.HK)

Appendix 4-3

Event and Action Plan for Noise Impact Monitoring

EVENT	ACTION			
	ET	IEC	ER	Contractor
Action Level	<ol> <li>Notify IEC, ER and Contractor of exceedance;</li> <li>Identify source</li> <li>Investigate the causes of exceedance and</li> <li>propose remedial measures;</li> <li>Report the results of investigation to the IEC,</li> <li>ER and Contractor;</li> <li>Discuss with the IEC, ER and Contractor and</li> <li>formulate remedial measures;</li> <li>Increase monitoring frequency to check</li> <li>mitigation effectiveness.</li> </ol>	<ol> <li>Review the analysed results submitted by the ET;</li> <li>Review the proposed remedial measures by the Contractor and advise the ER accordingly;</li> <li>Supervise the implementation of remedial measures.</li> </ol>	<ol> <li>Confirm receipt of notification</li> <li>of failure in writing;</li> <li>Notify Contractor;</li> <li>Require Contractor to propose</li> <li>remedial measures for the</li> <li>analysed noise problem;</li> <li>Ensure remedial measures are</li> <li>properly implemented</li> </ol>	<ol> <li>Submit noise mitigation proposals to ER with copy to ET and IEC;</li> <li>Implement noise mitigation proposals.</li> </ol>

Appendix 4-3 Event and Action Plan for Noise Impact Monitoring

EVENT	ACTION			
	ET	IEC	ER	CONTRACTOR
Limit Level				
Limit Level	<ul> <li>ET</li> <li>1. Inform IEC, ER, EPD and Contractor;</li> <li>2. Identify source;</li> <li>3. Repeat measurements to confirm findings;</li> <li>4. Increase monitoring frequency;</li> <li>5. Carry out analysis of Contractor's working</li> <li>procedures to determine possible mitigation to</li> <li>be implemented;</li> </ul>	<ol> <li>Discuss amongst ER, ET, and Contractor on the potential remedial actions;</li> <li>Review Contractor's remedial actions whenever necessary to assure their effectiveness and advise the ER accordingly;</li> </ol>	<ol> <li>Confirm receipt of notification of failure in writing;</li> <li>Notify Contractor;</li> <li>Require Contractor to propose remedial measures for the analysed noise problem;</li> </ol>	<ol> <li>Take immediate action to avoid further exceedance;</li> <li>Submit proposals for remedial actions to ER with copy to ET and IEC within 3 working days of notification;</li> <li>Implement the agreed proposals;</li> <li>Resubmit proposals if problem still not under</li> </ol>
	<ul> <li>6. Inform IEC, ER and EPD the causes and actions taken for the exceedances;</li> <li>7. Assess effectiveness of Contractor's remedial</li> <li>actions and keep IEC, EPD and ER informed</li> <li>of the results;</li> <li>8. If exceedance stops, cease additional monitoring.</li> </ul>		instruct the Contractor to terminate that portion of work until the exceedance ceases.	portion of works as determined by the ER until the exceedance ceases.

Appendix 6-2

Monthly Waste Flow Table

# Appendix 6-2 Monthly Summary Waste Flow Table

### Monthly Summary Waste Flow Table for <u>2021</u> (year)

Name of Department: DSD Contract No. DC 2019/09 Port Shelter Phase 3, Po Toi O Sewage Treatment Plant

		Actual Qu	antities of Iner	t C&D Materia	als Generate	d Monthly	Actual C	uantities of	C&D Wastes	Generated	Monthly
Month	Total Quantity Generated	Broken	Reused in the Contract	Reused in other Projects	Disposed as Public Fill	Imported Fill	Metals	Paper/ cardboard packaging	Plastics (see notes 3)	Chemical Waste	Others, e.g. general refuse
	(in '000m³)	(in '000m³)	(in '000m <sup>3</sup> )	(in '000m <sup>3</sup> )	(in '000m³)	(in '000m³)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	( in '000m³)
Jan											
Feb											
Mar	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Apr	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
May	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
June	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Sub-Total	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
July	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Aug	0.013	0.000	0.000	0.000	0.013	0.000	0.000	0.000	0.000	0.000	0.000
Sep	0.065	0.000	0.000	0.000	0.065	0.000	0.000	0.000	0.000	0.000	0.000
Oct	0.053	0.000	0.000	0.000	0.053	0.000	0.000	0.000	0.000	0.000	0.000
Nov											

Allied Environmental Consultants Limited

Member of AEC Group (HKEX Stock Code: 8320.HK)

		Actual Qu	antities of Iner	t C&D Materia	als Generate	d Monthly	Actual Quantities of C&D Wastes Generated Monthly				
Month	Total Quantity Generated	Hard Rock and Large Broken Concrete	Reused in the Contract	Reused in other Projects	Disposed as Public Fill	Imported Fill	Metals	Paper/ cardboard packaging	Plastics (see notes 3)	Chemical Waste	Others, e.g. general refuse
	(in '000m³)	(in '000m³)	(in '000m <sup>3</sup> )	(in '000m <sup>3</sup> )	(in '000m³)	(in '000m³)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	( in '000m³)
Dec											
Total	0.131	0.000	0.000	0.000	0.131	0.000	0.000	0.000	0.000	0.000	0.000

Notes: (1) The performance targets are given in the Environmental Management Plan.

(2) The waste flow table shall also include C&D materials to be imported for use at the Site.

(3) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging material.

Appendix 6-3

Impletementation Schedule of Recommended Mitgation Measures

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
_	ality Imp Specific							
3.8	A1	Deodourizer should have at least 99.5% hydrogen sulfide removal efficiency.	To minimize odour nuisance to sensitive receivers	DSD	Sewage Treatment Plant	Throughout operational phase	Operational phase	EIAO-TM
3.8	A2	Odourous materials (sludge, screenings and grits, worn filter) should be stored and removed in sealed tankers and containers.	To minimize odour nuisance to sensitive receivers	DSD	Sewage Treatment Plant	Throughout operational phase	Operational phase	EIAO-TM
3.8	A3	Sludge should be transferred to sludge tanker by coupling method.	To minimize odour nuisance to sensitive receivers	DSD	Sewage Treatment Plant	Throughout operational phase	Operational phase	EIAO-TM
3.8	A4	During release of pressure from the tanker, the odourous gas should be discharged into the sludge storage room for extraction to deodourization unit.	To minimize odour nuisance to sensitive receivers	DSD	Sewage Treatment Plant	Throughout operational phase	Operational phase	EIAO-TM
3.8	A5	Regular inspection should be conducted to check for leakage of odourous gas	To minimize odour nuisance to sensitive receivers	DSD	Sewage Treatment Plant	Throughout operational phase	Operational phase	EIAO-TM
3.8	A6	Maintain the removal efficiency of screenings and grits by flushing the screens and grit sump regularly to prevent build up of solids	To maintain the removal efficiency of screenings and grits	DSD	Sewage Treatment Plant	Throughout operational phase	Operational phase	EIAO-TM
3.8	A7	Maintain the efficiency of MBR membrane by removing organic and inorganic debris regularly	To maintain the efficiency of MBR membrane	DSD	Sewage Treatment Plant	Throughout operational phase	Operational phase	EIAO-TM
3.8	A8	Replace worn filter to maintain the odour removal efficiency at 99.5%	To minimize odour nuisance to sensitive receivers	DSD	Sewage Treatment Plant	Throughout operational phase	Operational phase	EIAO-TM
3.8	A9	Clean all the tanks with water regularly	To minimize odour nuisance to sensitive receivers	DSD	Sewage Treatment Plant	Throughout operational phase	Operational phase	EIAO-TM
Generi	c/Standaro	d Measures	Π				1	
3.8	A10	Good housekeeping to minimize dust generation, e.g. by properly handling and storing dusty materials	To minimize dust generation	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A11	Adopt dust control measures, such as dust suppression using water spray on exposed soil (at least 4 times per day), in areas with dusty construction activities and during material handling	To minimize dust generation due to erosion	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
3.8	A12	Store cement bags in shelter with 3 sides and the top covered by impervious materials if the stack exceeds 20 bags	To prevent leakage of cement	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A13	Maintain a reasonable height when dropping excavated materials to limit dust generation	To minimize dust generation during movement of excavated materials	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A14	Limit vehicle speed within construction site and in Po Toi O to 10km/hr and confine vehicle movement in haul road	To minimize dust generation due to traffic movement	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A15	Minimize exposed earth after completion of work in a certain area by hydroseeding, vegetating, soil compacting or covering with bitumen	To minimize dust generation due to erosion	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A16	Provide wheel washing at construction site exit to clean the vehicle body and wheel	To prevent dust from being brought offsite	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A17	Cover materials on trucks before leaving the construction site to prevent debris from dropping during traffic movement or being blown away by wind	To prevent falling of debris during traffic movement and by wind	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A18	Regular maintenance of plant equipment to prevent black smoke emission	To minimize black smoke emission	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A19	Throttle down or switch off unused machines or machine in intermittent use	To minimize unncessary emission	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A20	Minimize excavation area as far as possible	To minimize dust emission and potential release of odour from exposed ground	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A21	Store odourous excavated materials in covered containers and remove off-site as soon as possible within 24 hours	To minimize odour nuisance to sensitive receivers	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A22	Cover open stockpiles of construction materials (e.g. aggregates, sand and fill materials) with impermeable materials such as tarpaulin during rainstorms.	To prevent soil erosion under rainstorm	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO
3.8	A23	Hoarding of not less than 2.4 m high shall be erected from ground level to surround the construction site for sewage treatment plant along Po Toi O Chuen Road except for a construction site entrance or exit	To minimize dust emission	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
3.8	A24	Carry out air quality monitoring throughout the construction period	To monitor construction dust level	DSD's Contractor	At representative ASRs	Prior to and throughout construction phase	Construction phase	EIAO-TM
3.8	A25	Carry out regular site inspection to audit the implementation of mitigation measures	To check the implemenation status and effectiveness of mitigation measures	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM, APCO

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
	Impact							
4.7	N1	Veasures Use hand-held plant equipment or manual equipment within village area	To minimize construction noise level	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N2	For HDD, enclose the stationary plant equipment on three sides with cover. Only the side facing the sea shall be opened for heat exhaustion.	To lower noise transmission	DSD's Contractor	HDD work site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N3	Generator should be placed at a fixed location at least 5-6m away from the NSRs and screened by noise barrier whenever excavation work has to be carried out at their front doors	To lower noise transmission	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7		Avoid carrying out noisy activities at the same time. The work front of village sewer installation near NSRs PTO_N1 and PTO_N3 shall not be conducted concurrently with installation of Po Toi O Chuen Road sewer and horizontal directional drilling respectively.	To mimize noise production	DSD's Contractor	Whole construction site	When the respective workfront next to the NSR is carried out	Construction phase	NCO, EIAO-TM
4.7		Vibratory poker shall only be operated 4m away from NSR and with noise barrier properly erected. Surfacing work within 4m from NSR shall be carried out by manual method.	To mimize noise production	DSD's Contractor	Whole construction site	When the respective workfront next to the NSR is carried out	Construction phase	NCO, EIAO-TM
Generi	c/Standard	1 Measures						
4.7	N6	Schedule noisy activities to minimise exposure of nearby NSRs to high levels of construction noise	To minimize construction noise level	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N7	Use Quality Powered Mechanical Equipment (QPME) which produces lower noise level	To minimize construction noise level	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N8	Erect 3m high mobile barriers with skid footing and a small cantilevered upper portion within a few metres of stationary plants and within about 5m of more mobile plant.	To lower noise transmission	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
4.7		Hand-held breaker shall be fitted with mufflers. A movable enclosure made up of plywood is proposed to surround both worker and breaker during breaking process. The internal wall of the enclosure should be laid with sound absorbent such as mineral wool.	To lower noise transmission	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N10	Regular maintenance of plant equipment to prevent noise emission due to impair	To prevent noise emission due to impair	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N11	Position mobile noisy equipment in location and direction away from NSR	To minimize noise transmission to NSR	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N12	Use silencer or muffler on plant equipment and should be properly maintained	To minimize noise transmission	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N13	Throttle down or switch off unused machines or machine in intermittent use between work	To mimize noise production	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N14	Make good use of stockpiles or other structures for noise screening	To minimize noise transmission	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N15	Mobile plant should be sited as far away from NSRs as possible	To minimize noise transmission	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N16	Reduce the percentage on-time for some noisy PMEs	To mimize noise production	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	NCO, EIAO-TM
4.7	N17	Carry out noise monitoring	To monitor construction noise level	DSD's Contractor	At representative NSRs	Prior to and throughout construction phase	Construction phase	EIAO-TM

Annex A - Implementation Schedule of Recommended Mitigation Measures

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
	Quality 1							
Project	t Specific I	Measures		1	1	1	I	<b>F</b>
5.8	W1	Divert the water from outfall of W3 (stream near Fairway Vista) during open cut excavation for laying of gravity sewer nearby.	To prevent the excavated materials from falling into the water and being carried into the sea	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM
5.8	W2	Place sandbag along the upstream section of the stream near Fairway Vista and along rocky shore during open cut excavation for laying of gravity sewers/rising mains nearby.	To prevent the excavated materials from falling into the water and being carried into the sea	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W3	Intercept the water from u-channel at the foot of the slope where the STP will be built	To prevent water from entering the construction site	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
6.8	W4	Install cofferdam around the proposed excavation area for entry pit of HDD work to prevent falling of debris into the sea	To prevent debris from entering the waterbodies	DSD's Contractor	HDD work site	Throughout construction phase	Construction phase	EIAO-TM
5.8	W5	Install sheet piles in marine waters by vibratory action.	To minimize dispersion of marine sediment	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM
5.8	W6	Marine works (dredging, construction and installation works at diffuser location, backfilling) shall be carried out inside the watertight cofferdam. The cofferdam can only be removed after completion of work.	To minimize dispersion of marine sediment	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM
5.8	W7	Dredging should be carried out by grab dredgers anchored outside the cofferdam. The marine sediment should be placed in sealed compartment of the marine barge.	To minimize dispersion of marine sediment	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM
5.8	W8	Water removed from the cofferdam should be desilted before discharge back into the sea.	To prevent discharge of silty water into the sea	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM
5.8	W9	Carry out water quality monitoring at water sensitive receivers before and during cofferdam installation works, throughout dredging works, and during cofferdam extraction works	To identify any water quality impact due to construction works	DSD's Contractor	Water Monitoirng Stations	Before and throughout installation and extraction works of cofferdam	Construction phase	EIAO-TM

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
5.8	W10	<ul> <li>The following summarizes the precautionary measures for minimizing chance of emergency discharge:</li> <li>Provision of dual power by CLP;</li> <li>Equipped with Supervisory control and data acquisition system (SCADA), which signals to the operation and maintenance personnel for emergency attendance in case of plant failure;</li> <li>Provision of standby pump and screen at the PTOSTW.</li> <li>Provision of emergency generator within 4 hours by DSD's future term contractor.</li> <li>Provision of emergency storage with capacity of 4-hr sewage retention time.</li> <li>Arrangement of tankers for removing incoming sewage to other sewage treatment plants for treatment.</li> </ul>	To prevent emergency discharge	DSD	Sewage Treatment Plant	Operational phase	Operational phase	EIAO-TM
5.8	W11	Carry out water quality monitoring at water sensitive receivers during normal operation	To identify any water quality impact due to the normal operation of the Sewage Treatment Plant (STP)	DSD	At representative WSRs	6 months before and in 1st year of operation	Operational phase	WPCO, EIAO-TM
Generi	c/Standard	1 Measures						
5.8	W12	Set up sedimentation tank for settling suspended solids in wastewater before discharge into storm drains. Sand/silt removal facilities such as sand traps, silt traps and sedimentation basin should be provided with adequate capacity.	To reduce the amount of suspended solid in wastewater	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W13	Follow ProPECC PN 1/94 "Construction Site Drainage" as far as practicable	To minimize surface runoff and chance of erosion	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W14	Construct catchpits and perimeter channels prior to commencement of site formation works and earthworks.	To stop runoff from flowing across the construction site	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W15	Maintain silt removal facilities, channels, manholes before and after rainstorm.	To prevent failure that may lead to flooding	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
5.8	W16	Remove silt and grit from silt trap at regular interval.	To prevent blockage the may lead to flooding	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W17	Well design works program to minimize the work areas to minimize the soil exposure and site runoff.	To minimize surface runoff and chance of erosion	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W18	<ul> <li>Arrange soil excavation works outside rainy seasons (April to September) as far as possible. If this cannot be achieved, the following measures should be implemented:</li> <li>Cover temporary exposed slope surfaces with impermeable materials, e.g. tarpaulin</li> <li>Protect temporary access roads by crushed stone or gravel</li> <li>Provide intercepting channels along crest/edge of excavation</li> <li>Carry out adequate surface protection measures well before the arrival of a rainstorm</li> </ul>	To minimize surface runoff and chance of erosion	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W19	Minimize exposed earth after completion of work in a certain area by hydroseeding, vegetating, soil compacting or covering with bitumen	To prevent soil erosion under rainstorm	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W20	Prevent rainwater from entering trenches. Excavation of trenches should be dug and backfilled in short sections during rainy seasons. Remove silt in rainwater collected from the trenches or foundation excavations prior to discharge to storm drains.	To prevent soil erosion under rainstorm	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W21	Cover open stockpiles of construction materials (e.g. aggregates, sand and fill materials) with impermeable materials such as tarpaulin during rainstorms.	To prevent soil erosion under rainstorm	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W22	Cover and temporary seal manholes to prevent silt, construction materials or debris and surface runoff from entering foul sewers.	To prevent overloading of foul sewers	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W23	Remove waste from the construction site regularly.	To prevent waste accumulation	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
5.8	W24	Apply discharge license for effluent discharge. Treat the discharge to comply with the requirement in TM-DSS.	To ensure compliance with effluent discharge requirement	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	WPCO, TM-DSS, EIAO- TM

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
5.8	W25	Reuse treated effluent onsite, e.g. dust suppression, wheel washing and general cleaning.	To minimize wastewater generation	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM
5.8	W26	Monitor effluent water quality.	To ensure compliance with effluent discharge requirement	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	WPCO, EIAO-TM
5.8	W27	Register as chemical waste producer if chemical waste will be generated.	To control chemical waste	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal (Chemical Waste) (General) Regulation, EIAO-TM
5.8	W28	Perform maintenance of vehicles and equipment that have oil leakage and spillage potential on hard standings within a bunded area with sumps and oil interceptors.	To prevent oil leakage or spillage	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal (Chemical Waste) (General) Regulation, EIAO-TM
5.8	W29	Dispose chemical waste in accordance to Waste Disposal Ordinance. Follow the <i>Code of Practice on the Packaging,</i> <i>Labelling and Storage of Chemical Wastes</i> , examples as follows: - Store chemical wastes with suitable containers to avoid leakage or spillage during storage, handling and transport - Label chemical waste containers according to the CoP to notify and warn the waste handlers - Store chemical wastes at designated safe location with adequate space	To avoid accident in waste storage and handling	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM
5.8	W30	Provide sufficient chemical toilets with regular maintenance by registered waste collector where necessary	To proper collection of task force waste	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM
5.8	W31	Provide a drip tray/container underneath the bentonite recycling system	To prevent any leaked bentonite from entering the watercourse or sea	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM
5.8	W32	Carry out regular site inspection to audit the implementation of mitigation measures	To check the implemenation status and effectiveness of mitigation measures	DSD's Contractor	Water Monitoirng Stations	Throughout construction phase	Construction phase	EIAO-TM, APCO
5.8	W33	Carry out effluent quality monitoring at location specified in the discharge licence	To ensure compliance with effluent discharge requirement	DSD	Effluent outlet	Operational phase	Operational phase	WPCO, EIAO-TM

EIA Ref.	Kei.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines		
	trial Ecol									
Project	Specific 1	Measures Erect bright colour fencing along the boundary of the								
6.12	E1	undisturbed region of the shrubland and woodland, and around <i>Diospyros vaccinioides</i> , a plant species of conservation importance, near the work boundary to remind workers not to trespass or occupy the area, and to be careful during operation of equipment.	To protect the shrub from being damaged	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM		
6.12	E2	Reinstate the disturbed rocky shore with the rocks temporarily removed	To restore the rocky shore habitat	DSD's Contractor	Whole construction site	After completion of works near the rocky shore	Construction phase	EIAO-TM		
6.12	E3	Place sandbag around the section of W3 next to Fairway Vista and along the shore during open cut excavation for laying of gravity sewer nearby.	To prevent the excavated materials from falling into the water and being carried into the sea	DSD's Contractor	Watercourse W3	When construction work is carried out in the vicinity of W3	Construction phase	EIAO-TM		
6.12	E4	Temporarily divert the water from outfall of W3 away from excavation area.	To prevent the excavated materials from falling into the water and being carried into the sea	DSD's Contractor	Watercourse W3	When construction work is carried out in the vicinity of W3	Construction phase	EIAO-TM		
6.12	ES	Inspect the condition of the <i>Diospyros vaccinioides</i> near the work boundary as part of weekly site audit	To inspect the condition of the Diospyros vaccinioides	DSD's Contractor	The <i>Diospyros</i> <i>vaccinioides</i> near the work boundary	Throughout construction phase	Construction phase	EIAO-TM		
Generic	eneric/Standard Measures									
6.12	E6	Erection of hoarding, fencing or provision of clear demarcation of work zones	To remind workers not to damage area outside the work boundary	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM		
6.12	E7	Designate areas for placement of equipment, building materials and wastes away from the natural environment	To prevent damage on the natural environment	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM		

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
6.12	нх	Carry out tree preservation and compensatory tree planting will be carried out in accordance with DEVB TCW No. 7/2015.	To reinstated woodland habitat	DSD's Contractor	Whole construction site	After completion of works near woodland	Construction phase	EIAO-TM

Annex A - Implementation Schedule of Recommended Mitigation Measures

EIA Ref.	Kef.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
	Manager							
Project	Specific	vieasures				[	[	
9.8		Sludge will be delivered by sealed sludge tanker for treatment at Sludge Treatment Facilities.	To prevent odour nuisance	DSD	STP	Throughout operational phase	Operational phase	Waste Disposal (Chemical Waste) (General) Regulation, EIAO-TM
9.8	WM2	Debris from screening process and general refuse should be stored within the STP in sealed container and be disposed of at landfill regularly.	To prevent odour nuisance	DSD	STP	Throughout operational phase	Operational phase	Waste Disposal (Chemical Waste) (General) Regulation, EIAO-TM
9.8		Worn filters and MBR membrane shall be stored and labelled as in construction phase. Chemical wastes shall be treated at chemical treatment facility by licensed contractor.	To prevent odour nuisance	DSD	STP	Throughout operational phase	Operational phase	Waste Disposal Ordinance, EIAO-TM
Generi	c/Standard	1 Measures						
9.8	WM4	Allocate an area for waste sorting and storage of C&D materials into the following categories for reuse, recycle or disposal if possible. Remove waste from the construction site for sorting once generated if no suitable space can be identified. - excavated materials suitable for reuse - inert C&D materials (or public fill) for disposal offsite - non-inert C&D materials (or C&D waste) for disposal at landfills - chemical waste - bentonite slurry for reconditioning and reuse - general refuse	To minimize waste generation	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
9.8	WM5	Adopt good site practice as follows: - Provide training to workers on site cleanliness, waste management (waste reduction, reuse and recycle) and chemical handling procedures - Provide sufficient waste collection points and regular removal	To proper handling of waste	DSD's Contractor	Whole construction site	Throughout	Construction phase	Waste Disposal Ordinance, EIAO-TM
	- - - - - -	<ul> <li>Cover waste materials with tarpaulin or in enclosure during transportation</li> <li>Maintain drainage systems, sumps and oil interceptors</li> <li>Sort out chemical waste for proper handling and treatment onsite or offsite</li> </ul>	-		sic	phase	Ĩ	
9.8	WM6	Adopt waste reduction measures as follows: - Allocate area/containers for sorting, recovering and storing waste for reuse, recycle or disposal (e.g. demolition debris and excavated materials, general refuse like aluminium cans.) Remove waste from the construction site for sorting once generated if no suitable space can be identified.	To minimize waste generation	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM
		<ul> <li>Allocate area for proper storage of construction materials to prevent contamination</li> <li>Minimize wastage through careful planning and avoiding over- purchase of construction materials</li> </ul>						
9.8	WM7	Prepare and implement a site specific Waste Management Plan (WMP) as part of Environmental Management Plan (EMP) in accordance with ETWB TCW No. 19/2005. Detail waste management method in the form of avoidance, reuse, recovery, recycling, storage, collection, treatment and disposal according to the recommendations on the EIA and EM&A Manual. It should be approved by the ER and regularly reviewed.	To provide guidance to waste management	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ETWB TCW No. 19/2005, EIAO-TM

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
		Store waste materials properly as follows: - Avoid contamination by proper handling and storing waste		DSD's	Whole	Throughout	Construction	ProPECC PN 1/94, EIAO-
9.8	WM8	<ul> <li>Prevent erosion by covering waste</li> <li>Apply water spray on excavated materials</li> <li>Maintain and clean storage area regularly</li> <li>Sort and stockpile different materials at designated location to enhance reuse</li> </ul>	To properly store waste	Contractor	construction site	construction phase	phase	TM
9.8	WM9	Apply for relevant waste disposal permits in accordance with the Waste Disposal Ordinance (Cap. 354), Waste Disposal (Charges for Disposal of Construction Waste) Regulation (Cap. 345) and the Land (Miscellaneous Provisions) Ordinance (Cap. 28), Dumping at Sea Ordinance (Cap. 466).	To properly dispose waste	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance (Cap. 354), Waste Disposal (Charges for Disposal of Construction Waste) Regulation (Cap. 345) and the Land (Miscellaneous Provisions) Ordinance (Cap. 28), Dumping at Sea Ordinance (Cap. 466), EIAO-TM
9.8	WM10	Hire licensed waste disposal contractors for waste collection and removal. Dispose waste at licensed waste disposal facilities	To properly dispose waste	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM
9.8	WM11	Implement trip-ticket system for recording the amount of waste generated, recycled and disposed, including chemical wastes	To monitor movement of waste	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal (Chemical Waste) (General) Regulation, Waste Disposal Ordinance, EIAO-TM
9.8	WM12	Provide wheel washing at construction site exit to clean the vehicle body and wheel	To prevent dust from being brought offsite	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	ProPECC PN 1/94, EIAO- TM
9.8		Reduce water content in wet spoil generated from piling work by mixing with dry materials. Only dispose treated spoil with less than 25% dry density to Public Fill Reception Facilities	To minimize load to reception facilities	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
9.8	WM14	Dispose dry waste or waste with less than 70% water content by weight to landfill	To minimize load to reception facilities	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM
9.8	WM15	Follow the <i>Code of Practice on the Packaging, Labelling and</i> <i>Storage of Chemical Waste</i> as follows: - Store chemical wastes with suitable containers. Seal and maintain the container to avoid leakage or spillage during storage, handling and transport - Label chemical waste containers in both English and Chinese with instructions in accordance to Schedule 2 of the Waste Disposal (Chemical Waste) (General) Regulation	To avoid accident in waste storage and handling	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM
9.8	WM16	<ul> <li>The container capacity should be smaller than 450 litres unless agreed by the EPD</li> <li>Comply with the requirement of the chemical storage area:</li> <li>Store only chemical waste and label clearly the chemical characters of the waste</li> <li>Have at least 3 sides enclosed and protected from rainfall with cover</li> <li>Provide sufficient ventilation</li> <li>Have impermeable floor and has bunds to contain 110% of the capacity of the largest container or 20% of the total volume of the stored waste in the area, whichever is larger</li> <li>Adequately spaced incompatible materials</li> </ul>	To ensure proper storage of chemical waste	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM
9.8		Transfer used lubricants, waste oils and other chemicals to oil recycling companies, if possible, and empty oil drums for reuse or refill. No direct or indirect discharge is permitted	To ensure proper disposal of chemical waste	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal (Chemical Waste) (General) Regulation, EIAO-TM
9.8	WM18	Hire licensed chemical waste disposal contractors for waste collection and removal. Dispose chemical waste at the approved Chemical Waste Treatment Centre at Tsing Yi or other licensed facility	To ensure proper disposal of chemical waste	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal (Chemical Waste) (General) Regulation, EIAO-TM
9.8	WM19	Hire reputable waste collector to separately collect and dispose general refuse from other wastes. Cover the waste to prevent being blown away	To ensure proper disposal of general refuse	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal (Chemical Waste) (General) Regulation, EIAO-TM

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
9.8		Provide recycling bins for sorting out recyclables for collection by recycling companies. Non-recyclables should be removed to designated landfills every day by licensed collectors to prevent environmental and health nuisance.	To ensure proper recycling and disposal of general refuse	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	Waste Disposal Ordinance, EIAO-TM
9.8		Organize training and reminders to site staff on waste minimization through avoidance and reduction, reusing and recycling	To ensure proper management of general refuse	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM
9.8		Used bentonite shall be reconditioned onsite and reused as far as practical to minimize wastage. If this is deemed not viable, the used bentonite shall be delivered offsite for reconditioning.	To minimize wastage of bentonite	DSD's Contractor	Whole construction site	Throughout construction phase	Construction phase	EIAO-TM
9.8	WM23	Characterize the sediment quality of the marine sediment to be dredged and submit a Sediment Quality Report for EPD's approval. Dispose the dredged marine sediment in accordance with ETWB TC(W) No. 34/2002	To verify the categories of sediment to be disposed in accordance with ETWB TC(W) No. 34/2002	DSD's Contractor	To be allocated by CEDD	Before dredging works	Construction phase	ETWB TC(W) No. 34/2002

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
	cape & Vi							
Table	CM8	Protective materials to be provided to natural rocky coastline to prevent damage to existing landform from plant and machinery during temporary drilling operations. Reinstatement following removal of plant & equipment to original or improved condition shall be undertaken.	To protect landscape resources		Temporary drilling site for submarine outfall	Construction planning and during construction period	Construction phase	Particular Specification
Table 10-7	OM1	Sensitive design of sewage treatment plant in terms of scale, height and bulk (visual weight) to integrate the building into the existing topography.	To mitigate visual impact	DSD's Design Architect/ Engineer	STP	Design Phase	Design Phase	Detailed Design Drawings and Specifications
				DSD's Design Architect/ Engineer		Design Phase		
Table 10-7	OM2	Use of appropriate building materials and colours for Sewage Treatment Plant to complement surroundings	To mitigate visual impacts	DSD's contractor	STP	Construction Phase & first year in Operational Phase	Design, Construction and Operational Phases	Detailed Design Drawings and Specifications
Canari	o/Stondon	Measures		Building Operator/DSD		Operational phase		
Generi	c/Standard	1 Measures			STP, along			
Table 10-6	CM1	The construction area and contractor's temporary works areas should be minimised to avoid impacts on adjacent landscape. All slope excavation shall take place from within the work boundary to minimise impacts on adjacent slopes.	To avoid impact on adjacent landscape areas	DSD's contractor	gravity sewers and rising mains construction route and at temporary drilling site for submarine outfall	Construction planning and during construction period	Construction phase	Detailed Design drawings and particular specifications
Table 10-6	CM2	Reduction of construction period to practical minimum	To minimise duration of impact	DSD's contractor	N/A	Construction planning and during construction period	Construction phase	N/A

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
Table 10-6	CM3	Construction traffic (land and sea) including construction plant, construction vessels and barges to be kept to a practical minimum.	To minimize visual impacts to local residents and surrounding VSRs	DSD's contractor	STP, along gravity sewers and rising mains construction route at temporary drilling and dredging sites for submarine outfall	Construction planning and during construction period	Construction phase	As per the Particular Specification
Table 10-6		Erection of decorative mesh screens or construction hoardings and/or temporary noise barriers around works areas in visually unobtrusive colours.	To screen construction works from local residents and surrounding VSRs	DSD's contractor	STP, along gravity sewers and rising mains construction route and at temporary drilling site for submarine outfall	Construction planning and during construction period	Construction phase	As per the Particular Specification
Table 10-6	CM5	Avoidance of excessive height and bulk of site buildings and structures.	To reduce visual impact	DSD's contractor	STP, and at temporary drilling site for submarine outfall	Construction planning and during construction period	Construction phase	As per the Particular Specification
Table 10-6	CM6	Control of night-time lighting by hooding all lights and through minimisation of night working periods.	To maximize screening of the works	DSD's contractor	STP and at temporary drilling and dredging site for submarine outfall	Construction planning and during construction period	Construction phase	As per the Particular Specification

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
Table 10-6	CM7	All existing trees shall be carefully protected during construction. A Detailed Tree Protection Specification shall be provided in the Contract Specification. Under this specification, the Contractor shall be required to submit, for approval, a detailed working method statement for the protection of trees prior to undertaking any works adjacent to all retained trees, including trees in contractor's works areas. Tree risk assessment shall be undertaken to all existing trees within the project site as per "Guidelines for Tree Risk Assessment and Management Arrangement"	To maximize protection of existing trees	DSD's contractor	STP and all other construction areas	Construction planning and during construction period	Construction phase	As per Tree Protection Particular Specification, DEVB TC (W) No.10/2013 and Guidelines for Tree Risk Assessment and Management Arrangement
				DSD's Design Architect/ Engineer		Design Phase	Decision	
Table 10-7	OM3	Lighting units to be directional and minimise unnecessary light spill and glare.	To mitigate visual impacts	DSD's contractor	STP	Construction Phase & first year in Operational Phase	Design, Construction and Operational Phases	Detailed Design Drawings and Specifications
				Building Operator/DSD		Operational phase		
				DSD's Design Landscape Architect		Design Phase		
Table 10-7	OM4	Greening measures to reinstate the landscape which are appropriate to the context, including tree and shrub planting and vertical greening, shall be implemented.	To mitigate visual impacts	DSD's contractor	STP	Construction Phase & first year in Operational Phase	Design, Construction and Operational Phases	Detailed Design Drawings and Specifications
				Building Operator/DSD		Operational phase	se	

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
Table 10-7	OM5	Compensatory tree planting for all felled trees shall be provided to the satisfaction of relevant Government departments. Required numbers and locations of compensatory trees shall be determined and agreed separately with Government during the Tree Felling Application process under the relevant technical circulars. Tree risk assessment shall be undertaken to all existing trees within the project site as per "Guidelines for Tree Risk Assessment and Management Arrangement"	To mitigate landscape and visual impacts of tree loss	DSD's Landscape Architect Contractor's Landscape Architect Building Operator/DSD	outfall	Design Phase Construction Phase & first year in Operational Phase Operational phase	Operational Phases	As per approved Tree Removal Application, Detailed Design Drawings, Tree Protection Particular Specification and Guidelines for Tree Risk Assessment and Management Arrangement

EIA Ref.	EM&A Ref.	Recommended Mitigation Measures *	Objectives of the Recommended Measure & Main Concerns to address	Implementation Agent	Location of the measure	Duration of the measure	Implementation stages	Relveant Legislation & Guidelines
Built H	Ieritage							
Project	Specific I	Measures						
11.6	BH1	Undertake condition survey by professional qualified building surveyor or engineer to record the existing condition of the built heritage resources.	To record the condition of the built heritage resources before the commencement of construction works	DSD's Contractor	GB01, BH02, LF04	Before commencement of construction works	Construction phase	EIAO-TM and Guidelines for CHIA
11.6	BH2	Carry out vibration and settlement monitoring to built heritage resources. A maximum vibration level 7.5mm/s shall be adopted for the Grade 3 Hung Shing Temple and settlement check points in the Alert/Alarm/Action limit levels at 6mm/8mm/10mm shall be adopted.	impact by mechanical vibration	DSD's Contractor	GB01, BH02, LF04	During construction works	Construction phase	EIAO-TM and Guidelines for CHIA
11.6	вн	Provision of protective covering or protective screen to built heritage resources which are close to the works area	To prevent direct impact from the machine and damages by construction tools or waste	DSD's Contractor	GB01, BH02, LF01, LF04	During construction works	Construction phase	EIAO-TM and Guidelines for CHIA
11.6	BH4	Maintain public access to the cultural landscape features as far as possible	To avoid the proposed works affecting the worshippers	DSD's Contractor	LF01, LF04, LF05	During construction works	Construction phase	EIAO-TM and Guidelines for CHIA
11.6	BH5	Provision of buffer zone of at least 1m from the proposed works as far as possible	To prevent any direct and indirect impact	DSD's Contractor	BH02, LF01, LF04	During construction works	Construction phase	EIAO-TM and Guidelines for CHIA

\* All recommendations and requirements resulted during the course of EIA Process, including ACE and/or accepted public comment to the proposed project

Appendix 6-4

Recommended Mitigation Measures and Proactive Environmental Protection Proforma

#### Appendix 6-4 Recommended Mitigation Measures and Proactive Environmental Protection Proforma

Reporting Period: 2021-10-01 – 2021-10-31

Construction Works Area: PTO-SW-03 & STP

Anticipated Impacts: Dust, Noise, Water Quality, Terrestrial Ecology, Marine Ecology, Fisheries, Waste Management, Landscape and Visual and Build Heritage Impact.

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures	EM&A Manual Recommended Mitigation/ Actions	Action By	Measurement Procedures/Methods
Air Quality Impact	3.8	A10 - A25	<ul> <li>a) Major air quality impact in construction phase would arise from excavation of slope at the proposed sewage treatment plant.</li> <li>b) Excavation, Gas welding, slope cutting, Rock dowel, fencing, flexible barrier installation Loading &amp; Unloading Dusty Materials storage, Dusty Waste Sorting, Temporary Site Traffic Control</li> </ul>	<ul> <li>a) All construction plants / machineries will be checked / serviced on a regular basis during the courses of construction to minimize the emission of noise generation and eliminate dark smoke emission</li> <li>b) All dump trucks will be equipped with mechanical covers to prevent the dust emission during transportation when necessary.</li> <li>c) Dust control measures, such as water spraying, will be provided during</li> </ul>	<ul> <li>(a) Hoarding of not less than</li> <li>2.4 m high shall be erected</li> <li>from ground level to surround</li> <li>the work area along Po Toi O</li> <li>Chuen Road except for a site</li> <li>entrance or exit.</li> <li>(b) Good housekeeping to</li> <li>minimize dust generation, e.g.</li> <li>by properly handling and</li> <li>storing dusty materials.</li> <li>(c) Adopt dust control</li> <li>measures, such as dust</li> <li>suppression using water spray</li> <li>on exposed soil at least 4</li> <li>times a day, in areas with</li> <li>dusty construction activities</li> <li>and during material handling.</li> <li>(d) Minimize exposed earth</li> <li>after completion of work in a</li> </ul>	Contractor	<ul> <li>a) 1-hour and 24-hour TSP levels will be measured in accordance to the standard high-volume sampling method as set out in the Title 40 of the Code of Federal Regulations, Chapter 1 (Part 50), Appendix A.</li> <li>b) Due to objection from the residents of Po Toi O village of the use of high-volume sampler (HVS) in conducting 24-hours TSP measurement, 24-hour TSP measures for impact monitoring is to be measured by portable dust meters during construction phase of the project. This is to be approved and verified by ER and IEC.</li> </ul>

	EIA	EM&A	Environmental	Corresponding	EM&A Manual		Measurement
Item	Ref.	Ref.	Aspect	Mitigation Measures	<b>Recommended Mitigation/</b>	Action By	Procedures/Methods
	Nei.	Nei.	Азресс		Actions		riocedures/methods
				demolition works when	certain area by hydroseeding,		
				necessary.	vegetating, soil compacting or		c) Other than using high
				d) Maintaining of wet	covering with bitumen.		volume sampler, 1-hour
				surface on access road			TSP levels can be measured
				and keep slow speed in	(e) Provide wheel washing at		alternatively by direct
				the site.	site exit to prevent carrying		reading from portable dust
				e) Conditions in the	dust outside of the site.		meters upon approval from
				Environmental Permit			ER. The meters should be
				and Discharge License	(f) Cover materials on trucks		capable of producing comparable results as that
				should be followed	before leaving the site.		by the high-volume
				f) Predict required			sampling method, to
				quantity of concrete	(g) Limit vehicle speed of		indicate short event
				accurately and collect	construction trucks within the		impacts.
				the unused fresh	construction site and in Po Toi		
				concrete at designated	O, maximum at 10km/hr, and		d) -The ET shall agree with
				locations in the site for	confine vehicle movement in		the IEC on the monitoring
				subsequent disposal.	haul road.		position and the
				g) Provide sufficient			corrections adopted.
				g) Provide sufficient mitigation measures as	(h) As there is limited space		
				recommended in	in Po Toi O, stockpiling should		e) -The agreed position shall
				approved EIA Manual	be avoided. However, if found		be chosen in subsequent
				requirement.	necessary, the materials		baseline and impact
					should be covered by		monitoring.
					impervious materials such as		
					tarpaulin.		

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	N	orresponding 1itigation 1easures	EM&A Manual Recommended Mitigation/ Actions	Action By		Aeasurement Procedures/Methods
Noise Impact Control	4.7	N1 - N17	a) The Project comprises three main works including the construction of sewage treatment plant (STP), underground sewers and rising main, and the submarine outfall	a)	Conditions in the Environmental Permit and Discharge License should be followed		Contractor	a)	<ul> <li>Noise measurement shall normally be at a point 1 m from the exterior of the sensitive receiver building façade and be at a position</li> <li>1.2 m above the ground. If the normal monitoring position cannot be</li> </ul>
			<ul> <li>b) The major noise impact will arise from the use of powered mechanical equipment.</li> <li>c) Excavation, Gas welding,</li> </ul>	b)	Provide sufficient mitigation measures as recommended in approved EIA Manual				accessed, an alternative position may be chosen, and a correction to the measurements shall be made. For reference, a correction of +3 dB(A) shall be made to the free field
			slope cutting, Rock dowel, fencing, flexible barrier installation Loading & Unloading Dusty Materials storage, Temporary Site Traffic Control		requirement.			b)	<ul> <li>The ET shall agree with the IEC on the monitoring position and the corrections adopted.</li> </ul>
								c)	The agreed position shall be chosen in subsequent baseline and impact monitoring.

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures	EM&A Manual Recommended Mitigation/ Actions	Action By	Measurement Procedures/Methods
Water Quality impact	5.8	W1 - W33	<ul> <li>a) Major Water quality impact will be originated from minor displacement of suspended solids during installation, testing pipe and extraction of cofferdam around the proposed diffuser.</li> </ul>	<ul> <li>a) Wastewater to be treated by wastewater treatment facilities before discharge</li> <li>b) Conditions in the Environmental Permit and Discharge License should be followed</li> </ul>	<ul> <li>(a) Well manage construction materials, chemicals, sewage for proper storage and usage and to prevent accumulation onsite.</li> <li>(b) Immediately clean up contaminated soil upon chemical and oil leakage.</li> <li>(c) Label chemical waste containers according to the Code of Practice to notify and warn the waste handlers. Store fuels, chemicals and chemical waste at designated area with locks and bunds.</li> <li>(d) Register as chemical waste producer.</li> <li>(e) Set up sedimentation tank for settling suspended solids in wastewater before discharge into storm</li> </ul>	Contractor	<ul> <li>a) Weekly site audit to monitor the implementation of the proposed water quality mitigation measures and check the Contractor's work practice on water pollution prevention during construction phase.</li> <li>b) Should water pollution is observed (e.g. discharge of silty water into storm drains), the ET should record the environmental deficiency for investigation.</li> <li>c) The Contractor should be notified and responsible for carrying out rectification work immediately.</li> <li>d) The ET shall re-inspect the Project Site and review the effectiveness of the remedial measure performed until satisfaction.</li> <li>e) The Contractor shall implement preventive</li> </ul>

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures	EM&A Manual Recommended Mitigation/ Actions	Action By	Measurement Procedures/Methods
					drains. Sand/silt removal facilities such as sand traps, silt traps and sedimentation basin should be provided with adequate capacity. (f) Provide sufficient number of chemical toilets if necessary and employ licensed contractor for regular clean-up and maintenance.		measure to avoid causing the same problem.
					<ul> <li>(g) Provide wheel</li> <li>washing at site exit to</li> <li>prevent dust and silty</li> <li>water from leaving the</li> <li>construction site.</li> <li>(h) Cover slope and</li> <li>loose materials with</li> <li>tarpaulin before</li> <li>rainstorm and inspect the</li> <li>area afterwards.</li> </ul>		
					(i) Cover manhole to prevent silt, construction materials or debris and surface runoff from entering the foul sewer.		

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures	EM&A Manual Recommended Mitigation/ Actions	Action By	Measurement Procedures/Methods
					(j) Install fully enclosed cofferdam around the proposed diffuser and deploy a dredger barge outside the cofferdam for dredging and filling works.		

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures	EM&A Manual Recommended Mitigation/ Actions	Action By	Measurement Procedures/Methods
Terrestrial Ecology	6.12	E1-E8	<ul> <li>a) The proposed Project will cause minor habitat loss of shrubland, temporary habitat loss of woodland, developed area and rocky shore, and removal of one individual climber species of conservation importance that is common within the Study Area and Hong Kong. Indirect water quality impact may arise from surface runoff or accidental spillage of chemicals in construction phase.</li> <li>b) Use of powered plant equipment may bring noise disturbance on wildlife.</li> </ul>	<ul> <li>a) Conditions in the Environmental Permit and Discharge License should be followed</li> <li>b) Provide sufficient mitigation measures as recommended in approved EIA Manual requirement.</li> </ul>	<ul> <li>a) Construction noise and water quality mitigation measures proposed in the previous sections will be applicable to terrestrial ecology.</li> </ul>	Contractor	<ul> <li>(a)Bright colour fencing shall be erected along the boundary of the undisturbed region of the shrubland and woodland, and around <i>Diospyros vaccinioides</i>, a plant species of conservation importance, near the work boundary to remind workers not to trespass or occupy the area, and to be careful during operation of equipment.</li> <li>(b)Inspect the condition of <i>Diospyros vaccinioides</i> as part of weekly site audit.</li> <li>(c) Reinstate the disturbed rocky shore with the rocks temporarily removed.</li> <li>(d) Carry out compensatory tree planting in accordance with DEVB TCW No. 7/2015 to reinstate the affected woodland.</li> </ul>

Project No. 1825	
Monthly Environmental Monitoring & Audit Report for Port Sh	elter Phase 3, Po Toi O Sewerage Treatment Plant

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures	EM&A Manual Recommended Mitigation/ Actions	Action By	Measurement Procedures/Methods
Marine Ecology	7	7	<ul> <li>a) The proposed Project will cause minor habitat loss of muddy seabed.</li> <li>b) Indirect water quality impact may arise from installation and extraction of sheet pile of cofferdam in construction phase.</li> <li>c) Dredging and backfilling for installation of diffuser will be conducted inside fully enclosed cofferdam. No marine sediment loss to water column is expected.</li> </ul>	a) Conditions in the Environmental Permit and Discharge License should be followed	a) The variation in water quality at coral and amphioxus habitats during cofferdam installation and extraction works will be overseen by water quality monitoring mentioned.	Contractor	<ul> <li>a) No specific monitoring and audit programme is required. With proper implementation of water quality mitigation measures, residual impact is expected to be acceptable.</li> </ul>

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures	EM&A Manual Recommended Mitigation/ Actions	Action By	Measurement Procedures/Methods
Fisheries	8	8	<ul> <li>a) No direct encroachment on Fish Culture Zone and Artificial Reefs in the Study Area is expected.</li> <li>b) About 1,920 m<sup>2</sup> of fishing ground and 500 m<sup>2</sup> of benthic spawning ground will be affected. Except the 5 m<sup>2</sup> benthic spawning ground will be lost permanently, other impacted area will only be affected in construction phase temporarily (reversible impact). Indirect impact on fisheries resources by the water quality deterioration will be insignificant with proper implementation of water quality mitigation measures.</li> </ul>	a) Conditions in the Environmental Permit and Discharge License should be followed	Water quality at FCZ will be monitored during cofferdam installation and extraction works and dredging works in the construction phase as proposed.	Contractor	<ul> <li>a) No specific monitoring and audit programme are required. With proper implementation of water quality mitigation measures, residual impact is anticipated to be acceptable.</li> </ul>

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures	EM&A Manual Recommended Mitigation/ Actions	Action By	Measurement Procedures/Methods
Waste Management	9.8	WM4- WM23	<ul> <li>a) Construction of the sewage treatment plant, laying of gravity sewers and rising mains and submarine outfall are expected to generate mainly inert construction and demolition (C&amp;D) materials (or public fill) from excavation, and unused building materials. Other wastes include non-inert C&amp;D materials (or C&amp;D waste), plant materials, scaffolding, formwork and packaging, chemical waste from plant maintenance, bentonite slurry from drilling works and general refuse from workers.</li> <li>b) Dredging at the proposed diffuser location will generate marine sediment.</li> </ul>	<ul> <li>a) All C&amp;D materials generated will be transported and stored at temporary storage area. Cover will be provided during transportation of dusty materials. Suitable materials will be sorted for reuse on-site. Only non-inert C&amp;D material will be disposed off- site to NENT Landfill.</li> <li>b) Conditions in the Environmental Permit and Discharge</li> </ul>	<ul> <li>(a) Reuse C&amp;D materials onsite and dispose excess uncontaminated ones to public fill.</li> <li>(b) Provide sufficient waste collection points for general refuse and regularly maintained to avoid accumulation.</li> <li>Dispose the waste at waste transfer or disposal facilities.</li> <li>(c) Minimize wastage through careful planning and avoiding over- purchase of construction materials.</li> <li>(d) Provide training to workers on site cleanliness, waste management (waste reduction, reuse and recycle) and chemical handling procedures.</li> <li>(e) Hire licensed waste disposal contractors for</li> </ul>	Contractor	<ul> <li>The Contractor should apply for relevant licences/permits for waste disposal under different regulations and ordinances as follows:</li> <li>(a) Chemical Waste Permits/licenses under the Waste Disposal Ordinance (Cap 354);</li> <li>(b) Public Dumping Licence under the Land (Miscellaneous Provisions) Ordinance (Cap 28);</li> <li>(c) Marine Dumping Permit under Dumping at Sea Ordinance (Cap 466); and</li> <li>(d) Effluent Discharge Licence under the Water Pollution Control Ordinance (Cap 358).</li> <li>b) Reference should be made to EPD's booklets on licences/permits. The Contractor shall also document recycling receipts/ disposal record to keep track of waste movement. The ET shall check with the Contractor</li> </ul>

ltem	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures	EM&A Manual Recommended Mitigation/ Actions	Action By	Measurement Procedures/Methods
				License should be followed c) Fueling of equipment will be conducted carefully on- site by mobile tanker to avoid storage of fuel and oil spillage. d) Provision of drip trays for equipment likely cause spillage of chemical / fuel, and provide routine maintenance.	<ul> <li>waste collection and removal. Dispose waste at licensed waste disposal facilities.</li> <li>(f) Recondition and reuse bentonite as far as practical.</li> <li>(g) Conduct marine sediment test and dump dredged marine sediment according to <i>ETWB TCW No</i>. <i>34/2002 Management of</i> <i>Dredged/Excavated</i> <i>Sediment</i> and Dumping at Sea Ordinance.</li> <li>(h) Chemical waste shall be handled, stored and disposed properly, according to the relevant guidelines.</li> </ul>		that these licences/permits have been obtained. He should also review the above documentations regularly to ensure compliance with legislations and specifications.

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures	EM&A Manual Recommended Mitigation/ Actions	Action By	Measurement Procedures/Methods
Landscape and Visual impact	Table 10-6 & 10- 7	CM1- CM8 & OM1- OM5	<ul> <li>a) Minor landscape and visual impact is expected due to dredging work in open sea, construction of the STP and pipelines on land and the loss of existing trees and vegetation at the sewage treatment plant site in the construction phase.</li> </ul>	<ul> <li>a) Conditions in the Environmental Permit and Discharge License should be followed</li> <li>b) Implement the recommended mitigation proposed in EM&amp;A manual</li> </ul>	a) The contractor shall employ a professionally qualified Registered Landscape Architect (RLA) on the Environmental Team to supervise and monitor the implementation of construction phase landscape and visual mitigation measures. This is necessary to ensure that all the recommended landscape and visual mitigation measures under Chapter 10 of the EIA are effectively implemented including minimization of the works footprint, ensuring that those existing trees earmarked for retention on site or transplanting are protected and planting works are correctly implemented.	Contractor	<ul> <li>a) Tree risk assessment shall be undertaken by the contractor during construction to all existing trees within the project site as per "Guidelines for Tree Risk Assessment and Management Arrangement".</li> <li>b) Site inspections by appointed RLA shall be undertaken at monthly intervals to closely monitor all these aspects of work. Inspection findings shall be logged in a site monitoring report with any discrepancies or concerns regarding the implementation and effectiveness of mitigation measures highlighted.</li> </ul>

Item	EIA Ref.	EM&A Ref.	Environmental Aspect	Corresponding Mitigation Measures		EM&A Manual Recommended Mitigation/ Actions		Action By		Measurement Procedures/Methods	
Build Heritage	11.6	BH1 - BH5	<ul> <li>a) As the proposed work is close to some of the identified built heritage resources, condition survey, vibration and settlement monitoring are recommended to identified built heritage to prevent indirect damage by mechanical vibration and settlement.</li> </ul>	,	Conditions in the Environmental Permit and Discharge License should be followed Provide sufficient mitigation measures as recommended in approved EIA Manual requirement.	a) b)	Provision of protective covering or protective screen is recommended to identified built heritage to prevent damages by construction tools or waste. Maintenance of public access is suggested for identified built heritage. Besides, buffer zone of at least 1m from the works boundary should be provided for identified built heritage as far as possible. Condition survey, vibration and settlement monitoring to identified built heritage.	Contractor	a)	A maximum vibration level of 7.5mm/s shall be adopted for the Grade 3 Hung Shing Temple and settlement check points in the Alert/Alarm/Action limit levels at 6mm/8mm/10mm shall be adopted.	

Appendix 6-5

Cumulative Statistics on Complaints, Notifications of Summons

Appendix 6-5 Cumulative Statistics on Complaints, Notifications of Summons, Successful Prosecutions and Public Engagement Activities

### **Environmental Complaints Log**

Complaint Log No.	Date of Complaint	Received From	Received By	Nature of Environmental Complaint	Relevant to the Construction Work of Project Site? (Y/N)	Investigation/ Mitigation Action	Status
-	-	-	-	-	_	-	-

Remark:

\* No Complaints, Notifications of Summons or Successful Prosecutions was received in the reporting period.

### Cumulative Statistics on Complaints, Notifications of Summons and Successful Prosecutions and Public Engagement Activities

Reporting Period	Complaints	Notifications of Summons and Prosecutions	Public Engagement Activities		
This Month	0	0	0		
Cumulative Project-to-Date	0	0	0		